

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION

ORDER NO. 84-12
NPDES NO. CA0104507

WASTE DISCHARGE REQUIREMENTS
FOR
SEELEY COUNTY WATER DISTRICT
Imperial County

The California Regional Water Quality Control Board, Colorado River Basin Region, finds that:

1. Seeley County Water District (hereinafter also referred to as the discharger), P. O. Box 161, Seeley, California 92273, submitted an updated NPDES Application for Permit to Discharge dated November 17, 1983. Said application is assigned Application No. CA0104507.
2. The discharger presently discharges a peak month average daily flow of 102,000 gallons-per-day and a peak week average daily flow of 118,000 gallons-per-day of wastewater into stabilization basins that are designed for an average daily flow of 125,000 gallons-per-day. The effluent is discharged into New River in the NW $\frac{1}{4}$ of Section 11, T16S, R12E, SBB&M, 46 miles from Salton Sea.
3. The Environmental Protection Agency, in Federal Register Volume 43, No. 221, dated November 15, 1978, issued secondary treatment regulations regarding suspended solids limitations for publicly-owned waste stabilization basins. In California the limit is 95 mg/l based on a 30 consecutive day average.
4. The Water Quality Control Plan for the West Colorado River Basin Region was adopted on April 10, 1975. The Basin Plan contains water quality objectives for Imperial Hydrologic Unit.
5. Beneficial uses of water of New River to be protected by this Order are as follows:
 - a. Transport of dissolved solids to Salton Sea for agricultural soil salinity control.
 - b. Freshwater replenishment for Salton Sea.
 - c. Warm freshwater habitat for fish and wildlife.
 - d. Recreation - non-water contact.
6. The issuance of waste discharge requirements for this discharge is exempt from the provisions of Chapter 3 (commencing with Section 21000 et. seq.) of Division 13 of the Public Resources Code in accordance with Water Code Section 13389.
7. The discharge has been subject to waste discharge requirements adopted in Order No. 79-24 (NPDES No. CA0104507), which allows discharge to New River.

*Resubmitted
3/19/86 /
86-34*

8. The discharge is subject to Cease and Desist Order No. 79-37, dated March 14, 1979, for compliance with BOD limitations. On April 6, 1983, Cleanup and Abatement Order No. 83-50 was issued providing a new time schedule for compliance with BOD and Suspended Solids limitations.
9. The Board has notified the discharger and interested agencies and persons of its intent to update requirements for the existing discharge and has provided them with an opportunity for a public hearing and an opportunity to submit their written views and recommendations.
10. The Board in a public hearing heard and considered all comments pertaining to the discharge.
11. This Order shall serve as a National Pollutant Discharge Elimination System Permit pursuant to Section 402 of the Federal Clean Water Act, or amendments thereto, and shall take effect at the end of ten days from date of hearing provided the Regional Administrator has no objections.

IT IS HEREBY ORDERED, Seeley County Water District, in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, and the provisions of the Federal Clean Water Act and regulations and guidelines adopted thereunder, shall comply with the following:

A. Effluent Limitations

1. Representative samples of wastewater discharged to New River shall not contain constituents in excess of the following limits:

Constituent	Unit	30-Day Arithmetic Discharge Mean Rate	7-Day Arithmetic Discharge Mean Rate
20°C BOD ₅	lbs/day	31	47
	mg/l	30	45
Suspended Solids	lbs/day	99	—
	mg/l	95	—
Settleable Matter	ml/l	0.3	0.5

2. The arithmetic mean of the values for effluent samples collected for 20°C BOD₅ and for suspended solids in any 30-day period shall not be greater than 15 percent of the arithmetic mean of the values for influent samples collected during the same 30-day period (85 percent removal).
3. The effluent values for pH shall remain within the limits of 6.0 to 9.0.
4. The peak month average daily flow shall not exceed 125,000 gallons-per-day.


B. Receiving Water Limitations

1. Wastewater discharged to New River shall not:
 - a. Depress the dissolved oxygen content of said Drain below 5.0 mg/l.
 - b. Cause presence of oil, grease, scum, sludge, or solids.
 - c. Contain heavy metals or associated chemicals or pesticides in concentrations toxic to fish and other aquatic life.
2. This discharge shall not cause a violation of any applicable water quality standard for receiving waters adopted by the Regional Board or the State Water Resources Control Board as required by the Federal Clean Water Act and regulations adopted thereunder.

C. Provisions

1. Neither the treatment nor the discharge of wastes shall cause a pollution or a nuisance, as defined in Division 7 of the California Water Code.
2. Adequate protective works shall be provided to assure that a flood which would be expected to occur on a frequency of once in a 100-year period, would not erode or otherwise render portions of the treatment and discharge facilities inoperable.
3. This Order supersedes this Board's Order No. 79-24.
4. This Order includes the attached "Monitoring and Reporting Program No. 84-12", and future revisions thereto, as specified by the Executive Officer.
5. This Order expires five (5) years from January 18, 1984 and the discharger shall file a Report of Waste Discharge in accordance with Title 23, California Administrative Code, not later than 180 days in advance of such date as an application for issuance of new waste discharge requirements.
6. Facilities shall be available to keep the plant in operation in the event of commercial power failure.
7. The discharger's wastewater treatment plant shall be supervised and operated by persons possessing certification of appropriate grade pursuant to Chapter 3, Subchapter 14, Title 23, California Administrative Code.

I, Arthur Swajian, Executive Officer, do hereby certify the foregoing is a full, true and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on January 18, 1984.



Executive Officer

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION**

**MONITORING AND REPORTING PROGRAM NO. 84-12
FOR
SEELEY COUNTY WATER DISTRICT
Imperial County**

Location of Discharge: New River in the NW $\frac{1}{4}$ of Section 11, T16S, R12E, SBB&M

EFFLUENT MONITORING

Wastewater discharged into New River shall be monitored for the following constituents. All samples shall be taken between 6 a.m. and 6 p.m. A sampling station shall be established at the point of discharge and shall be located where representative samples of the effluent can be obtained.

<u>Constituent</u>	<u>Unit</u>	<u>Type of Sample</u>	<u>Sampling Frequency</u>
20°C BOD ₅	mg/l	8-Hr. Composite	Monthly
Suspended Solids	mg/l	8-Hr. Composite	Monthly
Settleable Matter	ml/l	Grab at Peak Flow	Weekly
pH	pH Units	Grab	Weekly
Flow	Gallons	Daily ¹	Reported Monthly

INFLUENT MONITORING

The wastewater influent to the treatment facilities shall be monitored for 20°C BOD₅ and for Suspended Solids, quarterly, 8-Hr. Composite.

1. For each day with average monthly flow calculated

REPORTING

Monthly and weekly monitoring reports shall be submitted to the Regional Board by the 15th day of the following month. Quarterly reports shall be submitted by January 15, April 15, July 15, and October 15 of each year.

The discharger shall implement the above monitoring program within 30 days of the effective date of this Order No. 84-12.


Forward monitoring reports to:

California Regional Water Quality Control Board
Colorado River Basin Region
73-271 Highway 111, Suite 21
Palm Desert, CA 92260

ORDERED BY:

Arthur Swajian
Executive Officer
Jan-26, 1984
Date

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD - 7

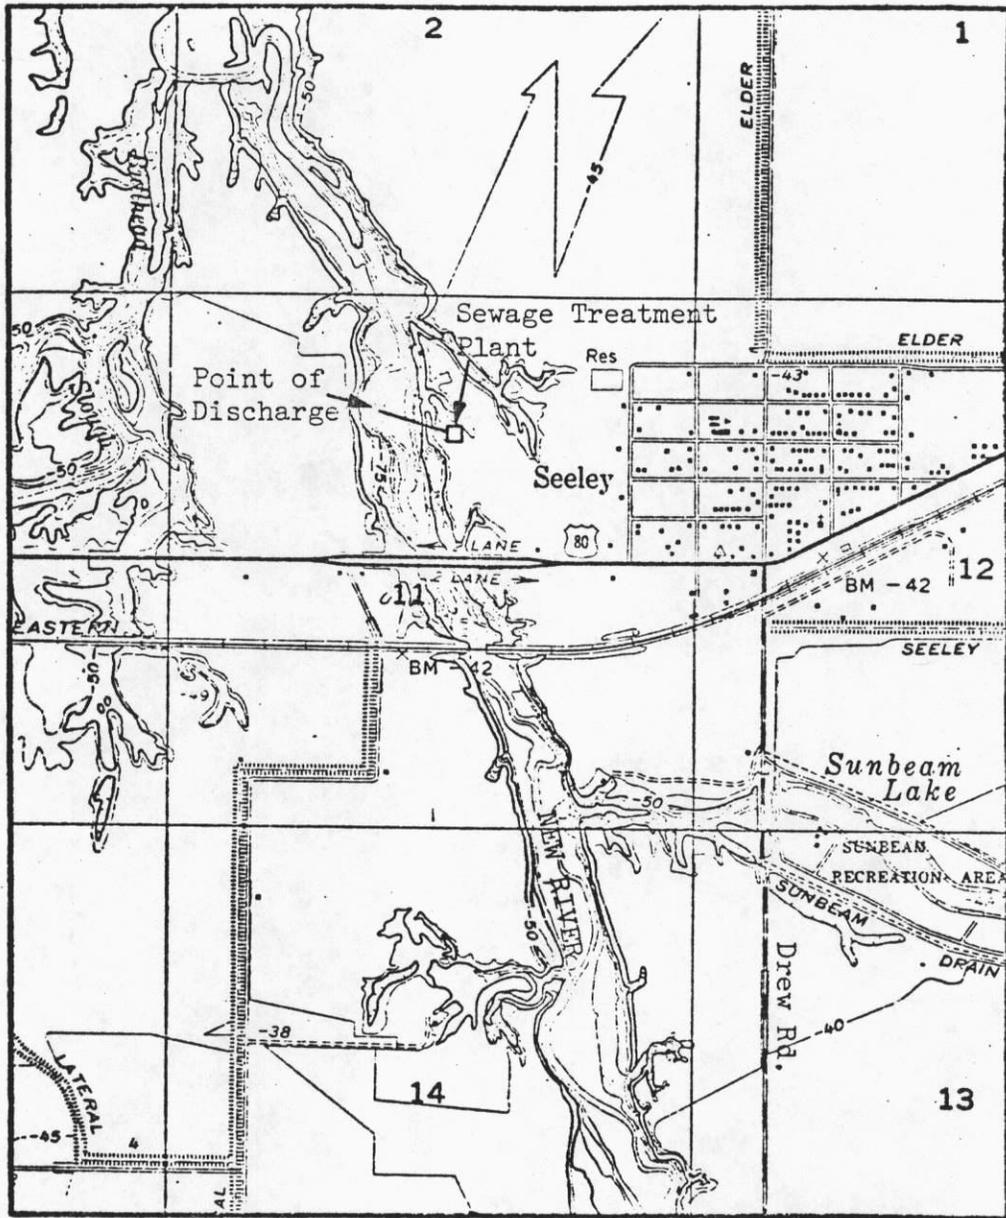

SITE MAP

SEELEY COUNTY WATER DISTRICT
..Imperial County

Discharge Point: New River, in NW 1/4 of Section 11, T16S, R12E, SBB&M

USGS Seeley 7.5 min. Topographic Map

Order No. 84-12