

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION**

ORDER NO. 84-59

**WASTE DISCHARGE REQUIREMENTS
FOR
METROPOLITAN WATER DISTRICT OF SOUTHERN CALIFORNIA
GENE PUMPING PLANT FACILITIES
West of Parker Dam - San Bernardino County**

The California Regional Water Quality Control Board, Colorado River Basin Region, finds that:

1. Metropolitan Water District of Southern California (hereinafter also referred to as the discharger), P.O. Box 54153, Los Angeles, California 90054, verified on March 5, 1984, that the below updated information is accurate.
2. The discharge from this pumping plant and residential facility has been subject to waste discharge requirements adopted in Board Order No. 76-54.
3. The discharger is discharging a maximum of 20,000 gallons-per-day of domestic sewage from the facilities of a pumping plant, consisting of 56 houses, 20-room guest lodge, a dormitory, an office building, and six restrooms. Wastewater is discharged into septic tank/leach line disposal systems located in the S $\frac{1}{2}$ of Section 5, T2N, R27E, SBB&M.
4. The discharger is reserving areas of sufficient size for possible future 100 percent replacement of leach lines.
5. There are no domestic wells within 200 feet of the discharge facilities described in Finding No. 3 (above).
6. The Water Quality Control Plan for the East Colorado River Basin was adopted on April 10, 1975. The Basin Plan contains water quality objectives for the Colorado Hydrologic Subunit.
7. The beneficial uses of ground water of the Colorado Hydrologic Subunit are:
 - a. Municipal supply
 - b. Industrial supply
 - c. Agricultural supply
8. The Board has notified the discharger and interested agencies and persons of its intent to update waste discharge requirements for the discharge.

*Replaced by
~~97-50095~~
94-080*

9. The Board in a public meeting heard and considered all comments pertaining to the discharge.
10. This pumping plant facility constitutes an ongoing project in accordance with provisions of the California Environmental Quality Act (Public Resources Code Section 21000 et. seq.) and the State Guidelines because the governmental approvals on or after April 5, 1973, do not involve a greater degree of responsibility or control over such activity than the governmental approvals received prior to that date.

IT IS HEREBY ORDERED, the discharger shall comply with the following:

A. Discharge Specifications

1. Neither the treatment nor the discharge of wastewater shall create a pollution or a nuisance as defined in Division 7 of the California Water Code.
2. No wastewater other than domestic sewage shall be discharged at this location.
3. Wastewater discharged subsurface shall be retained underground with no surfacing.
4. Adequate measures shall be taken to assure that flood or surface drainage waters do not erode or otherwise render portions of the discharge facilities inoperable.
5. Septic tank cleanings shall be discharged only by a duly authorized service.

B. Provision

1. Sufficient land area shall be reserved for possible future 100 percent replacement of the leach lines, until such time as this facility is connected to a municipal sewerage system.
2. Upon request from this Board's Executive Officer, the discharger shall furnish technical and/or monitoring reports on the treatment and discharge of wastes.
3. Prior to any modifications in this facility which would result in material change in the quality or quantity of wastewater discharged, or any material change in location of discharge, the discharger shall report in writing to the Regional Board.
4. This Order supersedes Board Order No. 76-54.

I, Arthur Swajian, Executive Officer, do hereby certify the foregoing is a full, true and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on May 16, 1984.


Executive Officer

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION**

MONITORING AND REPORTING PROGRAM NO. 84-59
FOR
METROPOLITAN WATER DISTRICT OF SOUTHERN CALIFORNIA
GENE PUMPING PLANT FACILITIES
West of Parker Dam - San Bernardino County

Location of Discharge: S $\frac{1}{2}$ of Section 5, T2N, R27E, SBB&M

MONITORING

The discharger shall report to the Regional Board the following:

<u>Constituent</u>	<u>Unit</u>	<u>Reporting Frequency</u>
Volume of waste discharged	gallons	quarterly

REPORTING

Quarterly monitoring reports shall be submitted to the Regional Board by the 15th day of January, April, July, and October.

Mail reports to:


California Regional Water Quality Control Board
Colorado River Basin Region
73-271 Highway 111, Suite 21
Palm Desert, CA 92260

ORDERED BY:

Arthur Sujan
Executive Officer

Dec. 18, 1987
Date

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD - 7

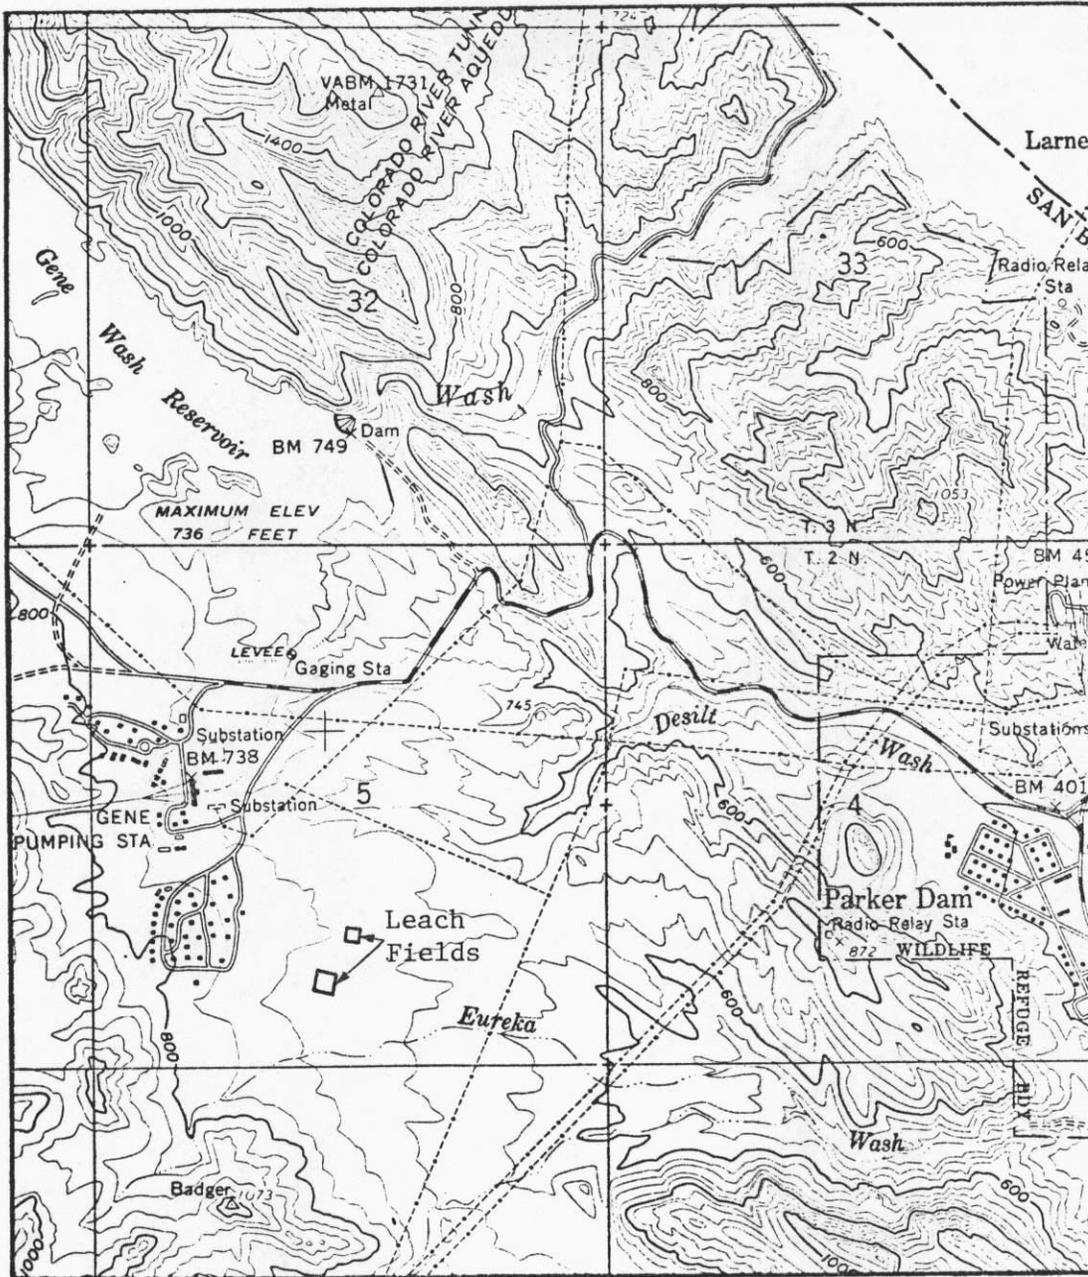

Scale:
1"=2,000'

SITE MAP

METROPOLITAN WATER DISTRICT OF SOUTHERN CALIFORNIA
 GENE PUMPING PLANT FACILITIES
 West of Parker Dam - San Bernardino County
 S½ of Section 5, T2N, R27E, SBB&M
 USGS Gene Wash 7.5 min. Topographic Map

Order No. 84-59