

Locations of Contaminated Sources at Alternative MCL Values

Alternative MCL Value of 1 ug/L

Under an alternative MCL value of 1 ug/L, there would be detections of hexavalent chromium above the MCL in public water system drinking water sources in the following counties:

Alameda, Amador, Butte, Colusa, Contra Costa, Del Norte, El Dorado, Fresno, Glenn, Humboldt, Imperial, Inyo, Kern, Kings, Lake, Lassen, Los Angeles, Madera, Mariposa, Mendocino, Merced, Modoc, Monterey, Napa, Nevada, Orange, Placer, Plumas, Riverside, Sacramento, San Benito, San Bernardino, San Diego, San Francisco, San Joaquin, San Luis Obispo, San Mateo, Santa Barbara, Santa Clara, Santa Cruz, Shasta, Siskiyou, Solano, Sonoma, Stanislaus, Sutter, Tehama, Trinity, Tulare, Tuolumne, Ventura, Yolo, and Yuba.

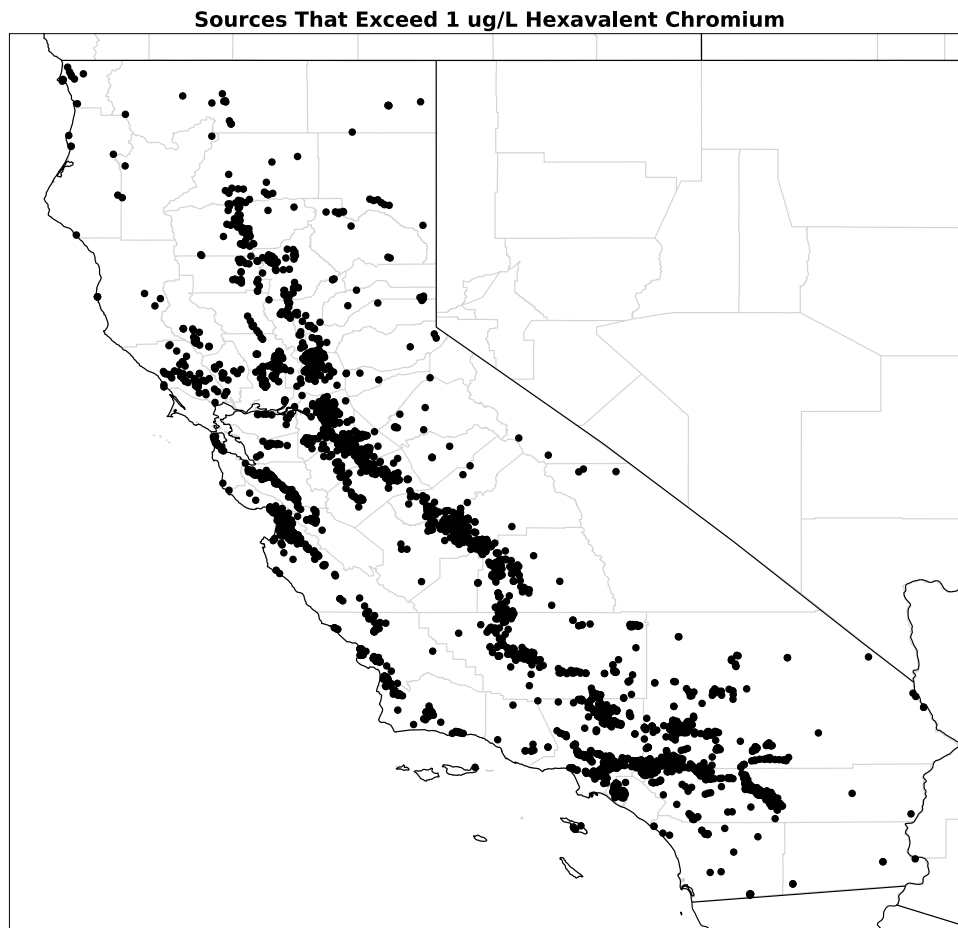


Figure 1. Public Water System Drinking Water Sources Above 1 ug/L

Alternative MCL Value of 2 ug/L

Under an alternative MCL value of 2 ug/L, there would be detections of hexavalent chromium above the MCL in public water system drinking water sources in the following counties:

Alameda, Amador, Butte, Colusa, Contra Costa, Del Norte, El Dorado, Fresno, Glenn, Humboldt, Imperial, Inyo, Kern, Kings, Lake, Lassen, Los Angeles, Madera, Mariposa, Merced, Monterey, Napa, Nevada, Orange, Placer, Riverside, Sacramento, San Benito, San Bernardino, San Diego, San Francisco, San Joaquin, San Luis Obispo, San Mateo, Santa Barbara, Santa Clara, Santa Cruz, Shasta, Siskiyou, Solano, Sonoma, Stanislaus, Sutter, Tehama, Trinity, Tulare, Tuolumne, Ventura, Yolo, and Yuba.

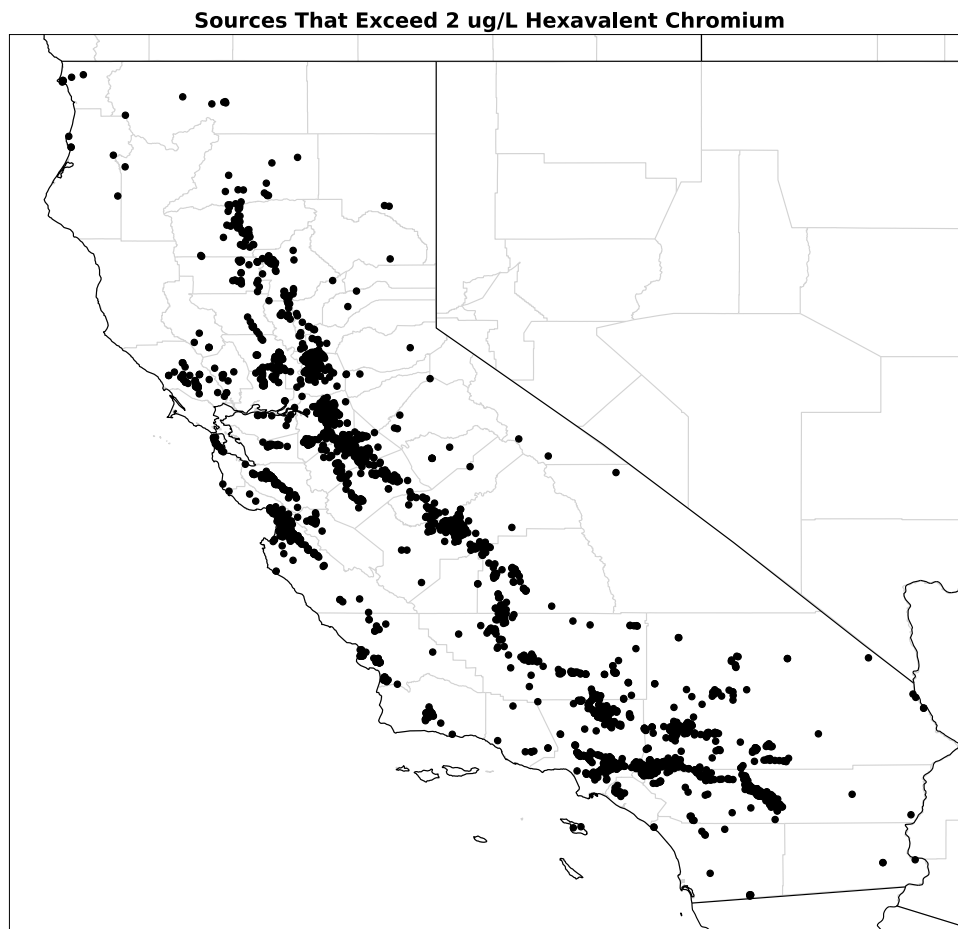


Figure 2. Public Water System Drinking Water Sources Above 2 ug/L

Alternative MCL Value of 3 ug/L

Under an alternative MCL value of 3 ug/L, there would be detections of hexavalent chromium above the MCL in public water system drinking water sources in the following counties:

Alameda, Amador, Butte, Colusa, Contra Costa, Del Norte, El Dorado, Fresno, Glenn, Humboldt, Imperial, Inyo, Kern, Lake, Lassen, Los Angeles, Madera, Mariposa, Merced, Monterey, Napa, Nevada, Orange, Placer, Riverside, Sacramento, San Benito, San Bernardino, San Diego, San Francisco, San Joaquin, San Luis Obispo, San Mateo, Santa Barbara, Santa Clara, Santa Cruz, Shasta, Siskiyou, Solano, Sonoma, Stanislaus, Sutter, Tehama, Trinity, Tulare, Tuolumne, Ventura, Yolo, and Yuba.

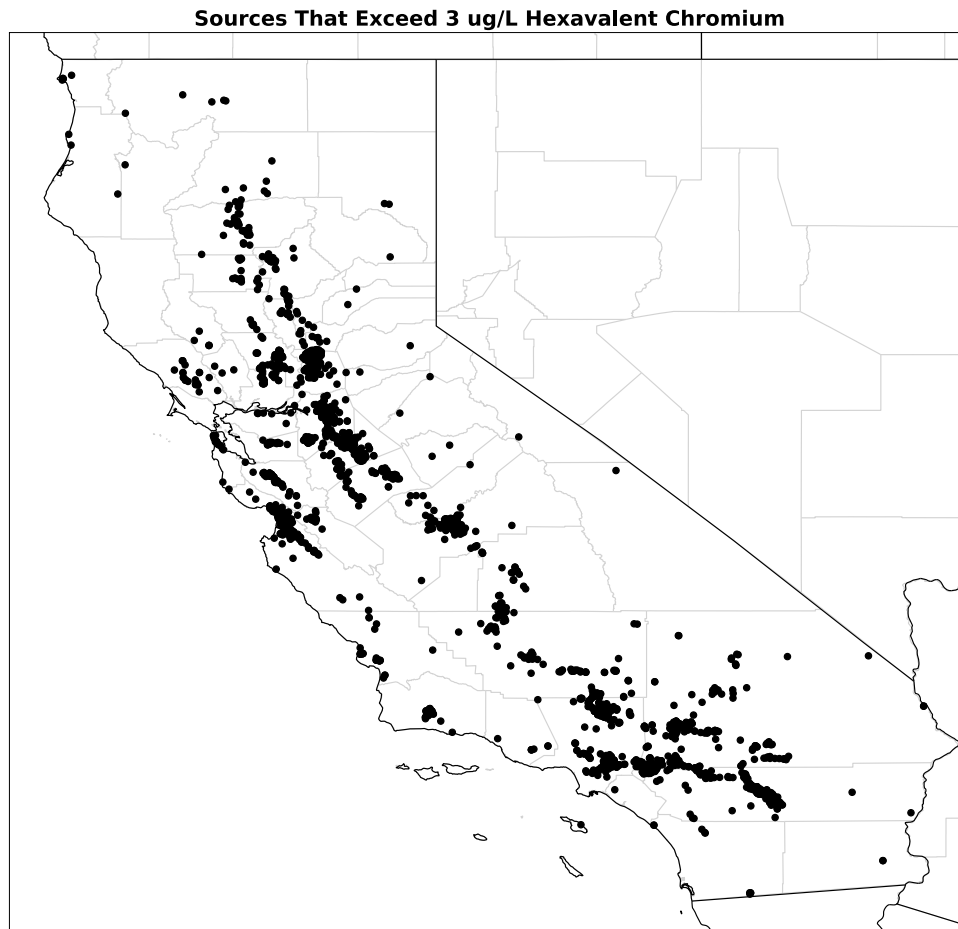


Figure 3. Public Water System Drinking Water Sources Above 3 ug/L

Alternative MCL Value of 4 ug/L

Under an alternative MCL value of 4 ug/L, there would be detections of hexavalent chromium above the MCL in public water system drinking water sources in the following counties:

Alameda, Amador, Butte, Colusa, Contra Costa, Del Norte, El Dorado, Fresno, Glenn, Humboldt, Imperial, Inyo, Kern, Lake, Lassen, Los Angeles, Madera, Mariposa, Merced, Monterey, Napa, Nevada, Placer, Riverside, Sacramento, San Benito, San Bernardino, San Diego, San Francisco, San Joaquin, San Luis Obispo, San Mateo, Santa Barbara, Santa Clara, Santa Cruz, Shasta, Siskiyou, Solano, Sonoma, Stanislaus, Sutter, Tehama, Trinity, Tulare, Tuolumne, Ventura, Yolo, and Yuba.

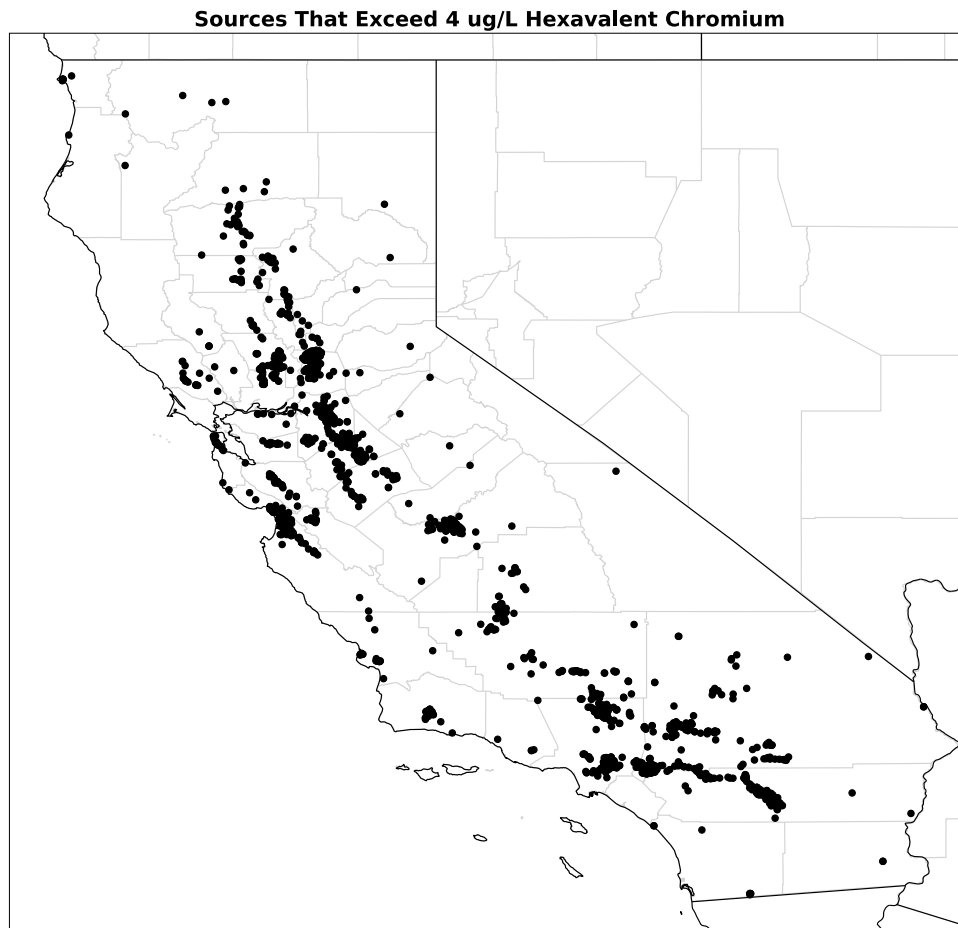


Figure 4. Public Water System Drinking Water Sources Above 4 ug/L

Alternative MCL Value of 5 ug/L

Under an alternative MCL value of 5 ug/L, there would be detections of hexavalent chromium above the MCL in public water system drinking water sources in the following counties:

Alameda, Butte, Colusa, Contra Costa, Del Norte, El Dorado, Fresno, Glenn, Humboldt, Imperial, Inyo, Kern, Lake, Los Angeles, Madera, Mariposa, Merced, Monterey, Napa, Nevada, Placer, Riverside, Sacramento, San Benito, San Bernardino, San Diego, San Francisco, San Joaquin, San Luis Obispo, San Mateo, Santa Barbara, Santa Clara, Santa Cruz, Shasta, Siskiyou, Solano, Sonoma, Stanislaus, Sutter, Tehama, Trinity, Tulare, Tuolumne, Ventura, and Yolo.

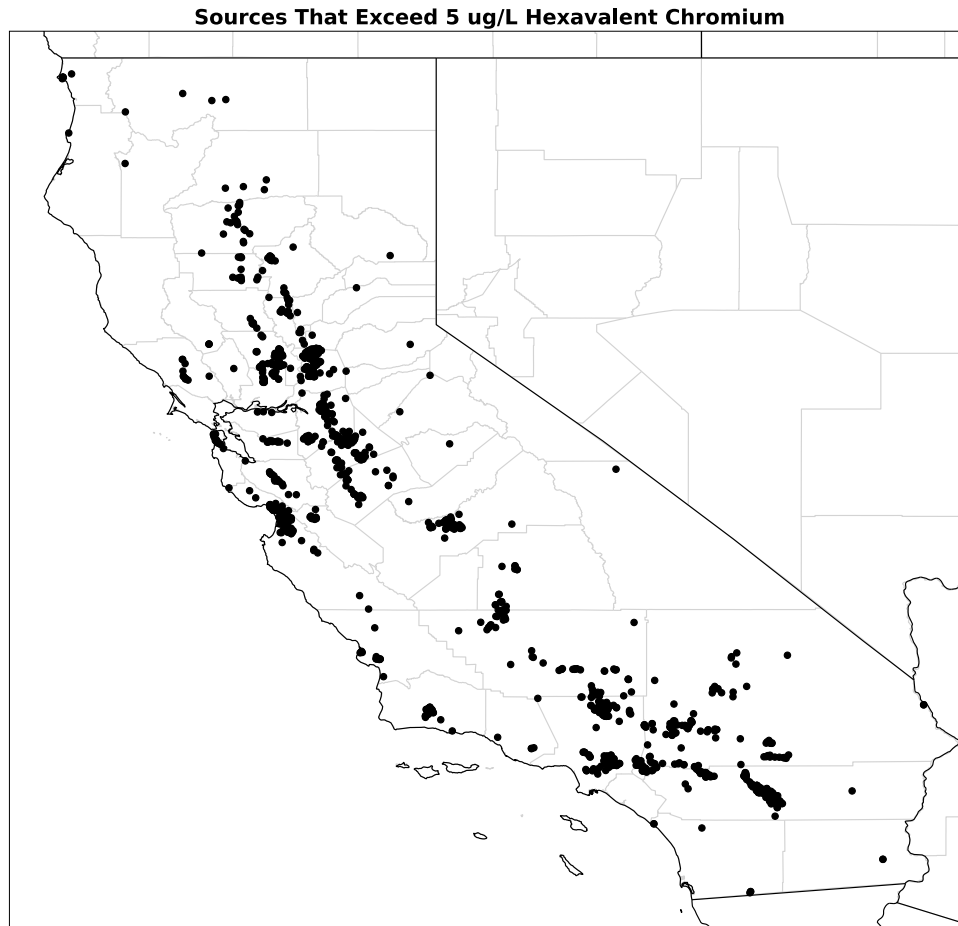


Figure 5. Public Water System Drinking Water Sources Above 5 ug/L

Alternative MCL Value of 6 ug/L

Under an alternative MCL value of 6 ug/L, there would be detections of hexavalent chromium above the MCL in public water system drinking water sources in the following counties:

Alameda, Butte, Colusa, Contra Costa, Del Norte, El Dorado, Fresno, Glenn, Humboldt, Imperial, Kern, Lake, Los Angeles, Madera, Mariposa, Merced, Monterey, Napa, Nevada, Placer, Riverside, Sacramento, San Benito, San Bernardino, San Diego, San Francisco, San Joaquin, San Luis Obispo, San Mateo, Santa Barbara, Santa Clara, Santa Cruz, Shasta, Siskiyou, Solano, Sonoma, Stanislaus, Sutter, Tehama, Trinity, Tulare, Tuolumne, Ventura, and Yolo.

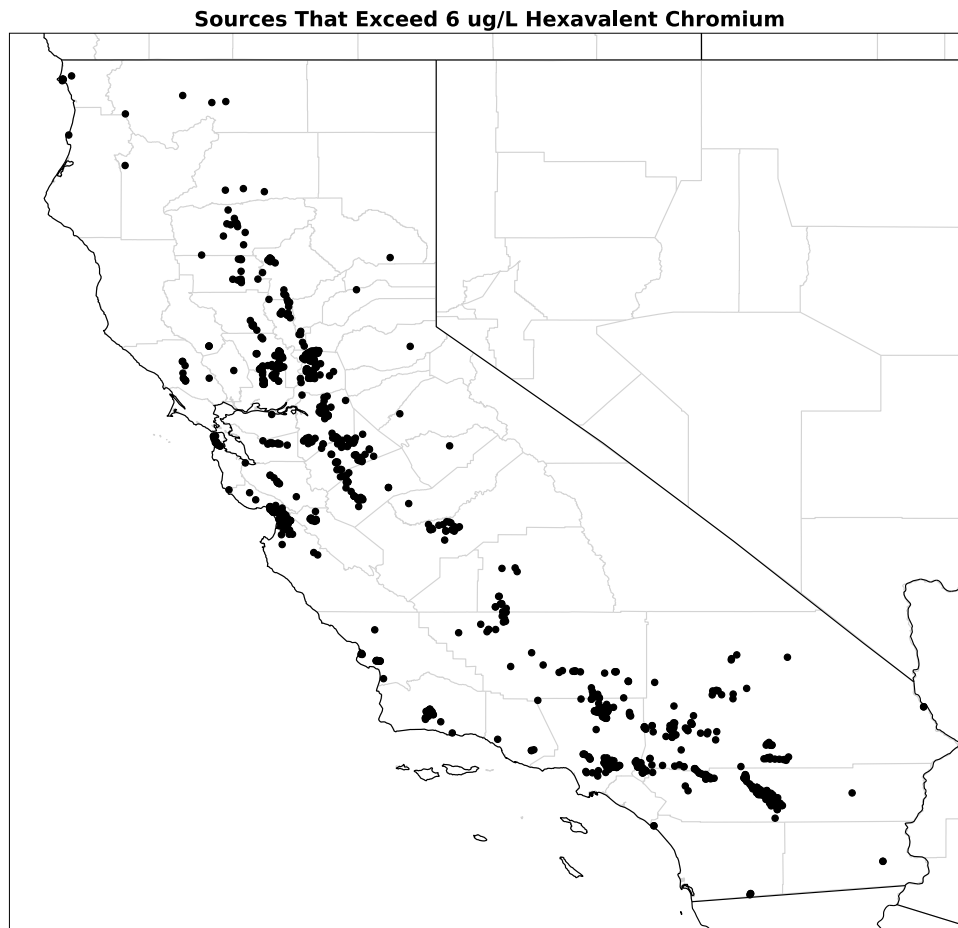


Figure 6. Public Water System Drinking Water Sources Above 6 ug/L

Alternative MCL Value of 7 ug/L

Under an alternative MCL value of 7 ug/L, there would be detections of hexavalent chromium above the MCL in public water system drinking water sources in the following counties:

Alameda, Butte, Colusa, Contra Costa, Del Norte, El Dorado, Fresno, Glenn, Imperial, Kern, Lake, Los Angeles, Mariposa, Merced, Monterey, Napa, Nevada, Placer, Riverside, Sacramento, San Benito, San Bernardino, San Diego, San Francisco, San Joaquin, San Luis Obispo, San Mateo, Santa Barbara, Santa Clara, Santa Cruz, Shasta, Siskiyou, Solano, Sonoma, Stanislaus, Sutter, Tehama, Trinity, Tulare, Ventura, Yolo,

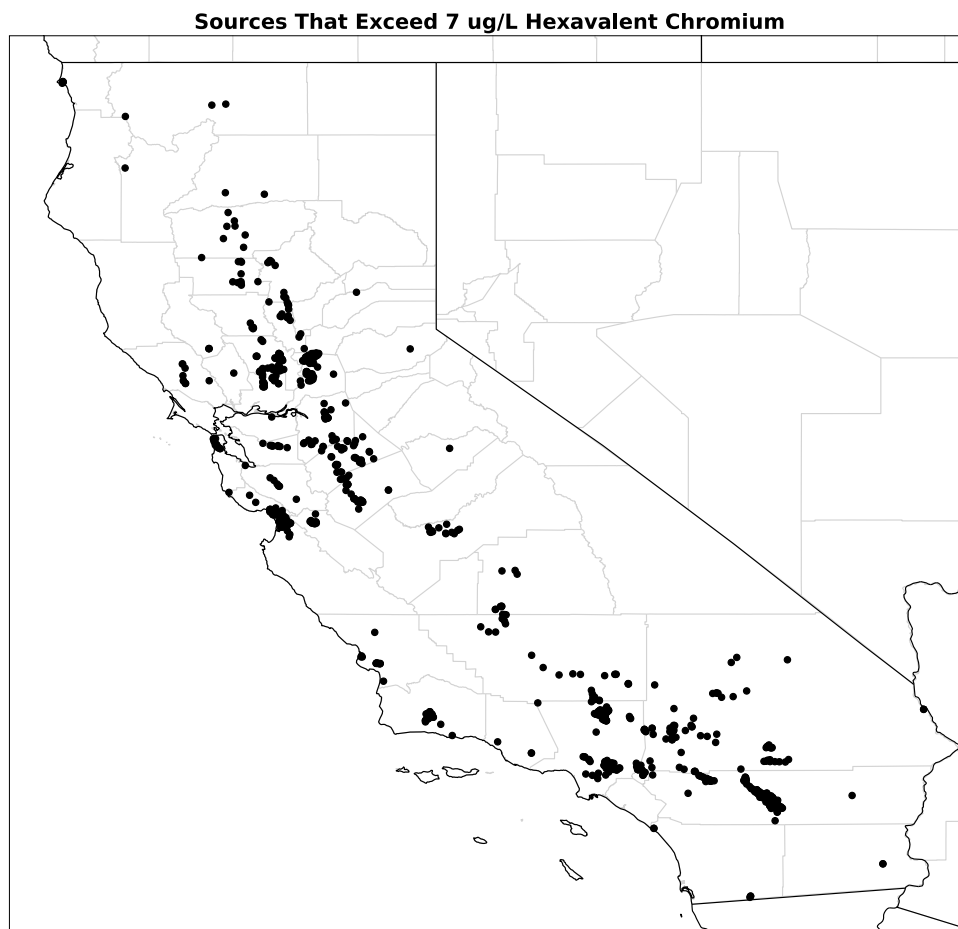


Figure 7. Public Water System Drinking Water Sources Above 7 ug/L

Alternative MCL Value of 8 ug/L

Under an alternative MCL value of 8 ug/L, there would be detections of hexavalent chromium above the MCL in public water system drinking water sources in the following counties:

Alameda, Butte, Colusa, Del Norte, El Dorado, Fresno, Glenn, Imperial, Kern, Lake, Los Angeles, Mariposa, Merced, Monterey, Napa, Placer, Riverside, Sacramento, San Benito, San Bernardino, San Diego, San Francisco, San Joaquin, San Luis Obispo, San Mateo, Santa Barbara, Santa Clara, Santa Cruz, Shasta, Siskiyou, Solano, Sonoma, Stanislaus, Sutter, Tehama, Trinity, Tulare, Ventura, and Yolo.

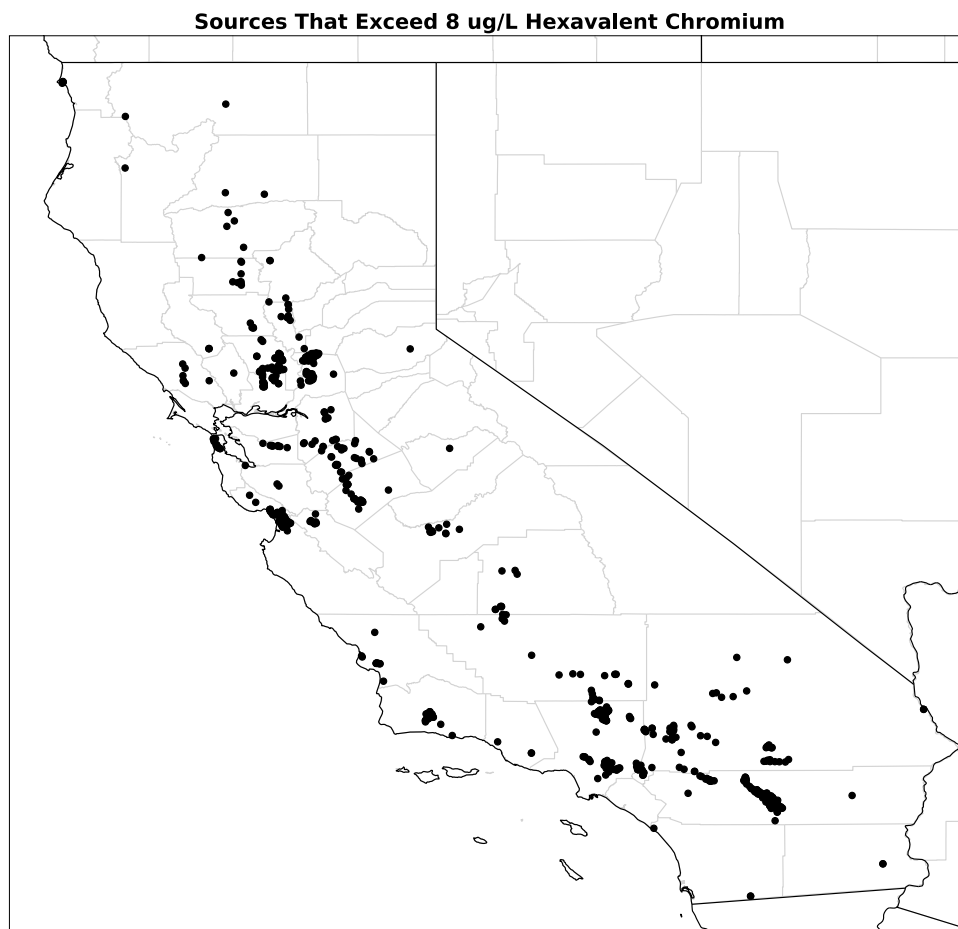


Figure 8. Public Water System Drinking Water Sources Above 8 ug/L

Alternative MCL Value of 9 ug/L

Under an alternative MCL value of 9 ug/L, there would be detections of hexavalent chromium above the MCL in public water system drinking water sources in the following counties:

Alameda, Butte, Colusa, Del Norte, El Dorado, Fresno, Glenn, Imperial, Kern, Lake, Los Angeles, Mariposa, Merced, Monterey, Napa, Riverside, Sacramento, San Benito, San Bernardino, San Diego, San Francisco, San Joaquin, San Luis Obispo, San Mateo, Santa Barbara, Santa Cruz, Shasta, Siskiyou, Solano, Sonoma, Stanislaus, Sutter, Tehama, Trinity, Tulare, Ventura, and Yolo.

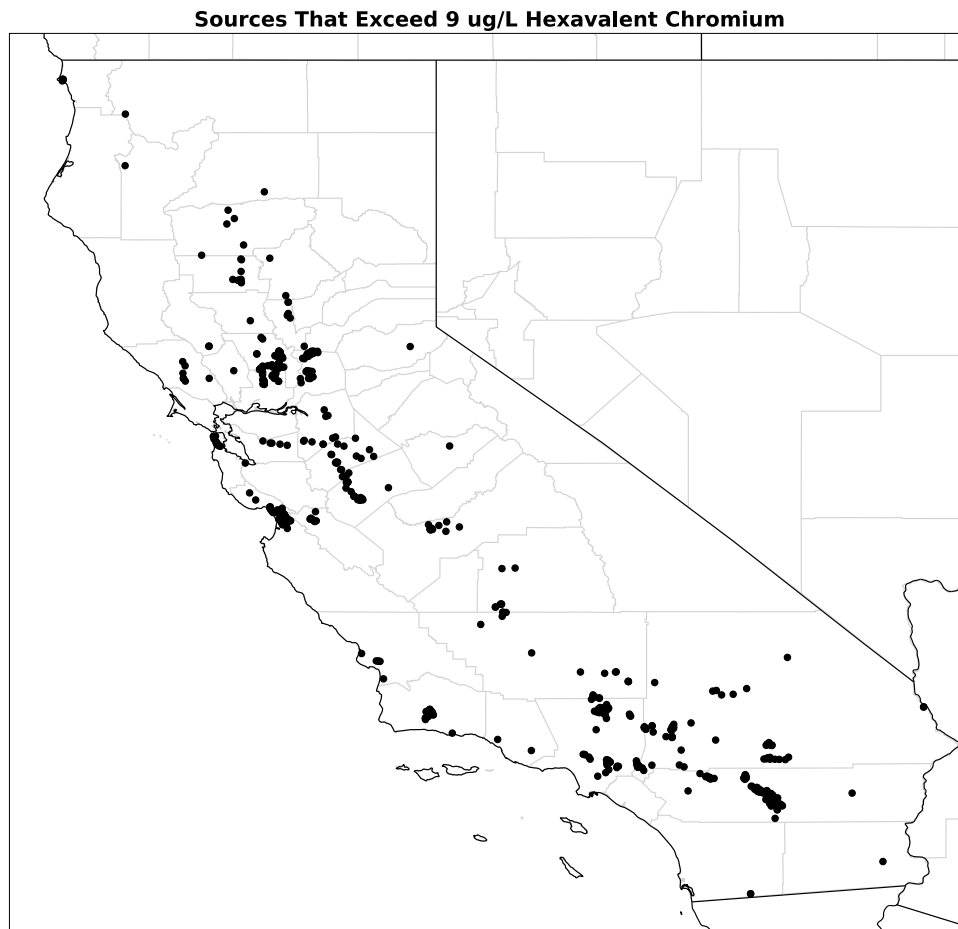


Figure 9. Public Water System Drinking Water Sources Above 9 ug/L

Alternative MCL Value of 11 ug/L

Under an alternative MCL value of 11 ug/L, there would be detections of hexavalent chromium above the MCL in public water system drinking water sources in the following counties:

Alameda, Colusa, Del Norte, Fresno, Glenn, Imperial, Kern, Lake, Los Angeles, Mariposa, Merced, Monterey, Napa, Riverside, Sacramento, San Benito, San Bernardino, San Diego, San Francisco, San Joaquin, San Luis Obispo, San Mateo, Santa Barbara, Santa Cruz, Siskiyou, Solano, Sonoma, Stanislaus, Sutter, Tehama, Tulare, Ventura, and Yolo.

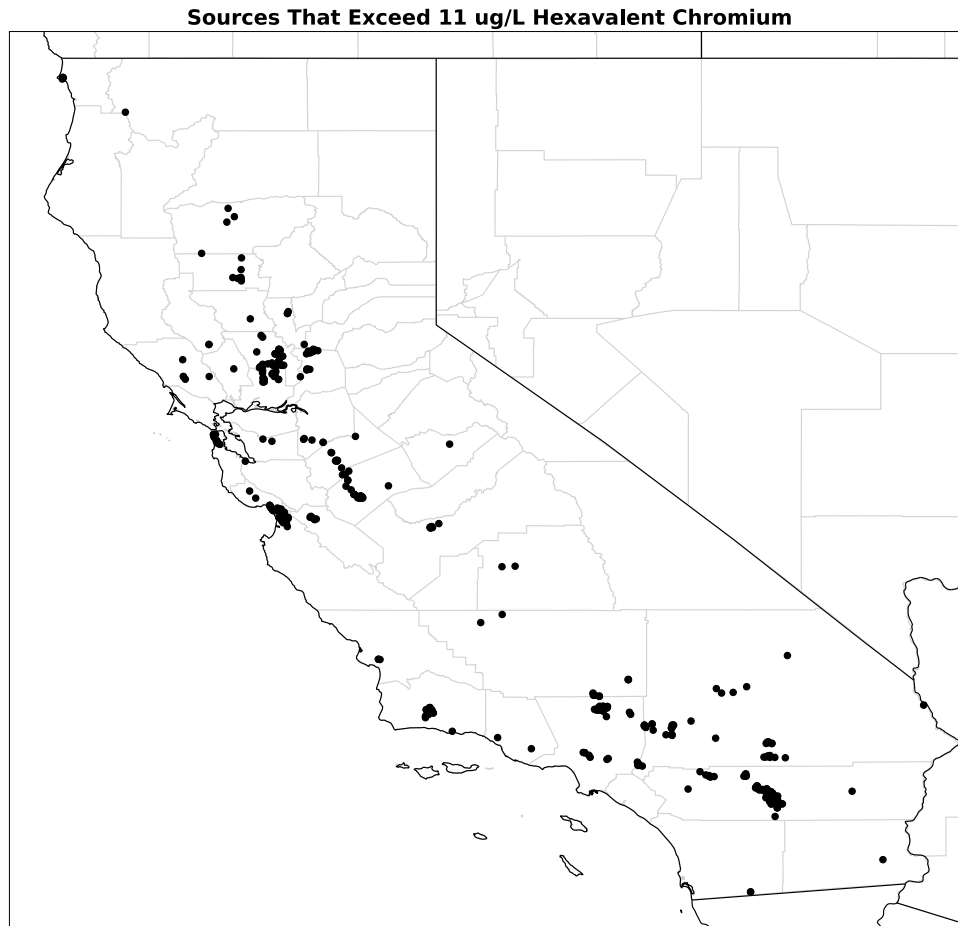


Figure 10. Public Water System Drinking Water Sources Above 11 ug/L

Alternative MCL Value of 12 ug/L

Under an alternative MCL value of 12 ug/L, there would be detections of hexavalent chromium above the MCL in public water system drinking water sources in the following counties:

Alameda, Colusa, Del Norte, Fresno, Glenn, Imperial, Kern, Lake, Los Angeles, Mariposa, Merced, Monterey, Napa, Riverside, Sacramento, San Benito, San Bernardino, San Diego, San Francisco, San Joaquin, San Luis Obispo, San Mateo, Santa Barbara, Santa Cruz, Siskiyou, Solano, Sonoma, Stanislaus, Sutter, Tehama, Tulare, Ventura, and Yolo.

Sources That Exceed 12 ug/L Hexavalent Chromium

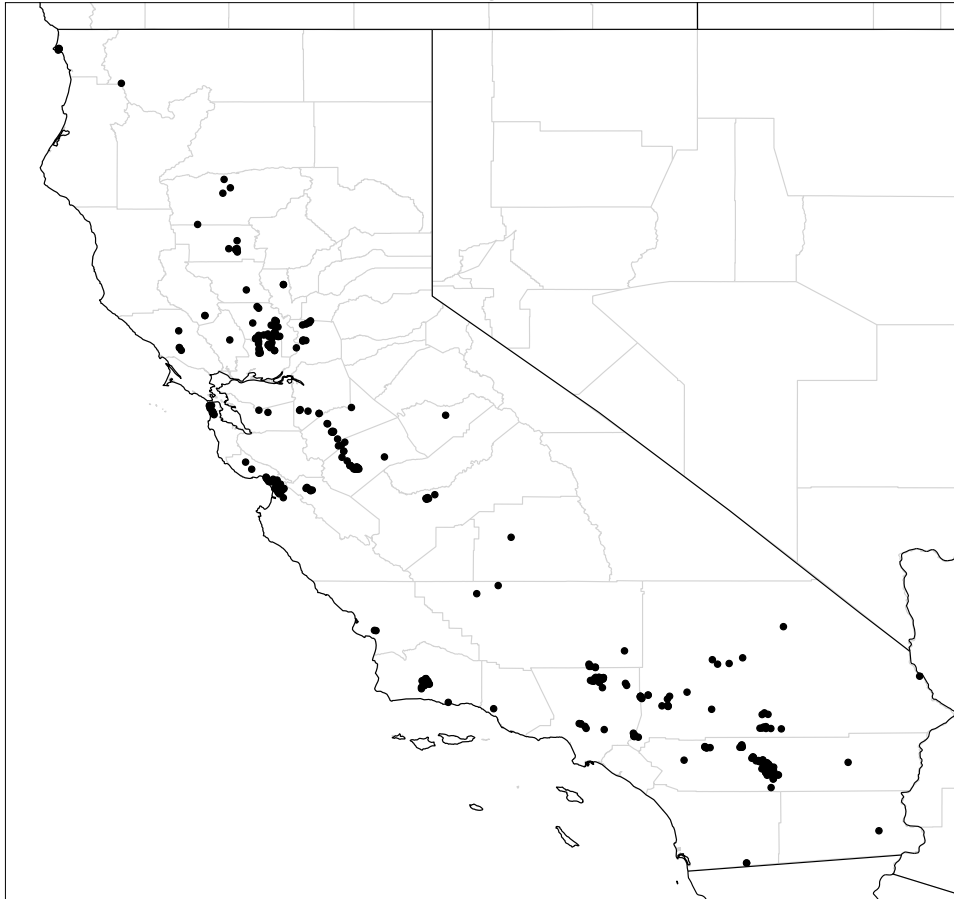


Figure 11. Public Water System Drinking Water Sources Above 12 ug/L

Alternative MCL Value of 13 ug/L

Under an alternative MCL value of 13 ug/L, there would be detections of hexavalent chromium above the MCL in public water system drinking water sources in the following counties:

Alameda, Colusa, Del Norte, Fresno, Glenn, Imperial, Kern, Lake, Los Angeles, Mariposa, Merced, Monterey, Napa, Riverside, Sacramento, San Benito, San Bernardino, San Diego, San Francisco, San Joaquin, San Luis Obispo, San Mateo, Santa Barbara, Santa Cruz, Siskiyou, Solano, Sonoma, Stanislaus, Sutter, Tehama, Tulare, Ventura, and Yolo.

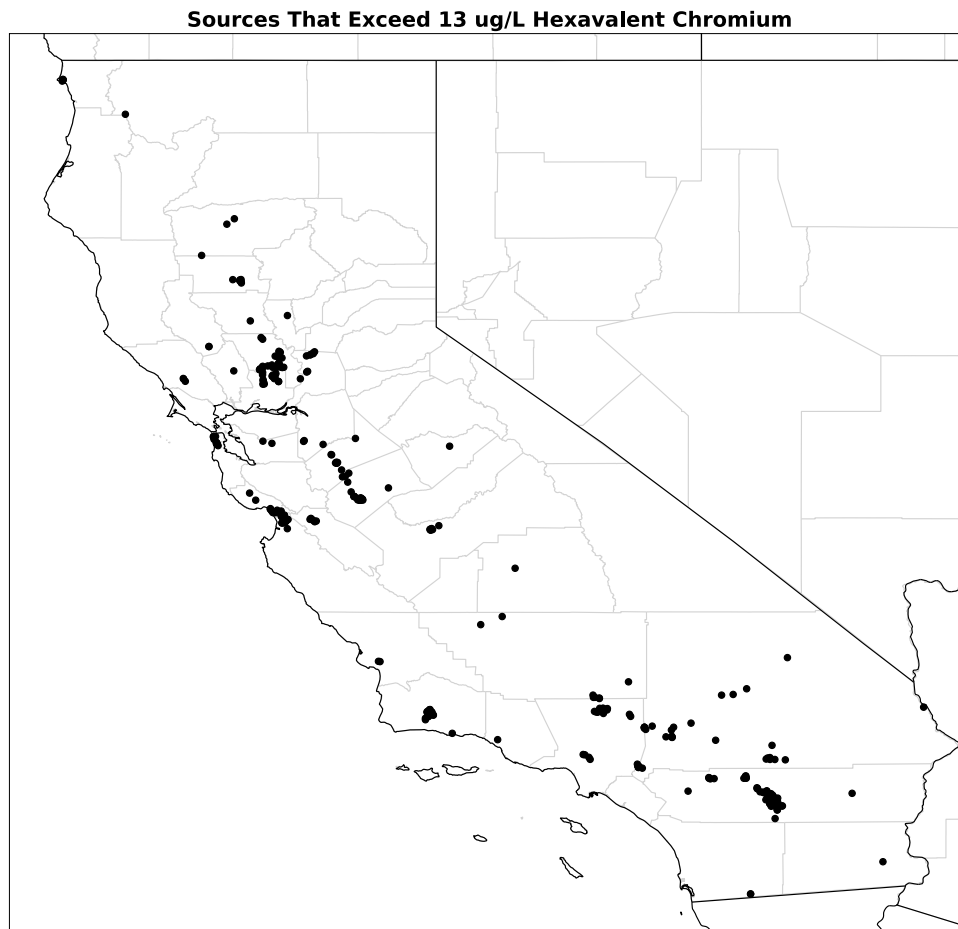


Figure 12. Public Water System Drinking Water Sources Above 13 ug/L

Alternative MCL Value of 14 ug/L

Under an alternative MCL value of 14 ug/L, there would be detections of hexavalent chromium above the MCL in public water system drinking water sources in the following counties:

Colusa, Del Norte, Fresno, Glenn, Kern, Lake, Los Angeles, Merced, Monterey, Napa, Riverside, Sacramento, San Benito, San Bernardino, San Diego, San Francisco, San Joaquin, San Luis Obispo, San Mateo, Santa Barbara, Santa Cruz, Solano, Sonoma, Stanislaus, Sutter, Tehama, Ventura, and Yolo.

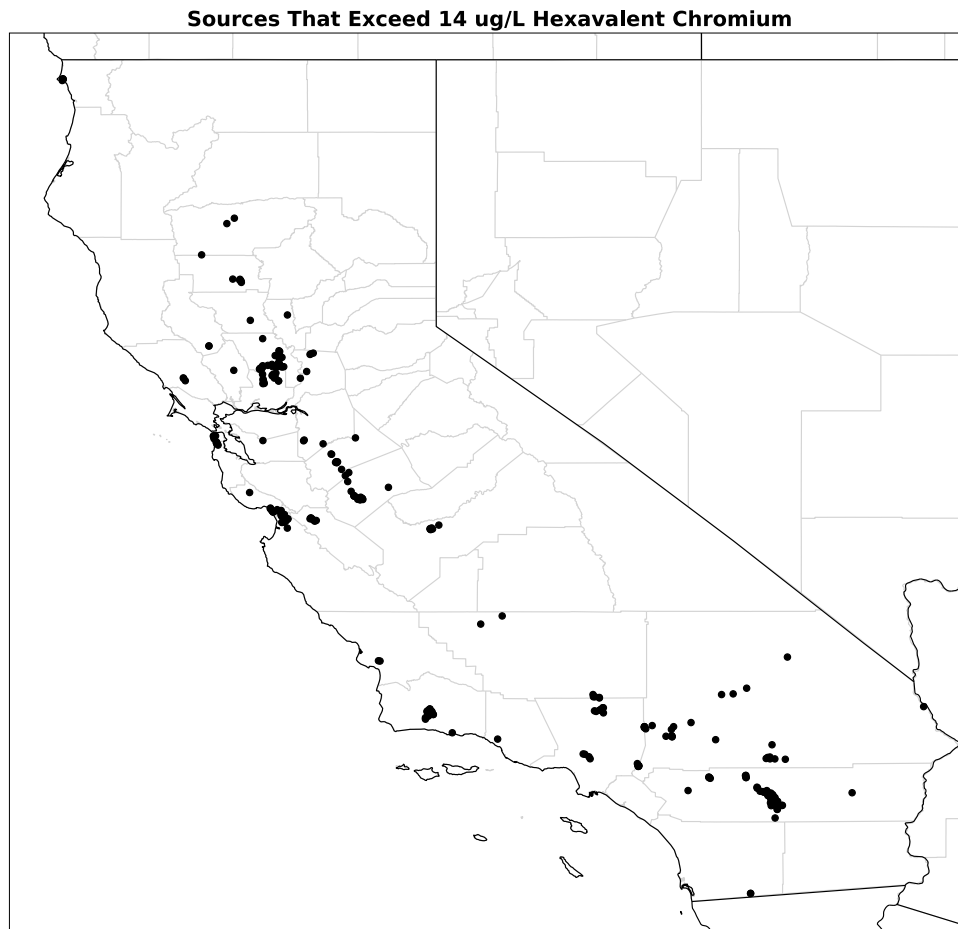


Figure 13. Public Water System Drinking Water Sources Above 14 ug/L

Alternative MCL Value of 15 ug/L

Under an alternative MCL value of 15 ug/L, there would be detections of hexavalent chromium above the MCL in public water system drinking water sources in the following counties:

Colusa, Del Norte, Fresno, Glenn, Kern, Lake, Los Angeles, Merced, Monterey, Napa, Riverside, Sacramento, San Benito, San Bernardino, San Diego, San Francisco, San Joaquin, San Luis Obispo, San Mateo, Santa Barbara, Santa Cruz, Solano, Sonoma, Stanislaus, Tehama, Ventura, and Yolo.

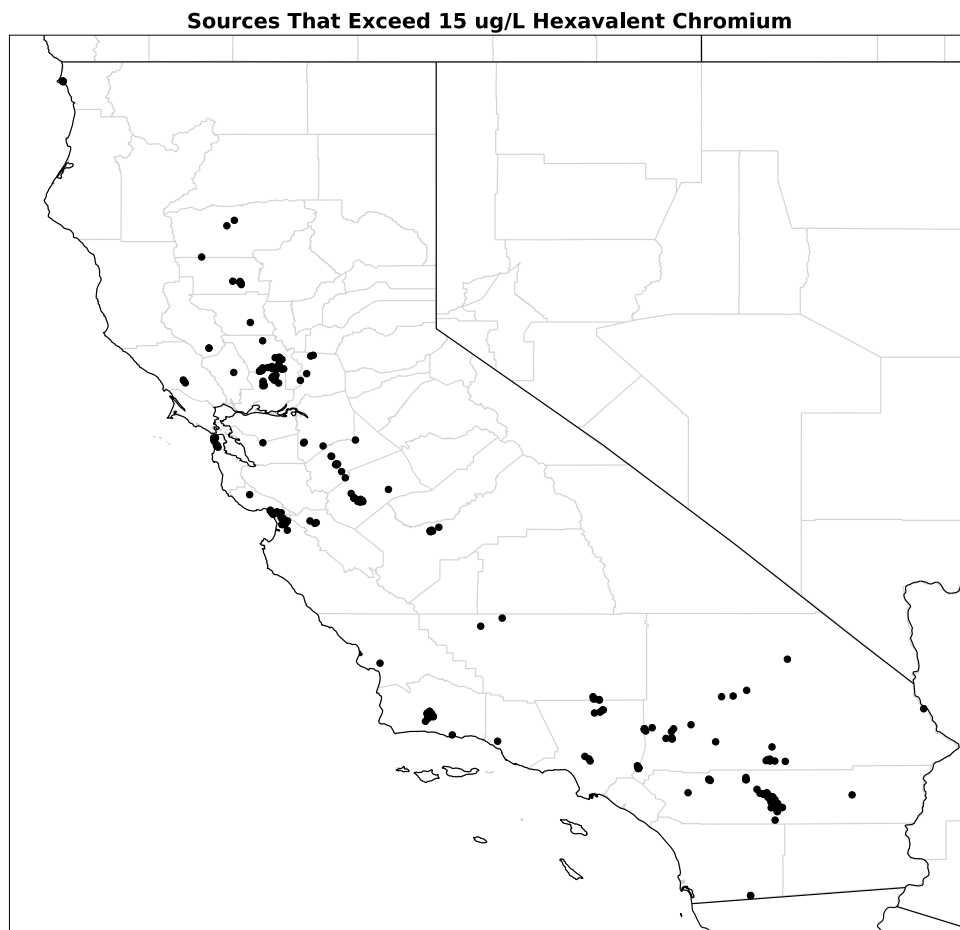


Figure 14. Public Water System Drinking Water Sources Above 15 ug/L

Alternative MCL Value of 20 ug/L

Under an alternative MCL value of 20 ug/L, there would be detections of hexavalent chromium above the MCL in public water system drinking water sources in the following counties:

Colusa, Del Norte, Fresno, Glenn, Kern, Lake, Los Angeles, Merced, Monterey, Napa, Riverside, San Benito, San Bernardino, San Francisco, San Joaquin, Santa Barbara, Santa Cruz, Solano, Sonoma, Stanislaus, Ventura, and Yolo.

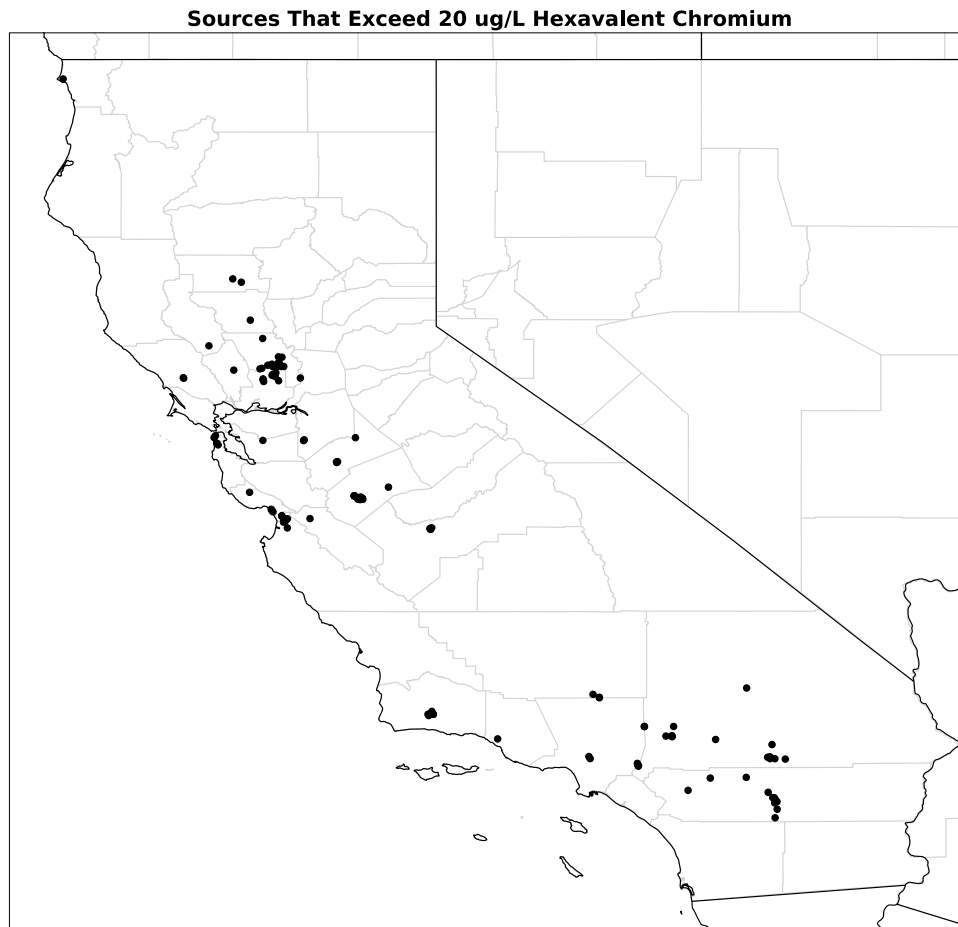


Figure 15. Public Water System Drinking Water Sources Above 20 ug/L

Alternative MCL Value of 25 ug/L

Under an alternative MCL value of 25 ug/L, there would be detections of hexavalent chromium above the MCL in public water system drinking water sources in the following counties:

Colusa, Del Norte, Fresno, Glenn, Kern, Los Angeles, Merced, Monterey, Napa, Riverside, San Bernardino, San Francisco, Santa Barbara, Santa Cruz, Solano, Sonoma, Stanislaus, Ventura, and Yolo.

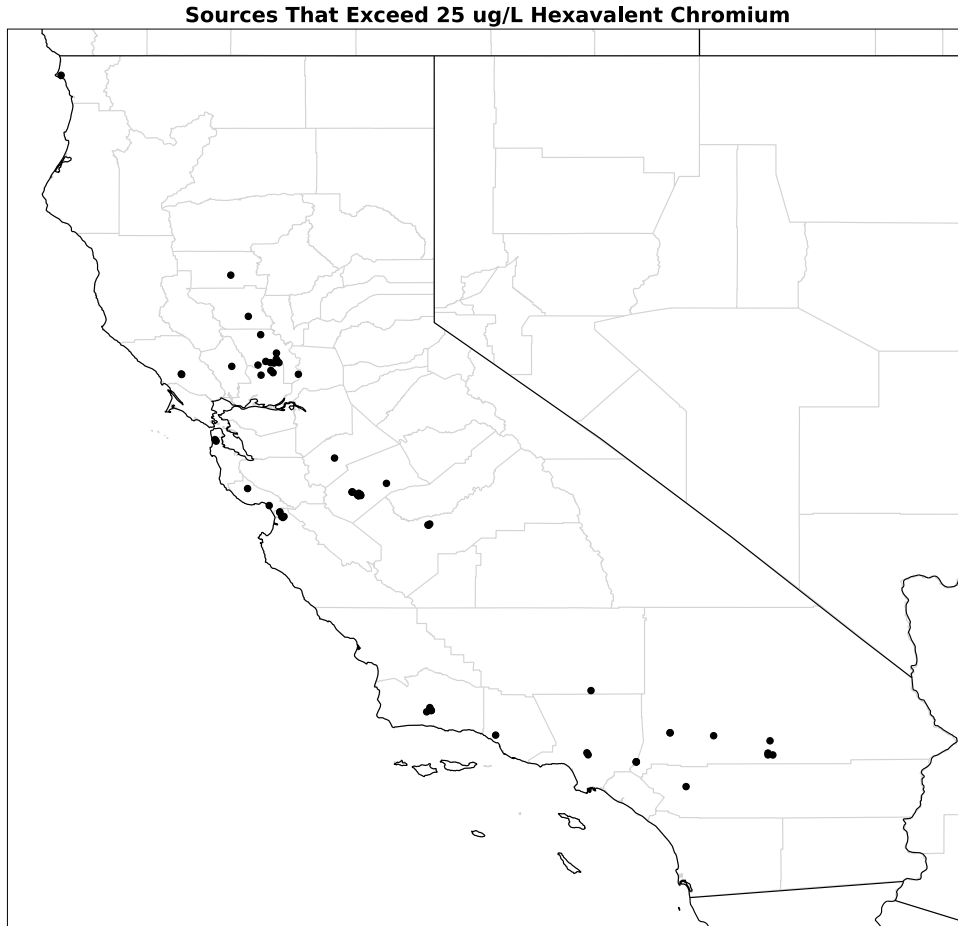


Figure 16. Public Water System Drinking Water Sources Above 25 ug/L

Alternative MCL Value of 30 ug/L

Under an alternative MCL value of 30 ug/L, there would be detections of hexavalent chromium above the MCL in public water system drinking water sources in the following counties:

Fresno, Glenn, Kern, Los Angeles, Merced, Monterey, Napa, Riverside, San Bernardino, San Francisco, Santa Barbara, Santa Cruz, Sonoma, Stanislaus, Ventura, and Yolo.

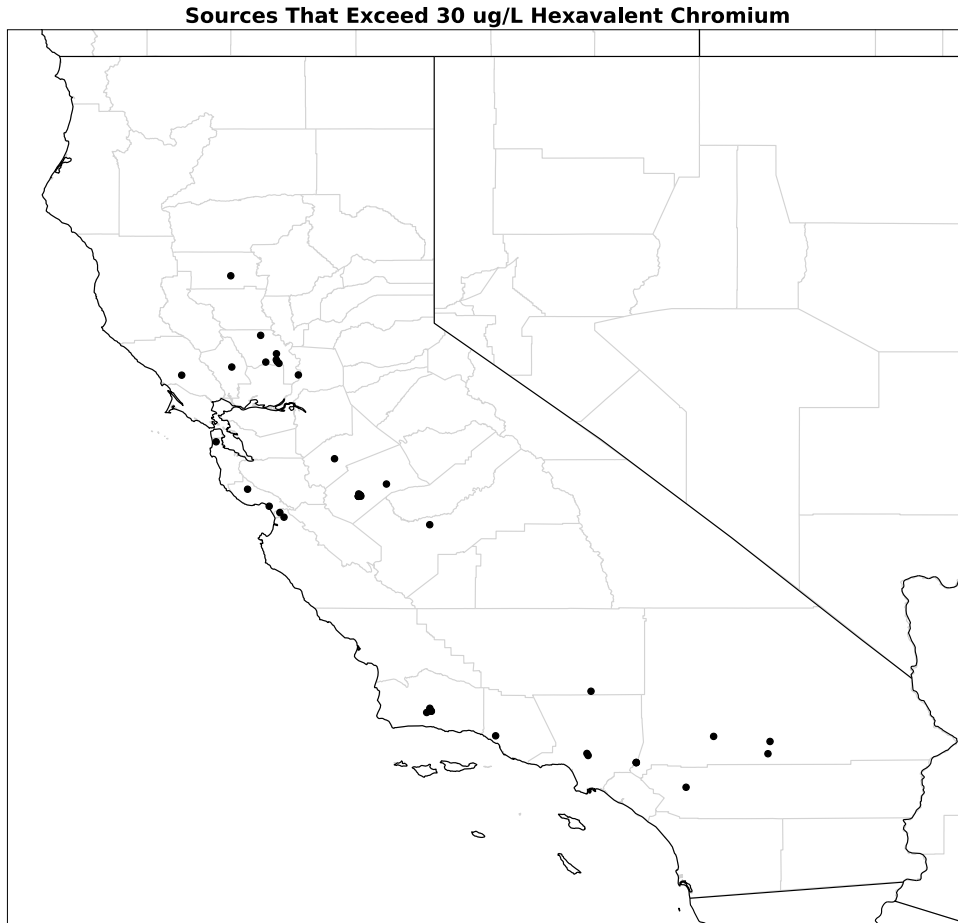


Figure 17. Public Water System Drinking Water Sources Above 30 ug/L

Alternative MCL Value of 35 ug/L

Under an alternative MCL value of 35 ug/L, there would be detections of hexavalent chromium above the MCL in public water system drinking water sources in the following counties:

Kern, Los Angeles, Merced, Monterey, Riverside, San Bernardino, Santa Barbara, Santa Cruz, Sonoma, Stanislaus, Ventura, and Yolo.

Sources That Exceed 35 ug/L Hexavalent Chromium

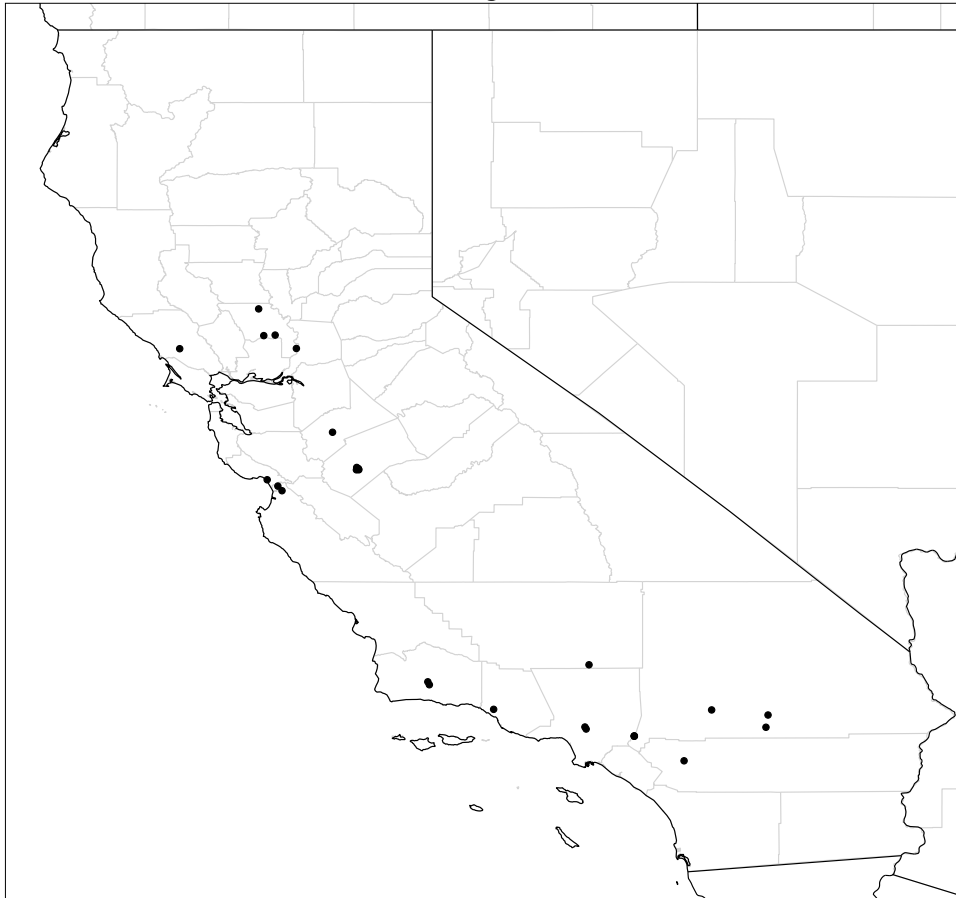


Figure 18. Public Water System Drinking Water Sources Above 35 ug/L

Alternative MCL Value of 40 ug/L

Under an alternative MCL value of 40 ug/L, there would be detections of hexavalent chromium above the MCL in public water system drinking water sources in the following counties:

Kern, Los Angeles, Merced, Monterey, Riverside, San Bernardino, Santa Barbara, Ventura, and Yolo.

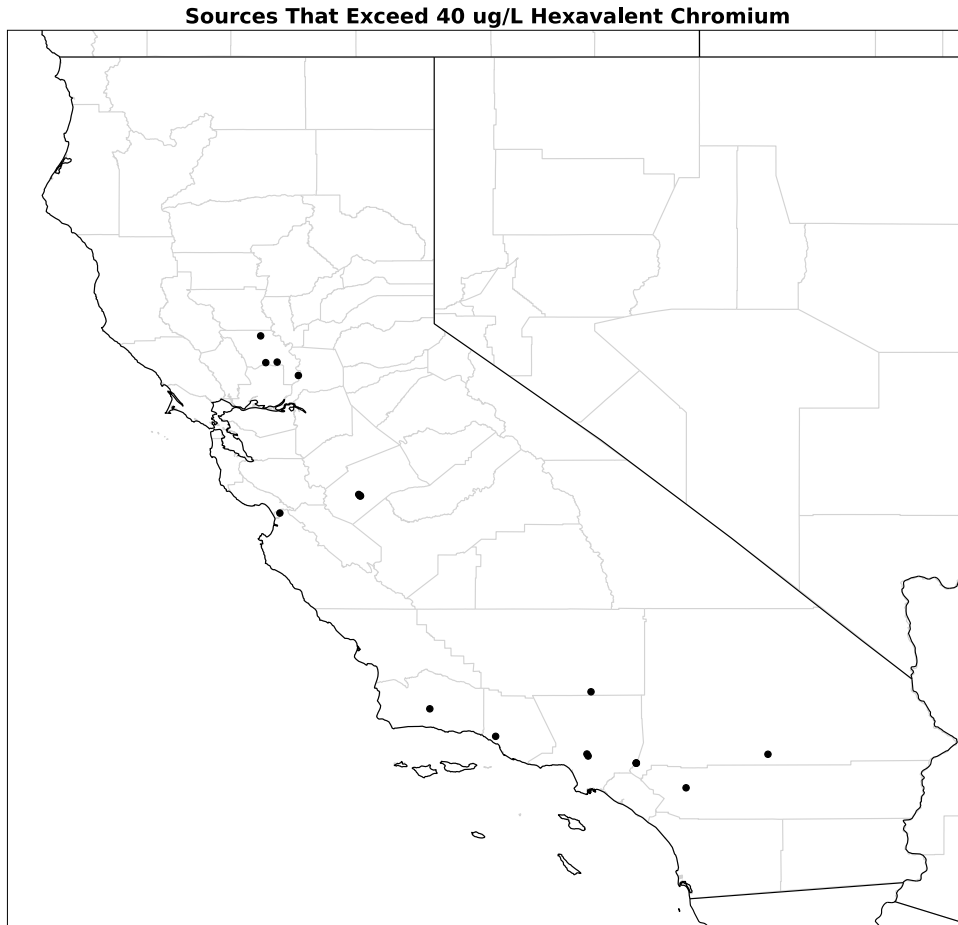


Figure 19. Public Water System Drinking Water Sources Above 40 ug/L

Alternative MCL Value of 45 ug/L

Under an alternative MCL value of 45 ug/L, there would be detections of hexavalent chromium above the MCL in public water system drinking water sources in the following counties:

Los Angeles, Merced, Monterey, Santa Barbara, Ventura, and Yolo.

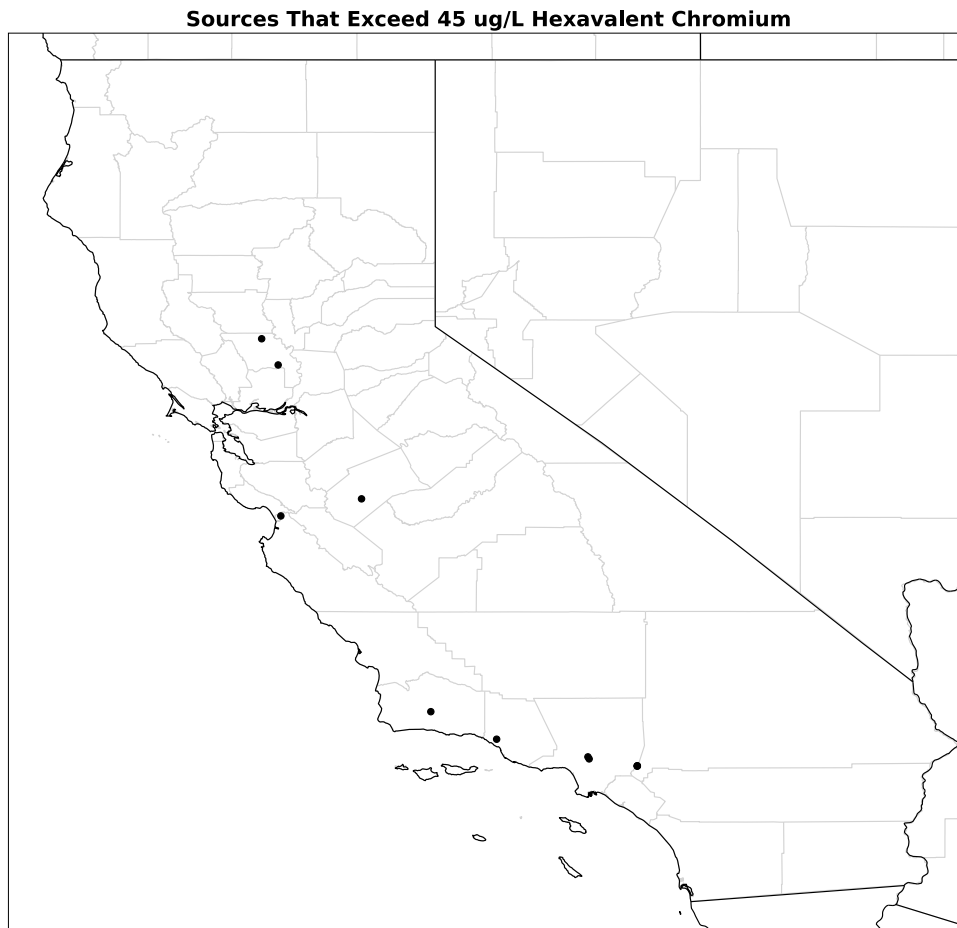


Figure 20. Public Water System Drinking Water Sources Above 45 ug/L