

Late Changes
9:00 a.m., June 7, 2012
Willow Creek Community Services District
Kimtu Cookhouse/Lodge
135 Willow Road
Willow Creek, California

Item: 8

Subject: **Public Hearing** on Order No. R1-2012-0046, to consider adoption of Waste Discharge Requirements for **Sierra Pacific Industries, Arcata Division Sawmill**, WDID No. 1B83065OHUM, NPDES Permit No. CA0024520 Humboldt County

DISCUSSION

A change to the proposed Order is included below that was discussed with Sierra Pacific Industries, LLC on May 10, 2012, but was inadvertently not included in the response to comments and proposed order that were mailed out in the Board's agenda packet on May 25, 2012. Please consider modifying section VI.C.1 on Page 9 of the proposed Order and Page 7 of the Response to Comments as follows:

C. Special Provisions

1. Reopener Provisions

- h. **Antidegradation Analysis.** If the Discharger performs an antidegradation analysis of increased flows to the freshwater wetland receiving water, then this Order may be reopened to incorporate such analysis and allow for increased permitted flows.

3. Best Management Practices and Pollution Prevention

a. Pollutant Minimization Program (PMP)

The Discharger shall, if required by the Executive Officer, develop and conduct a PMP as further described below when there is evidence (e.g., sample results reported as detected, not quantified (DNQ) when the effluent limitation is less than the reporting method detection-limit (MDRL), sample results from analytical methods more sensitive than those methods required by this Order,


presence of whole effluent toxicity, health advisories for fish consumption, results of benthic or aquatic organism tissue sampling) that a priority pollutant is present in the effluent above an effluent limitation and either:

4. Construction, Operation and Maintenance Specifications

- a. The Discharger shall maintain an updated Operation and Maintenance (O&M) Manual for the wet decking process at the Facility. The Discharger shall update the O&M Manual, as necessary, to conform to changes in operation and maintenance of the Facility. The O&M Manual shall be readily available to operating personnel onsite for review by state or federal inspectors. The O&M Manual shall include the following:

Description of the treatment facility and table of organization showing the number of employees, duties and qualifications and plant attendance schedules (daily, weekends and holidays, part-time, etc.). The description should include documentation that the personnel are knowledgeable and qualified to operate the treatment facility so as to achieve the required level of treatment at all times.

Replace Attachment B with the following map of the facility:

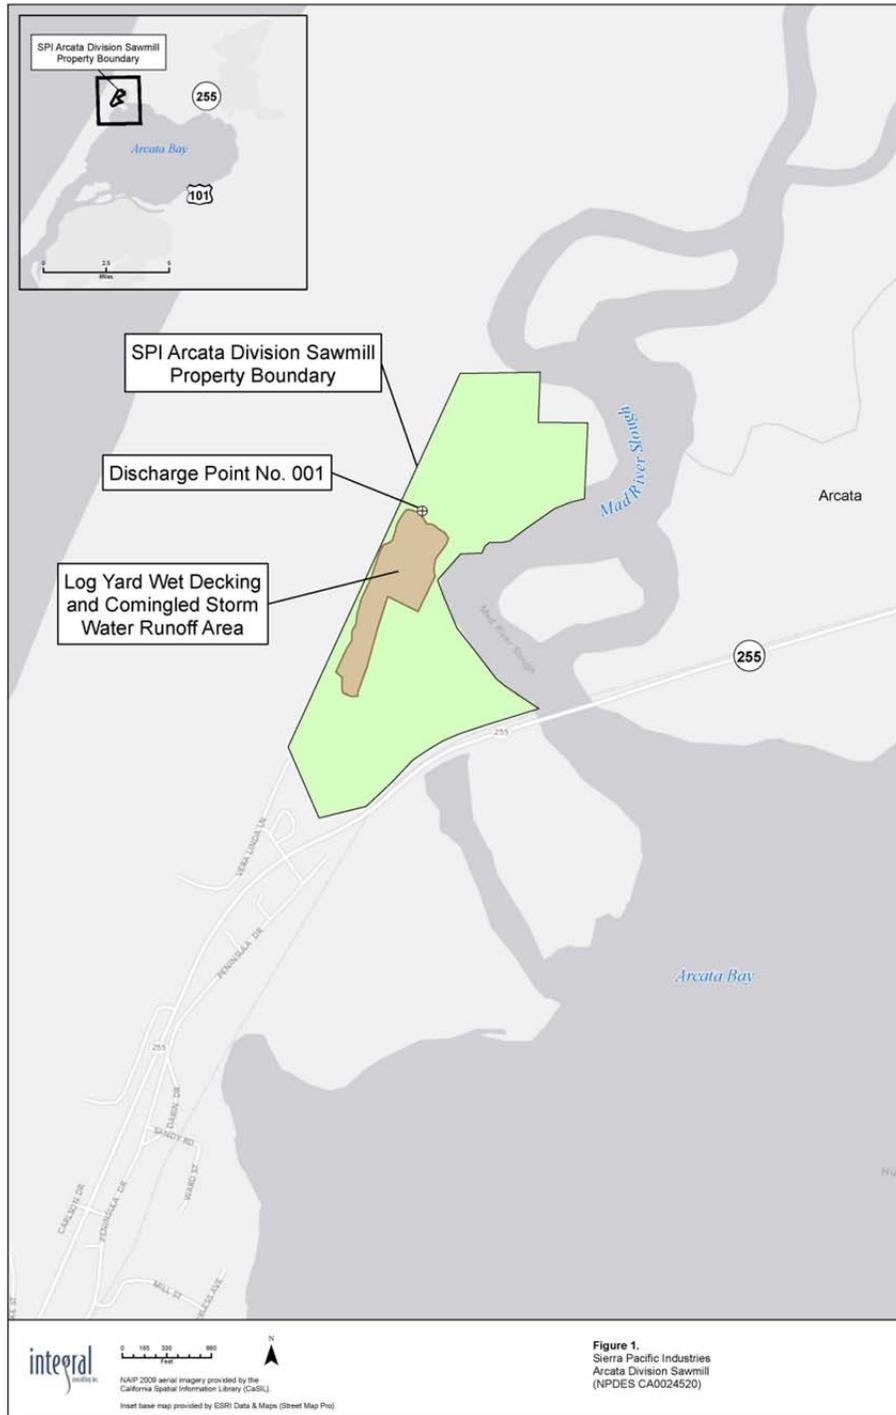

Replace Attachment C with the following flow schematic:

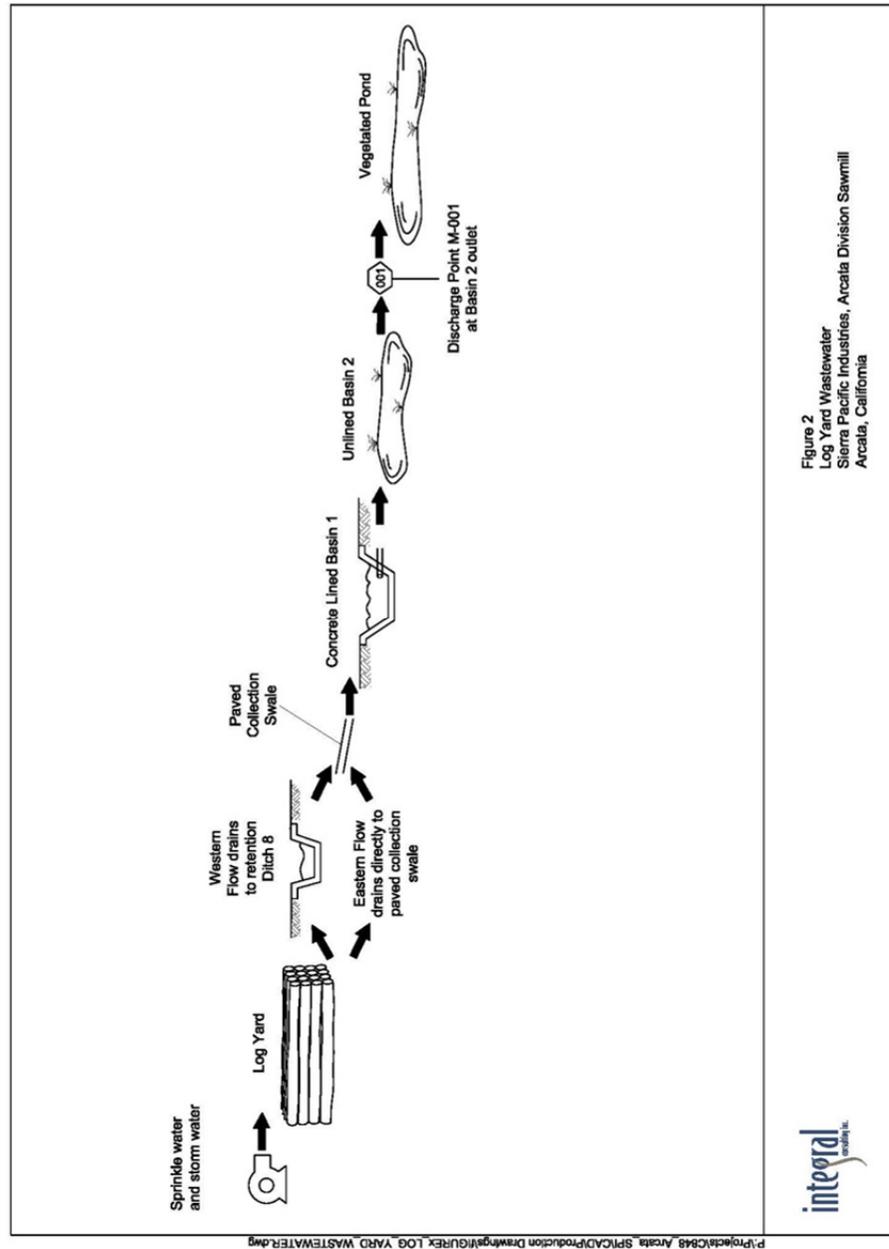


Figure 2
Log Yard Wastewater
Sierra Pacific Industries, Arcata Division Sawmill
Arcata, California

Preliminary Staff
Recommendation:

Adopt Order No. R1-2012-0046 with proposed
changes.