

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION**

ORDER NO. 86-16

**WASTE DISCHARGE REQUIREMENTS
FOR
LUCERNE VALLEY LAUNDROMAT
Lucerne Valley - San Bernardino County**

The California Regional Water Quality Control Board, Colorado River Basin Region, finds that:

1. Dennis Bruce and Richard Scott (hereinafter both are also referred to as the discharger), 8230 Pacific Avenue, Stanton, California 90680, submitted a Report of Waste Discharge, dated October 8, 1985.
2. The discharger proposes to discharge from a remodeled laundromat, which is located in an existing building, a maximum of 2,000 gallons-per-day of washwater. The wastewater is to be discharged into a lint trap and would then flow through a cleanout into two (2) septic tank/leach line disposal systems located in the SE 1/4 of the SE 1/4 of Section 11, T4N, R1W, SBB&M. Domestic sewage from a restroom is discharged into a separate existing septic tank/leach line system.
3. The discharger is reserving areas of sufficient size for possible future 100 percent replacement of the leach lines.
4. The nearest domestic well is in excess of 200 feet from the proposed leach line facilities described in Findings No. 2 and 3 (above), and depth to water is about 90 feet.
5. The Water Quality Control Plan for the Colorado River Basin Region was adopted by the Regional Board on November 14, 1984. The Basin Plan contains water quality objectives for the Lucerne Hydrologic Unit.
6. The beneficial uses of the ground water of the Lucerne Hydrologic Unit are:
 - a. Municipal supply
 - b. Industrial supply
 - c. Agricultural supply.
7. The Board has notified the discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for the proposed discharge.
8. The Board in a public meeting heard and considered all comments pertaining to the discharge.

*Rescinded
1/21/87
87-022*

9. These waste discharge requirements govern an existing facility, which the discharger has been operating, and therefore is exempt from the provisions of the California Environmental Quality Act in accordance with Section 15301 of Chapter 3, Title 14, of the California Administrative Code.

IT IS HEREBY ORDERED, the discharger shall comply with the following:

A. Discharge Specifications


1. Neither the treatment nor the discharge of wastewater shall create a pollution or a nuisance as defined in Division 7 of the California Water Code.
2. No wastewater other than domestic sewage and laundromat wastewater shall be discharged at this location.
3. Domestic sewage shall not be discharged via the laundromat disposal facilities.
4. Wastewater discharged subsurface shall be retained underground with no surfacing.
5. Adequate measures shall be taken to assure that flood or surface drainage waters do not erode or otherwise render portions of the discharge facilities inoperable.
6. Lint trap and septic tank cleanings shall be discharged only by a duly authorized service.

B. Provisions

1. Sufficient land area shall be reserved for possible future 100 percent replacement of the leach lines until such time as this laundromat is connected to a municipal sewerage system.
2. This Order includes the attached "Monitoring and Reporting Program No. 85-111", and future revisions thereto, as specified by the Executive Officer.
3. Prior to any modifications in this facility which would result in material change in the quality or quantity of wastewater discharged, or any material change in location of discharge, the discharger shall report in writing to the Regional Board.
4. Prior to any change of ownership of this facility, the discharger shall:

- a. Specify as a condition of transfer that the area specified in Provision B.1 (above) remain servient to the laundromat for the purpose of providing additional subsurface wastewater disposal capacity, until such time as this building is connected to a municipal sewerage system.
- b. Transmit a copy of this Order to the succeeding owner or operator, and file a copy of the transmittal letter with this Board.

I, Arthur Swajian, Executive Officer, do hereby certify the foregoing is a full, true and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on January 22, 1986.



Executive Officer

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION**

**MONITORING AND REPORTING PROGRAM NO. 86-16
FOR
LUCERNE VALLEY LAUNDROMAT
Lucerne Valley - San Bernardino County**

Location of Discharge: SE 1/4, SE 1/4 of Section 11, T4N, R1W, SBB&M

MONITORING

The discharger shall report to the Regional Board concerning the following:

1. Water meter reading to determine discharge flow - monthly reporting frequency.


REPORTING

Monthly monitoring reports shall be submitted to the Regional Board on a quarterly basis - by January 15, April 15, July 15 and October 15 of each year.

Mail reports to:

California Regional Water Quality Control Board
Colorado River Basin Region
73-271 Highway 111, Suite 21
Palm Desert, CA 92260


ORDERED BY:

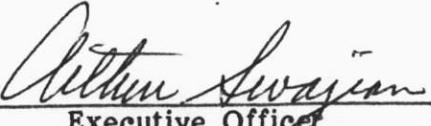
Executive Officer

January 22, 1986

Date

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD - 7

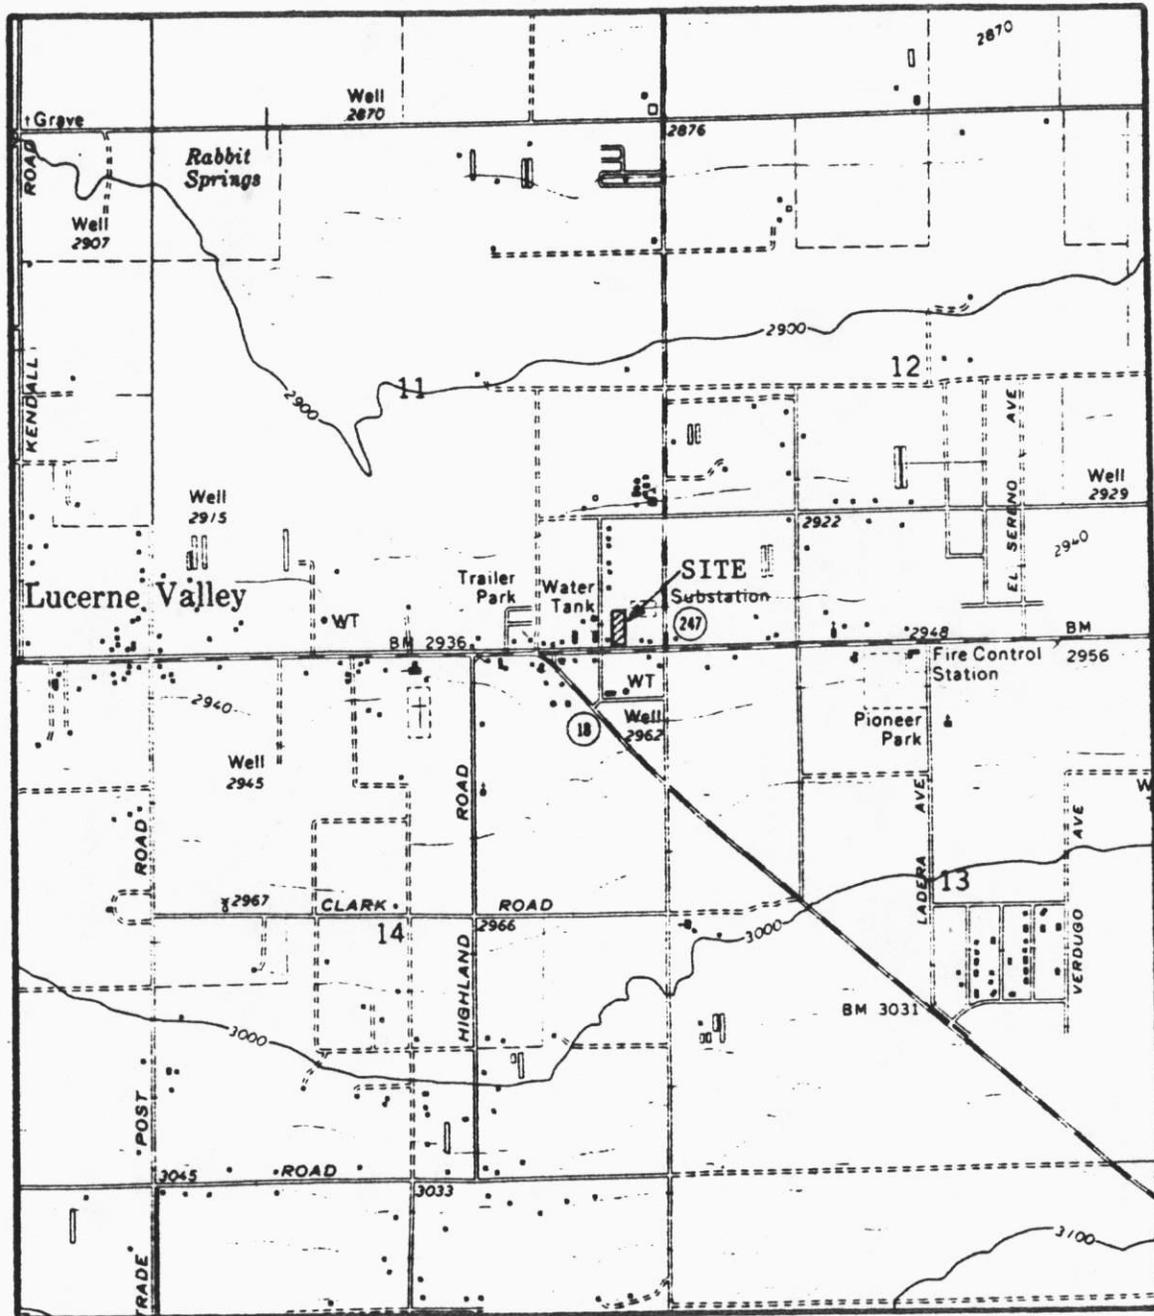

Scale:
1" = 2000'

SITE MAP
LUCERNE VALLEY LAUNDROMAT
Lucerne Valley - San Bernardino County
Portion of the SE 1/4, SE 1/4 of Section 11, T4N, R1W, SBB&M
USGS Lucerne Valley 7.5 min. Topographic Map

Order No. 86-16