

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION

ORDER NO. 88-80

WASTE DISCHARGE REQUIREMENTS
FOR
RIVER VIEW TRAILER PARK
North of Earp - San Bernardino County

The California Regional Water Quality Control Board, Colorado River Basin Region, finds that:

1. Erle Holm, lessee and operator of River View Trailer Park, (hereinafter also referred to as the discharger), 4112 Highland Avenue, Manhattan Beach, CA 90266, verified the below updated information on the discharge of waste on March 14, 1988.
2. The discharger is discharging a maximum of 25,000 gallons-per-day of domestic wastewater from a mobile home and recreational vehicle park having 83 mobile homes and 67 recreational vehicle spaces, two (2) restrooms, a laundry room, a recreation room and an office building. The wastewater is discharged into four (4) septic tanks followed by three (3) oxidation basins for disposal by evaporation and infiltration. The site is located in the SE 1/4 of the SE 1/4 of Section 13, T1N, R25E, SBB&M.
3. This discharge has been subject to waste discharge requirements adopted in Board Order No. 83-4.
4. The Water Quality Control Plan for the Colorado River Basin Region of California was adopted by the Regional Board on November 14, 1984.
5. There are no domestic wells within 200 feet of the discharge facilities described in Finding No. 2.
6. The beneficial uses of ground water of the Colorado Hydrologic Unit are:
 - a. Municipal supply
 - b. Industrial supply
 - c. Agricultural supply
7. The Board has notified the discharger and interested agencies and persons of its intent to update waste discharge requirements for the discharge.
8. The Board in a public meeting heard and considered all comments pertaining to the existing discharge.
9. These waste discharge requirements govern an existing facility, which the discharger is currently operating, and therefore is exempt from the provisions of the California Environmental Quality Act in accordance with Section 15301, Chapter 3, Title 14 of the California Code of Regulations.

*Superseded
by 93-027
3/31/93*

IT IS HEREBY ORDERED, the discharger shall comply with the following:

A. Discharge Specifications

1. Neither the treatment nor the discharge of wastewater shall create pollution or nuisance as defined in Division 7 of the California Water Code.
2. No wastewater other than domestic wastewater shall be discharged into the sewage disposal system described in Finding No. 2 (above).
3. A minimum freeboard of two (2) feet shall be maintained in each oxidation basin.
4. Treated or untreated sludge or similar solid waste materials shall be disposed only at locations approved by the Regional Board.
5. Adequate measures shall be taken to assure that unauthorized persons and animal pets are effectively excluded from contact with the discharge.
6. Adequate measures shall be taken to assure that flood or surface drainage waters do not erode or otherwise render portions of the discharge facilities inoperable.
7. There shall be no surface flow of wastewater away from the discharge facilities.
8. There shall be no discharge, bypass, or flow of treated or untreated sewage to any irrigation drain or any channel which drains thereto.
9. Disposal by ponding shall be conducted in such manner that there shall be no stranded or exposed sewage solids.
10. Surface aerobic environment shall be maintained for each oxidation basin.
11. Infiltration facilities shall be maintained and operated so as to maximize infiltration and minimize the increase in salinity of the infiltrating wastewater.
12. Standby facilities shall be provided in the event of pump and/or commercial power failure.

B. Provisions


1. Prior to any modifications in this facility which would result in material change in the quality or quantity of wastewater discharged, or any material change in location of discharge, the discharger shall report in writing to the Regional Board.
2. The discharger shall comply with the "Monitoring and Reporting Program No. 88-80", and any future revisions thereto, as specified by the Regional Board's Executive Officer.

3. In the event of any change in operation, or in control or ownership of land or waste disposal facilities owned or controlled by the discharger, the discharger shall:

- a. Notify this Board of such change; and
- b. Transmit a copy of this Order to the succeeding owner or operator, and file a copy of the transmittal letter with this Board.

IT IS FURTHER ORDERED that Board Order No. 83-4 be superseded by this Order.

I, Arthur Swajian, Executive Officer, do hereby certify the foregoing is a full, true and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on JUN 30 1999.

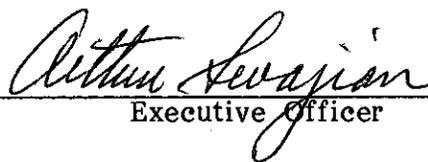
Executive Officer

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION

MONITORING AND REPORTING PROGRAM NO. 88-080 (Revision No. 1)
FOR
RIVER VIEW TRAILER PARK
North of Earp - San Bernardino County

Location of Discharge: SE $\frac{1}{4}$ of SE $\frac{1}{4}$, of Section 13 T1N, R25E, SBB&M

MONITORING

The discharger shall submit an annual status report on the following:

1. Estimate of maximum daily flow (gpd) of wastewater discharged to basin(s).
2. Number of mobile home and RV spaces and restrooms connected to the sewerage system.
3. List any proposed changes in the sewage disposal facilities during the upcoming year.
4. The oxidation basins shall be sampled semi-annually and analyzed for Total Dissolved Solids (TDS) content (in mg/L) during June and December.

REPORTING

1. Semi-annual reports shall be submitted to the Regional Board by January 15th, and July 15th of each year. Annual monitoring reports shall be submitted to the Regional Board by January 15th of each year to:

California Regional Water Quality Control Board
Colorado River Basin Region
73-720 Fred Waring Drive, Suite 100
Palm Desert, CA 92260

2. Immediately report to this office by telephone and follow-up by letter any failure of the sewerage system.

ORDERED BY:

Philip A. Grunberg
Executive Officer

10-13-92

Date

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION

MONITORING AND REPORTING PROGRAM NO. 88-80
FOR
RIVER VIEW TRAILER PARK
North of Earp - San Bernardino County

Location of Discharge: SE 1/4 of SE 1/4, of Section 13, T1N, R25E, SBB&M

MONITORING

The discharger shall submit an annual status report on the following:

1. Estimate of maximum daily flow (gpd) of wastewater discharged to basin(s).
2. Number of mobile home and RV spaces and restrooms connected to the sewerage system.
3. List any proposed changes in the sewage disposal facilities during the upcoming year.

REPORTING

1. Annual monitoring reports shall be submitted to the Regional Board by January 15th of each year to:

California Regional Water Quality Control Board
Colorado River Basin Region
73-271 Highway 111, Suite 21
Palm Desert, CA 92260

2. Immediately report to this office by telephone and follow-up by letter any failure of the sewerage system.


ORDERED BY:

Arthur Surajian
Executive Officer

July 15, 1988
Date

*Superseded
MIR
revised
10/13/92*

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD - 7

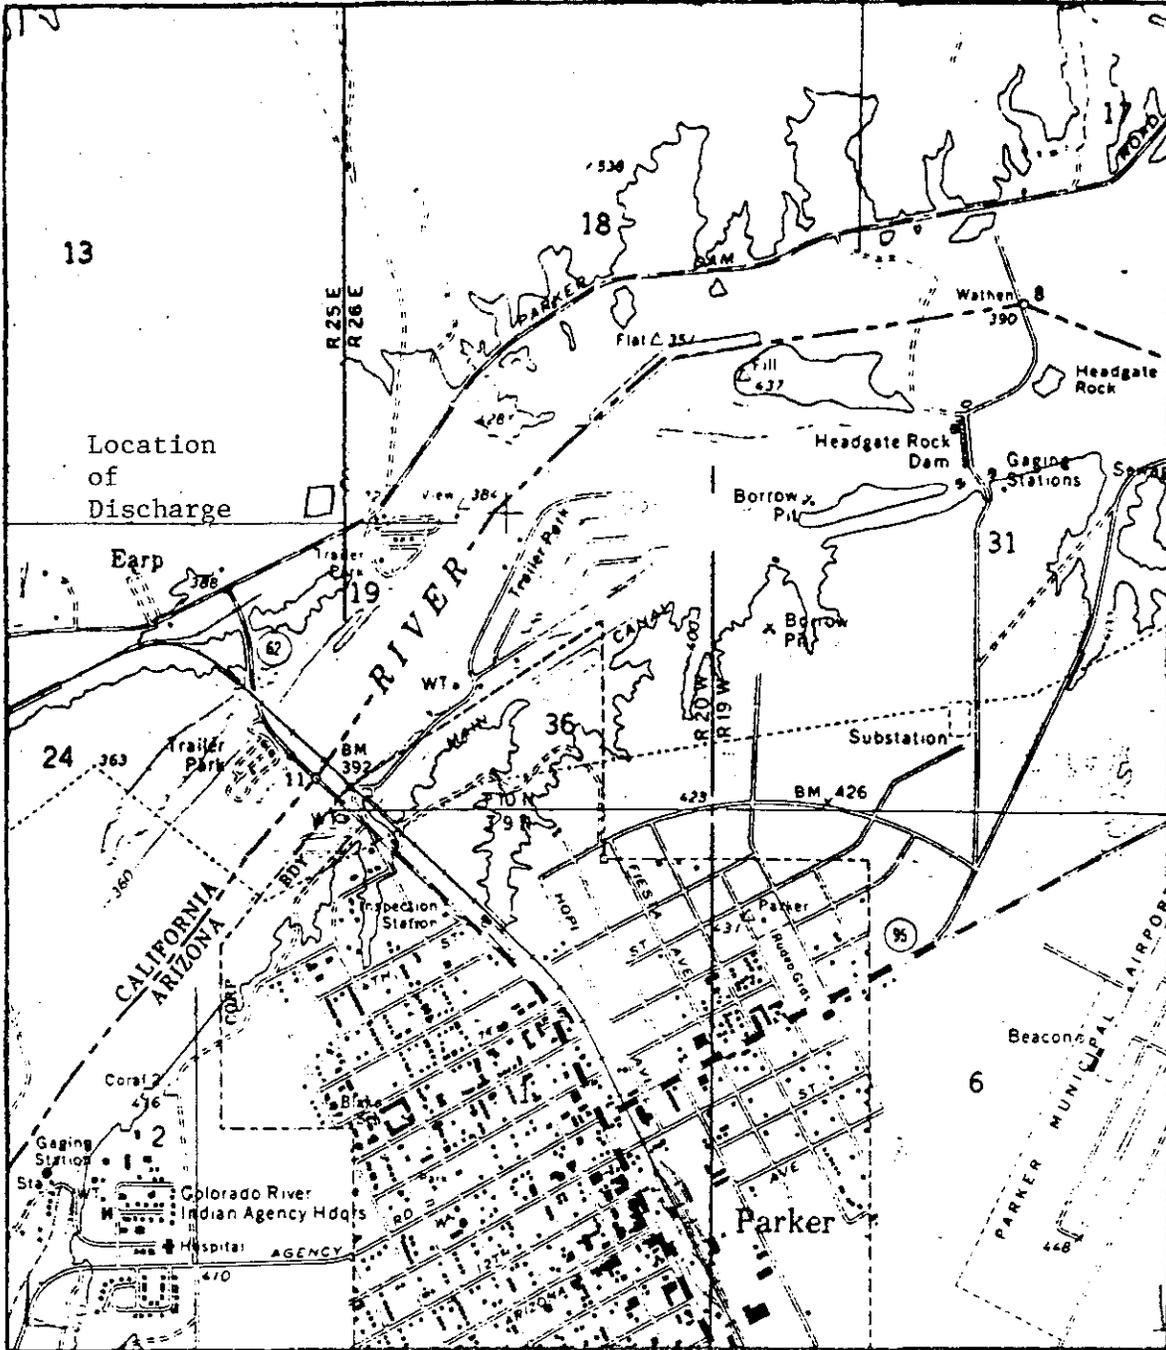

SITE MAP
 RIVER VIEW TRAILER PARK
 Northeast of Earp - San Bernardino County
 SE $\frac{1}{4}$ of the SE $\frac{1}{4}$ of Section 13, T1N, R25E, SBB&M
 USGS Parker, Ariz. - Calif. 7.5 min. Topographic Map

Order No. 88-80