

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD  
SAN DIEGO REGION

ADDENDUM NO. 1  
TO  
ORDER NO. 2000-165

WASTE DISCHARGE REQUIREMENTS  
FOR  
EASTERN MUNICIPAL WATER DISTRICT  
TEMECULA VALLEY REGIONAL WATER RECLAMATION FACILITY  
RIVERSIDE COUNTY

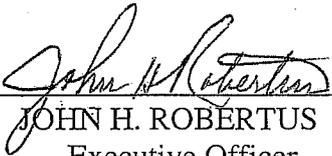
The California Regional Water Quality Control Board, San Diego Region (hereinafter Regional Board), finds that:

1. Eastern Municipal Water District (EMWD) discharges up to 12.0 million gallons per day (MGD) of tertiary treated wastewater from the Temecula Valley Regional Water Reclamation Facility (TVRWRF) to various locations within the Santa Margarita Hydrologic Area subject to waste discharge requirements contained in Order No. 2000-165, "*Waste Discharge Requirements For Eastern Municipal Water District Temecula Valley Regional Water Reclamation Facility Riverside County*".
2. EMWD proposes to increase the flow rate at the TVRWRF from 12.0 MGD to 13.2 MGD based on the fact that TVRWRF is designed with hydraulic capacity for a maximum 30-day flow rate of 13.2 MGD and is capable of treating 13.2 MGD throughout the entire year without any modification to treatment equipment or processes at TVRWRF; the current 30-day average dry weather flow rate limit of 12.0 MGD is actually the annual average flow rate.
3. Issuance of this addendum is exempt from the requirement for preparation of environmental documents under the California Environmental Quality Act Section 15301 for existing facilities "involving negligible or no expansion of use beyond that existing at the time of the lead agency's determination".
4. The Regional Board has notified EMWD and all known interested parties of its intent to modify Order No. 2000-165.
5. The Regional Board has, at a public meeting, heard and considered all comments pertaining to this addendum to Order No. 2000-165.

**IT IS HEREBY ORDERED** that Discharge Specifications of Order No. 2000-165 be revised as follows:

1. The 30-day maximum flow from the Temecula Valley Regional Water Reclamation Facility shall not exceed 13.2 million gallons per day.

I, John H. Robertus, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, San Diego Region, on February 9, 2005.

  
\_\_\_\_\_  
JOHN H. ROBERTUS  
Executive Officer