

California Regional Water Quality Control Board

Santa Ana Region

3737 Main Street, Suite 500, Riverside, California 92501-3348
 Phone (951) 782-4130 • FAX (951) 781-6288 • TDD (951) 782-3221
<http://www.waterboards.ca.gov/santaana>

ORDER NO. R8-2006-0009
NPDES NO. CA0105350

WASTE DISCHARGE AND PRODUCER /USER RECLAMATION REQUIREMENTS FOR THE CITY OF RIVERSIDE RIVERSIDE REGIONAL WATER QUALITY CONTROL PLANT DISCHARGE TO REACH 3 OF SANTA ANA RIVER

The following Discharger is subject to waste discharge requirements as set forth in this Order:

Table 1. Discharger Information

Discharger	City of Riverside/Department of Public Works/City of Riverside
Name of Facility	Riverside Regional Water Quality Control Plant, City of Riverside
Facility Address	5950 Acorn Street
	City of Riverside, CA 92504
	Riverside County

The discharge by the City of Riverside/Department of Public Works from the discharge points identified below is subject to waste discharge requirements as set forth in this Order:

Table 2. Discharge Location

Discharge Point	Effluent Description	Discharge Point (Latitude)	Discharge Point (Longitude)	Receiving Water
001	Tertiary or secondary treated effluent into the River	33°57'55"	117°27'28"	Reach 3 of Santa Ana River
002	Tertiary treated effluent into the River when earthen channel exists.	33°57'48"	117°28'30"	Reach 3 of Santa Ana River
003	Tertiary treated effluent to River after 14 wetland ponds	33°57'48"	117°29'52"	Reach 3 of Santa Ana River
004	Tertiary treated effluent, wetlands bypass (effluent commingled with Hole Lake flows and diverted to farmer's field and thence to River)	33°57'44"	117°29'7.29"	Reach 3 of Santa Ana River
005	Recycled water for Riverside Energy Resource Center	33°57'50.22"	117°27'13.8"	None
006	Recycled water for irrigation of "Urban Forest"	33°57'35"	117°27'46"	Chino South Groundwater Management Zone
007	Recycled water for Golf course irrigation	33°57'33"	117°27'41"	Chino South Groundwater Management Zone
008	Recycled water for lawn irrigation at Toro Company	33°57'49"	117°27'41"	Chino South Groundwater Management Zone

Table 3. Administrative Information

This Order was adopted by the Regional Water Board on:	April 21, 2006
This Order shall become effective on:	April 21, 2006
This Order shall expire on:	April 1, 2011
The U.S. Environmental Protection Agency (U.S. EPA) and the Regional Water Board have classified this discharge as a major discharge.	
The Discharger shall file a Report of Waste Discharge in accordance with Title 23, California Code of Regulations, <u>not later than 180 days in advance of the Order expiration date</u> as application for issuance of new waste discharge requirements.	

IT IS HEREBY ORDERED, that this Order supercedes Order No. ORDER No. 01-03 except for enforcement purposes, and, in order to meet the provisions contained in Division 7 of the California Water Code (CWC) and regulations adopted thereunder, and the provisions of the federal Clean Water Act (CWA) and regulations and guidelines adopted thereunder, the Discharger shall comply with the requirements in this Order.

I, Gerard J. Thibeault, Executive Officer, do hereby certify that this Order No. R8-2006-0009 with all attachments is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Santa Ana Region, on April 21, 2006.

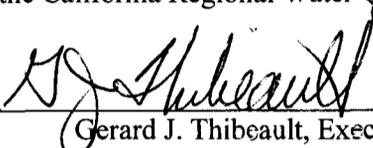

Gerard J. Thibeault, Executive Officer

TABLE OF CONTENTS

I. Facility Information..... 4
II. Findings..... 4
III. Discharge Prohibitions..... 9
IV. Effluent Limitations and Discharge Specifications..... 9
 A. Effluent Limitations – Discharge Points (DPs) 001, 002, 003, and 004..... 9
 1. Tertiary Effluent Limitations - DPs 001, 002, 003, and 004 9
 2. Toxicity Requirements - DP 001 11
 3. Secondary Effluent Limitations - DP 001..... 12
 4. Interim Effluent Limitations – Not Applicable..... 13
 B. Land Discharge Specifications - Not Applicable..... 13
 C. Reclamation Specifications – DPs 005, 006, 007, and 008 13
V. Receiving Water Limitations and Specifications..... 17
 A. Surface Water Limitations 17
 B. Groundwater Limitations 18
VI. Provisions..... 18
 A. Standard Provisions 18
 B. Monitoring and Reporting Program Requirements..... 20
 C. Special Provisions..... 20
 1. Reopener Provisions 20
 2. Special Studies, Technical Reports and Additional Monitoring Requirements 21
 3. Best Management Practices and Pollution Prevention 21
 4. Construction, Operation and Maintenance Specifications..... 22
 5. Special Provisions for Municipal Facilities (POTWs Only)..... 23
 6. Other Special Provisions – Not Applicable 25
 7. Compliance Schedules – Not Applicable 25
VII. Compliance Determination..... 26

LIST OF TABLES

Table 1. Discharger Information 1
Table 2. Discharge Location 1
Table 3. Administrative Information..... 2
Table 4. Facility Information 6
Table 5. Basin Plan Beneficial Uses 7
Table 7. Tertiary Effluent Limitations 11
Table 8. Secondary Effluent Limitations 14
Table 9. Reclaimed Effluent Limitations 15

LIST OF ATTACHMENTS

Attachment A – Definitions A-1
Attachment B – Topographic Map..... B-1
Attachment C – Flow Schematic..... C-1
Attachment D – Standard Provisions D-1
Attachment E – Monitoring and Reporting Program (MRP) E-1
Attachment F – Fact Sheet F-1
Attachment G – EPA PPL Table..... G-1
Attachment H – PQL Table..... H-1
Attachment I – Minimum Levels Table I-1
Attachment J – Triggers for Quarterly Monitoring of Priority Pollutants..... J-1

I. FACILITY INFORMATION

The following Discharger is subject to waste discharge requirements as set forth in this Order:

Table 4. Facility Information

Discharger	City of Riverside/Department of Public Works/City of Riverside
Name of Facility	Riverside Regional Water Quality Control Plant, City of Riverside
Facility Address	5950 Acorn Street
	Riverside, CA 92504
	Riverside County
Facility Contact, Title, and Phone	Stephen Schultz, Wastewater System Manager, (951) 351-6140 Rodney Cruze, Wastewater Operations Manager, (951) 351-6011
Mailing Address	Same
Type of Facility	POTW
Facility Design Flow	40 million gallons per day

II. FINDINGS

The California Regional Water Quality Control Board, Santa Ana Region (hereinafter Regional Water Board), finds:

A. Background. The City of Riverside (hereinafter Discharger) is currently discharging pursuant to Order No. 01-3 and National Pollutant Discharge Elimination System (NPDES) Permit No. CA0105350. The Discharger submitted a Report of Waste Discharge, dated April 13, 2005, and applied for a NPDES permit renewal to discharge from the Riverside Regional Water Quality Control Plant (hereinafter RRWQCP, or Facility) up to 40 million gallons per day (mgd) of tertiary treated wastewater to Reach 3 of the Santa Ana River. The application was deemed complete on November 29, 2005.

For the purposes of this Order, references to the “Discharger” or “permittee” in applicable federal and State laws, regulations, plans, or policy are held to be equivalent to references to the Discharger herein.

B. Facility Description. The Discharger owns and operates the RRWQCP, a publicly owned treatment works. The RRWQCP consists of two secondary treatment trains (Plants 1 and 2), one tertiary treatment plant that treats the flow from both Plants 1 and 2, and solids handling facilities that treat the sludge produced from wastewater treatment. Preliminary treatment consists of bar screens and vortex grit removal. Secondary treatment consists of alum and/or polymer injection, primary sedimentations basins, aeration basins, and secondary sedimentation. Tertiary treatment consists of equalization basins, dual media filtration (16 filters), chlorination (3 chlorine contact tanks), and dechlorination by sodium bisulfite. Solids handling includes dissolved air flotation (DAF) thickeners, anaerobic digestion (5 digesters), dewatering (2 belt presses and centrifuge) and air-drying. Wastewater is discharged from Discharge Points 001, 002, 003, and 004 (see table on cover page) to Reach 3 of the Santa Ana River, which is a water of the United States. Currently, a portion of the tertiary treated wastewater is directed through constructed wetlands for further nitrogen removal and then discharged through DPs 003. When at least 20:1 dilution is provided by natural flows in the receiving water, the Discharger is authorized to discharge

secondary treated wastewater from DP 001 into Reach 3 of the Santa Ana River. On-site storm water is collected and piped to the influent of Plant 1 aeration basins. Attachment B provides a location map of the area around the facility. Attachment C provides a flow schematic of the facility treatment systems.

- C. Legal Authorities.** This Order is issued pursuant to Section 402 of the federal Clean Water Act (CWA) and implementing regulations adopted by the U.S. Environmental Protection Agency (USEPA) and Chapter 5.5, Division 7 of the California Water Code (CWC). It shall serve as a NPDES permit for point source discharges from this facility to surface waters. This Order also serves as Waste Discharge Requirements (WDRs) pursuant to Article 4, Chapter 4 of the CWC.
- D. Background and Rationale for Requirements.** The Regional Water Board developed the requirements in this Order based on information submitted as part of the application, through monitoring and reporting programs, and other available information. The Fact Sheet (Attachment F), which contains background information and rationale for Order requirements, is hereby incorporated into this Order and constitutes part of the Findings for this Order. Attachments A through E and G through I are also incorporated into this Order.
- E. State law.** The provisions/requirements in subsections IV. C., and V.B. of this Order are included to implement State law only. These provisions are not required or authorized under the federal CWA; consequently, violations of these provisions are not subject to the enforcement remedies that are available for NPDES violations.
- F. California Environmental Quality Act (CEQA).** This action to adopt an NPDES permit is exempt from the provisions of Chapter 3 of Division 13 of the Public Resources Code in accordance with Section 13389 of the CWC. This action also involves the re-issuance of waste discharge requirements for an existing facility that discharges treated wastewater to land and as such, is exempt from the provisions of California Environmental Quality Act (commencing with Section 21100) in that the activity is exempt pursuant to Title 14 of the California Code of Regulations Section 15261.
- G. Technology-based Effluent Limitations.** Title 40 of the Code of Federal Regulations (CFR) at Section 122.44(a) requires that permits include applicable technology-based limitations and standards. This Order includes technology-based effluent limitations based on Secondary Treatment Standards at 40 CFR Part 133 and tertiary treatment or equivalent requirements that meet both the technology-based secondary treatment standards for POTWs and protect the beneficial uses of the receiving waters. The Regional Water Board has considered the factors listed in CWC Section 13241 in establishing these requirements and Best Professional Judgment (BPJ) in accordance with 40 CFR Section 125.3. A detailed discussion of the technology-based effluent limitations development is included in the Fact Sheet.

H. Water Quality-based Effluent Limitations. Section 122.44(d) of 40 CFR requires that permits include effluent limitations for all pollutants that are or may be discharged at levels that have the reasonable potential to cause or contribute to an exceedance of a water quality standard, including numeric and narrative objectives within a standard. Where numeric water quality objectives have not been established for a pollutant, water quality-based effluent limitations (WQBELs) may be established: (1) using USEPA criteria guidance under CWA Section 304(a), supplemented where necessary by other relevant information; (2) on an indicator parameter for the pollutant of concern; or (3) using a calculated numeric water quality criterion, such as a proposed State criterion or policy interpreting the State’s narrative criterion, supplemented with other relevant information, as provided in 40 CFR Section 122.44(d)(1)(vi).

I. Water Quality Control Plans. The Regional Water Board adopted a revised Water Quality Control Plan for the Santa Ana Region (hereinafter Basin Plan) that became effective on January 24, 1995. The Basin Plan designates beneficial uses, establishes water quality objectives, and contains implementation programs and policies to achieve those objectives for all waters in the Santa Ana Region addressed through the plan. More recently, the Basin Plan was amended significantly to incorporate revised boundaries for groundwater subbasins, now termed “management zones”, new nitrate-nitrogen and TDS objectives for the new management zones, and new nitrogen and TDS management strategies applicable to both surface and ground waters. The Regional Water Board adopted this Basin Plan Amendment on January 22, 2004. The State Water Resources Control Board (State Water Board) and Office of Administrative Law (OAL) approved the Amendment on September 30, 2004 and December 23, 2004, respectively. The surface water provisions of the Amendment are awaiting approval by the U.S. Environmental Protection Agency. This Order implements those provisions, which, for the City of Riverside, results in effluent limitations that are at least as stringent as those in the current permit.

In addition, the Basin Plan implements State Water Resources Control Board (State Water Board) Resolution No. 88-63, which established State policy that all waters, with certain exceptions, should be considered suitable or potentially suitable for municipal or domestic supply.

As discussed in detail in the Fact Sheet (Attachment F), beneficial uses applicable to Reach 3 of Santa Ana River are as follows:

Table 5. Basin Plan Beneficial Uses

Discharge Point	Receiving Water Name	Beneficial Use(s)
001, 002, 003, and 004	Reach 3 of Santa Ana River, near Van Buren Blvd Bridge	<u>Present or Potential:</u> Agricultural supply, groundwater recharge, water contact recreation, non-contact water recreation, warm freshwater habitat, wildlife habitat, and rare, threatened or endangered species.
006, 007, and 008	Chino South Groundwater management zone	<u>Present or Potential:</u> Municipal and domestic supply, agricultural supply, industrial service supply, and industrial process supply.
001, 002, and 003	Downstream groundwater management zone (Orange County)	<u>Present or Potential:</u> Municipal and domestic supply, agricultural supply, industrial service supply, and industrial process supply.

Requirements of this Order specifically implement the applicable Water Quality Control Plans.

- J. National Toxics Rule (NTR) and California Toxics Rule (CTR).** USEPA adopted the NTR on December 22, 1992, and later amended it on May 4, 1995 and November 9, 1999. About forty criteria in the NTR were applicable in California. On May 18, 2000, USEPA adopted the CTR, which incorporated the NTR criteria that were applicable in California. The CTR was amended on February 13, 2001. These rules contain water quality criteria for priority pollutants.
- K. State Implementation Policy.** On March 2, 2000, the State Water Board adopted the Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California (State Implementation Policy or SIP). The SIP became effective on April 28, 2000 with respect to the priority pollutant criteria promulgated for California by the USEPA through the NTR and to the priority pollutant objectives established by the Regional Water Board in the Basin Plan. The SIP became effective on May 18, 2000 with respect to the priority pollutant criteria promulgated by the USEPA through the California Toxics Rule. The State Water Board adopted amendments to the SIP on February 24, 2005 that became effective on July 13, 2005.
- L. Compliance Schedules and Interim Requirements.** Section 2.1 of the SIP provides that, based on a Discharger's request and demonstration that it is infeasible for an existing Discharger to achieve immediate compliance with an effluent limitation derived from a CTR criterion, compliance schedules may be allowed in an NPDES permit. Unless an exception has been granted under Section 5.3 of the SIP, a compliance schedule may not exceed 5 years from the date that the permit is issued or reissued, nor may it extend beyond 10 years from the effective date of the SIP (or May 18, 2010) to establish and comply with CTR criterion-based effluent limitations. Where a compliance schedule for a final effluent limitation exceeds 1 year, the Order must include interim numeric limitations for that constituent or parameter. Where allowed by the Basin Plan, compliance schedules and interim effluent limitations or discharge specifications may also be granted. The Basin Plan specifies language authorizing the inclusion of compliance schedules in NPDES permits under certain circumstances. This Order does not include compliance schedules and interim effluent limitations and/or discharge specifications.
- M. Alaska Rule.** On March 30, 2000, USEPA revised its regulation that specifies when new and revised State and Tribal water quality standards (WQS) become effective for CWA purposes (40 CFR 131.21, 65 FR 24641, April 27, 2000). Under the revised regulation (also known as the Alaska rule), new and revised standards submitted to USEPA after May 30, 2000, must be approved by USEPA before being used for CWA purposes. The final rule also provides that standards already in effect and submitted to USEPA by May 30, 2000, may be used for CWA purposes, whether or not approved by USEPA.
- N. Stringency of Requirements for Individual Pollutants.** This Order contains restrictions on individual pollutants that are no more stringent than required by the federal CWA. Individual pollutant restrictions consist of technology-based restrictions and water quality-based effluent limitations. The technology-based effluent limitations consist of restrictions on pollutants listed. Restrictions on pollutants listed are specified in federal regulations as discussed in Attachment F, and the permit's technology-based pollutant restrictions are no more stringent than required by the CWA. Water quality-based effluent limitations have been scientifically derived to implement water quality objectives that protect beneficial uses. Both the beneficial uses and the water quality objectives have been approved pursuant to federal law and are the applicable

federal water quality standards. To the extent that toxic pollutant water quality-based effluent limitations were derived from the CTR, the CTR is the applicable standard pursuant to 40 CFR 131.38. The scientific procedures for calculating the individual water quality-based effluent limitations are based on the CTR-SIP, which was approved by USEPA on May 18, 2000. All beneficial uses and water quality objectives contained in the Basin Plan were approved under state law and submitted to and approved by USEPA prior to May 30, 2000. Any water quality objectives and beneficial uses submitted to USEPA prior to May 30, 2000, but not approved by USEPA before that date, are nonetheless “applicable water quality standards for purposes of the CWA” pursuant to 40 CFR 131.21(c)(1). Collectively, this Order’s restrictions on individual pollutants are no more stringent than required to implement the technology-based requirements of the CWA and the applicable water quality standards for purposes of the CWA.

- O. Antidegradation Policy.** Section 131.12 of 40 CFR requires that State water quality standards include an antidegradation policy consistent with the federal policy. The State Water Board established California’s antidegradation policy in State Water Board Resolution No. 68-16. Resolution No. 68-16 incorporates the federal antidegradation policy where the federal policy applies under federal law. Resolution No. 68-16 requires that existing quality of waters be maintained unless degradation is justified based on specific findings. The Regional Water Board’s Basin Plan implements, and incorporates by reference, both the State and federal antidegradation policies. As discussed in detail in the Fact Sheet the permitted discharge is consistent with the antidegradation provision of 40 CFR Section 131.12 and State Water Board Resolution No. 68-16.
- P. Anti-Backsliding Requirements.** Sections 402(o)(2) and 303(d)(4) of the CWA and federal regulations at 40 CFR § 122.44(l) prohibit backsliding in NPDES permits. These anti-backsliding provisions require effluent limitations in a reissued permit to be as stringent as those in the previous permit, with some exceptions where limitations may be relaxed. All effluent limitations in this Order are at least as stringent as the effluent limitations in the previous Order No. 01-03.
- Q. Monitoring and Reporting.** Section 122.48 of 40 CFR requires that all NPDES permits specify requirements for recording and reporting monitoring results. Sections 13267 and 13383 of the CWA authorize the Regional Water Board to require technical and monitoring reports. The Monitoring and Reporting Program establishes monitoring and reporting requirements to implement federal and State requirements. This Monitoring and Reporting Program is provided in Attachment E.
- R. Standard and Special Provisions.** Standard Provisions, which in accordance with 40 CFR Sections 122.41 and 122.42, apply to all NPDES discharges and must be included in every NPDES permit, are provided in Attachment D. The Regional Water Board has also included in this Order special provisions applicable to the Discharger. A rationale for the special provisions contained in this Order is provided in the attached Fact Sheet (Attachment F).

- S. Notification of Interested Parties.** The Regional Water Board has notified the Discharger and interested agencies and persons of its intent to prescribe Waste Discharge Requirements for the discharge and has provided them with an opportunity to submit their written comments and recommendations. Details of notification are provided in the Fact Sheet (Attachment F) of this Order.
- T. Consideration of Public Comment.** The Regional Water Board, in a public meeting, heard and considered all comments pertaining to the discharge. Details of the Public Hearing are provided in the Fact Sheet (Attachment F) of this Order.

III. DISCHARGE PROHIBITIONS

- A. Wastewater discharged shall be limited to tertiary treated and disinfected effluent and/or secondary treated and disinfected effluent that meets the conditions and requirements specified in Section IV.
- B. The direct discharge of secondary treated wastewater to the Santa Ana River other than when the flow¹ in the River results in a dilution of 20:1 or more at the point of discharge is prohibited.
- C. The discharge of wastewater at a location or in a manner different from those described in the Findings is prohibited.
- D. The bypass or overflow of untreated wastewater or wastes to surface waters or surface water drainage courses is prohibited, excepted as allowed in Standard Provisions - Permit Compliance I. G. of attachment D, Standard Provisions.
- E. The discharge of any substances in concentrations toxic to animal or plant life is prohibited.
- F. The discharge of any radiological, chemical, or biological warfare agent or high level radiological waste is prohibited.

IV. EFFLUENT LIMITATIONS AND DISCHARGE SPECIFICATIONS

A. Effluent Limitations – Discharge Points (DPs) 001, 002, 003, and 004

1. Tertiary Effluent Limitations - DPs 001, 002, 003, and 004

Unless otherwise specifically specified herein, compliance shall be measured at monitoring location M-001A as described in the MRP:

- a. The discharge of tertiary treated wastewater shall maintain compliance with the following effluent limitations at DPs 001, 002, 003, and 004:

¹ *Exclusive of discharges to surface waters from upstream public owned treatment works.*

Table 7. Tertiary Effluent Limitations

Parameter	Units	Effluent Limitations				
		Average Monthly	Average Weekly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum
Biochemical Oxygen Demand 5-day @ 20°C	mg/L	20	30	--	--	--
	lbs/day	6,672	10,008	--	--	--
Total Suspended Solids	mg/L	20	30	--	--	--
	lbs/day	6,672	10,008	--	--	--
pH	standard units	--	--	--	6.5	8.5
Total Chlorine Residual	mg/L	--	--	--	--	0.1
Ammonia-Nitrogen	mg/L	5.0	--	--	--	--
	lbs/day	1,668	--	--	--	--
Cyanide (Free)	µg/l	4.2	--	8.5	--	--

- b. The average monthly percent removal of BOD 5-day 20⁰C and total suspended solids shall not be less than 85 percent.
- c. TDS Limitations - The lower of the two total dissolved solids limits specified in 1) or 2), below, is the limit. :
 - 1) The 12-month running average total dissolved solids concentration and mass emission rate shall not exceed 650 mg/l and 216,840 lbs/day², or
 - 2) The 12-month average total dissolved solids concentration shall not exceed the 12-month average total dissolved solids concentration in the water supply by more than 250 mg/l.
- d. Total Inorganic Nitrogen (TIN) Limitations, with compliance measured at monitoring locations at M-001A, and M-003:
 - 1) The flow weighted 12-month running average TIN concentration for flows up to 38 million gallons per day shall not exceed 13 mg/l and for flows exceeding 38 mgd shall not exceed 10 mg/l. The flow weighted 12-month running average TIN concentration shall not exceed the computed value using the following equation:

$$C_e, \text{ TIN 12-m average, mg/l} = \frac{[13 \times 38 + (\text{effluent flow}_{12\text{-m average}} - 38) \times 10]}{(\text{Effluent flow}_{12\text{-m average}})}$$
 - 2) The TIN 12-month average mass emission rate shall not exceed the computed value using the equation:

² Derived from 40 mgd x 8.34 x 650 mg/L.

TIN 12-month emission rate, (lbs/day) = 4,120 lbs³ + (flows_{12-m average} above 38 mgd x 8.34 x 10 mg/l)

- e. The discharge shall at all times be adequately oxidized, filtered, and disinfected tertiary treated wastewater and shall meet the following limitations: Compliance with e.2), e.3), and e.4) shall be measured at monitoring location M-001B.
- 1) The turbidity of the filter effluent shall not exceed any of the following:
 - (a) Average of 2 Nephelometric Turbidity Unit (NTU) within any 24-hour period;
 - (b) 5 NTU more than 5 percent of the time in any 24-hour period; and
 - (c) 10 NTU at any time.
 - 2) The 7-day median number of total coliform shall not exceed a Most Probable Number (MPN) of 2.2 total coliform bacteria per 100 milliliters (ml). (See Compliance Determination VII.L.1., below)
 - 3) The number of total coliform organism shall not exceed an MPN of 23 total coliform bacteria per 100 ml in more than one sample in any 30-day period.
 - 4) No total coliform sample shall exceed an MPN of 240 total coliform bacteria per 100 ml.
- f. There shall be no visible oil and grease in the discharge.

2. Toxicity Requirements - DP 001

Compliance with toxicity requirements shall be measured at monitoring location M-001A (including Van Buren Bridge location) or M-002.

- a. There shall be no acute or chronic toxicity in the plant effluent nor shall the plant effluent cause any acute or chronic toxicity in the receiving water. All waters shall be maintained free of toxic substances in concentrations which are toxic to, or which produce detrimental physiological responses in human, plant, animal, or indigenous aquatic life. This Order contains no numeric limitation for toxicity. However, the Discharger shall conduct chronic toxicity monitoring.
- b. The Discharger shall implement the accelerated monitoring as specified in Attachment E when the result of any single chronic toxicity test of the effluent exceeds 1.0 TUc.
- c. The Discharger shall develop an Initial Investigation Toxicity Reduction Evaluation (IITRE) work plan that describes the steps the Discharger intends to follow if required by Toxicity Requirement d., below. The work plan shall include at a minimum:
 - 1) A description of the investigation and evaluation techniques that will be used to identify potential causes/sources of the exceedance, effluent variability, and/or

³ Derived from 38 mgd x 8.34 x 13 mg/L.

- efficiency of the treatment system in removing toxic substances. This shall include a description of an accelerated chronic toxicity-testing program.
- 2) A description of the methods to be used for investigating and maximizing in-house treatment efficiency and good housekeeping practices.
 - 3) A description of the evaluation process to be used to determine if implementation of a more detailed TRE/TIE is necessary.
- d. The Discharger shall implement the IITRE work plan whenever the results of chronic toxicity tests of the effluent exceed:
- 1) A two month median value of 1.0 TUC for survival or reproduction endpoint or,
 - 2) Any single test value of 1.7 TUC for survival endpoint.
- e. The Discharger shall develop a detailed Toxicity Reduction Evaluation and Toxicity Identification Evaluation (TRE/TIE) work plan that shall describe the steps the Discharger intends to follow if the implemented IITRE fails to identify the cause of, or to rectify, the toxicity.
- f. The Discharger shall use as guidance, at a minimum, EPA manuals EPA/600/2-88/070 (industrial), EPA/600/4-89-001A (municipal), EPA/600/6-91/005F (Phase I), EPA/600/R-92/080 (Phase II), and EPA-600/R-92/081 (Phase III) to identify the cause(s) of toxicity. If during the life of this Order the aforementioned EPA manuals are revised or updated, the revised/updated manuals may also be used as guidance. The detailed TRE/TIE work plan shall include:
- 1) Further actions to investigate and identify the cause of toxicity;
 - 2) Actions the Discharger will take to mitigate the impact of the discharge and to prevent the recurrence of toxicity; and
 - 3) A schedule for these actions.
- g. The Discharger shall implement the TRE/TIE workplan if the IITRE fails to identify the cause of, or rectify, the toxicity, or if in the opinion of the Executive Officer the IITRE does not adequately address an identified toxicity problem.
- h. The Discharger shall assure that adequate resources are available to implement the required TRE/TIE.

3. Secondary Effluent Limitations - DP 001

Discharge of Secondary Treated and Disinfected Effluent when the River flow⁴ provides a 20:1 (receiving water flow:wastewater flow) dilution or more at DP 001:

- a. The discharge of secondary treated wastewater shall maintain compliance with the following effluent limitations, with compliance measured at monitoring location M-001A, as described in the attached Monitoring and Reporting Program (Attachment E):

Table 8. Secondary Effluent Limitations

Parameter	Units	Effluent Limitations
-----------	-------	----------------------

⁴ Exclusive of discharges to surface waters from upstream publicly owned treatment works.

		Average Monthly	Average Weekly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum
Biochemical Oxygen Demand 5-day @ 20°C	mg/L	30	45	--	--	--
Total Suspended Solids	mg/L	30	45	--	--	--
pH	standard units	--	--	--	6.5	8.5
Total Residual Chlorine	mg/L	--	--	--	--	2.1

- b. The discharge of secondary treated wastewater shall at all times be adequately oxidized and disinfected wastewater and shall meet the following limitations:
 - 1) With compliance measured at monitoring location M-001B, the number of coliform organisms does not exceed a median of 23 per 100 milliliters as determined from the daily coliform organism values for the last seven (7) days. (See also Compliance Determination VII.L.2., below)
 - 2) With compliance measured at monitoring location M-001A, the discharge shall be considered adequately oxidized if the 5-day @ 20°C Biochemical Oxygen Demand and Total Suspended Solids constituent concentrations of the discharge are less than or equal to the limitations shown in A.3.a., above.
- c. The monthly average biochemical oxygen demand and suspended solids concentrations of the discharge shall not be greater than fifteen percent (15%) of the monthly average influent concentration.

4. Interim Effluent Limitations – Not Applicable

B. Land Discharge Specifications - Not Applicable.

C. Reclamation Specifications – DPs 005, 006, 007, and 008

- 1. Beginning April 21, 2006, the use of recycled water for golf course/landscape irrigation or other similar uses shall maintain compliance with the following limitations. Compliance is to be measured at monitoring location M-001A or at other approved monitoring locations where representative samples of recycled water can be obtained for laboratory testing and analysis as described in the attached Monitoring and Reporting Program (Attachment E). The Discharger shall submit for approval by the Executive Officer other monitoring location(s) not specified herein where representative samples of recycled water could be obtained for laboratory testing and analysis.
 - a. Physical/Biological Limitations:

Table 9. Reclaimed Effluent Limitations

Parameter	Units	Recycled Water Limitations				
		Average Monthly	Average Weekly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum

Parameter	Units	Recycled Water Limitations				
		Average Monthly	Average Weekly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum
Biochemical Oxygen Demand 5-day @ 20°C	mg/L	20	30	--	--	--
Total Suspended Solids	mg/L	20	30	--	--	--
pH	standard units	--	--	--	6	9

- b. Recycled water for recycling uses described in Section 60307(a) of Division 4, Chapter 3, Title 22, California Code of Regulations and for irrigation of food crops, parks and playground, school yards, residential landscaping and other irrigation uses not specified in Section 60304(a) of Division 4, Chapter 3, Title 22, California Code of Regulations or not prohibited in other Sections of the California Code of Regulations shall at all times be adequately oxidized, filtered, and disinfected tertiary treated wastewater and shall meet the following limitations:
- 1) The turbidity of the filter effluent shall not exceed any of the following:
 - a) Average of 2 Nephelometric Turbidity Unit (NTU) within any 24-hour period;
 - b) 5 NTU more than 5 percent of the time in any 24-hour period; and
 - c) 10 NTU at any time.
 - 2) The 7-day median number of total coliform shall not exceed a Most Probable Number (MPN) of 2.2 total coliform bacteria per 100 milliliters (ml). (see Compliance Determination VII.L.1., below)
 - 3) The number of total coliform organism shall not exceed an MPN of 23 total coliform bacteria per 100 ml in more than one sample in any 30-day period.
 - 4) No total coliform sample shall exceed an MPN of 240 total coliform bacteria per 100 ml.
 - 5) A chlorine disinfection process following filtration that provides a CT (the product of total chlorine residual and modal contact time measured at the same point) value of not less than 450 milligram-minutes per liter at all times with a modal contact time of at least 90 minutes, based on peak dry weather design flow.
- c. Recycled water used for irrigation of food crops where the edible portion is produced above ground and not contacted by the recycled water shall at all times be adequately oxidized and disinfected so that the median concentration of total coliform bacteria in the disinfected effluent does not exceed a most probable number (MPN) of 2.2 per 100 milliliters utilizing the bacteriological results of the last seven days for which analyses have been completed, and the number of total coliform bacteria does not exceed an MPN of 23 per 100 milliliters in more than one sample.
- d. Recycled water used for the uses listed below shall be an oxidized and disinfected water so that the median concentration of total coliform bacteria in the disinfected effluent does not exceed a most probable number (MPN) of 23 per 100 milliliters utilizing the bacteriological results of the last seven days for which analyses have been completed, and the number of total coliform bacteria does not exceed an MPN of 240 per 100 milliliters in more than one sample in any 30 day period.
- 1) Industrial boiler feed, nonstructural fire fighting, backfill consolidation around nonpotable piping, soil compaction, mixing concrete, dust control on roads and streets, cleaning roads, sidewalks and outdoor work areas and industrial process water that will not come into contact with workers.

- 2) Irrigation of cemeteries, freeway landscaping, restricted access golf courses, ornamental nursery stock and sod farms where access by the general public is not restricted, pasture for animals producing milk for human consumption, and any nonedible vegetation where access is controlled so that irrigated area cannot be used as if it were part of a park, playground or school yard
2. The use of recycled water shall only commence after the California Department of Health Services (CDHS) grants final approval for such use. The Discharger shall provide the Regional Water Board with a copy of the CDHS approval letter within 30 days of the approval notice.
3. The Discharger shall be responsible for assuring that recycled water is delivered and utilized in conformance with this Order, the recycling criteria contained in Title 22, Division 4, Chapter 3, Sections 60301 through 60355, California Code of Regulations, and the "Guidelines for Use of Reclaimed Water" by the California Department of Health Services. The Discharger shall conduct periodic inspections of the facilities of the recycled water users to monitor compliance by the users with this Order.
4. The Discharger shall establish and enforce Rules and Regulations for Recycled Water users, governing the design and construction of recycled water use facilities and the use of recycled water in accordance with the uniform statewide recycling criteria established pursuant to the California Water Code Section 13521.
 - a. Use of recycled water by the Discharger shall be consistent with its Rules and Regulations for Recycled Water Use.
 - b. Any revisions made to the Rules and Regulations shall be subject to the review of the Regional Water Board, the California Department of Health Services, and the County of Riverside Department of Environmental Health. The revised Rules and Regulations or a letter certifying that the Discharger's Rules and Regulations contain the updated provisions in this Order, shall be submitted to the Regional Water Board within 60 days of adoption of this Order by the Regional Water Board.
5. The Discharger shall, within 60 days of the adoption of this Order, review and update as necessary its program to conduct compliance inspections of recycled water reuse sites. Inspections shall determine the status of compliance with the Discharger's Rules and Regulations for Recycled Water Use.
6. The storage, delivery, or use of recycled water shall not individually or collectively, directly or indirectly, result in a pollution or nuisance, or adversely affect water quality, as defined in the California Water Code
7. Prior to delivering recycled water to any new user, the Discharger shall submit to the Regional Water Board, the California Department of Health Services and the Riverside County Health Department a report containing the following information for review and approval:

- a. The average number of persons estimated to be served at each use site area on a daily basis.
 - b. The specific boundaries of the proposed use site area including a map showing the location of each facility, drinking water fountain, and impoundment to be used.
 - c. The person or persons responsible for operation of the recycled water system at each use area.
 - d. The specific use to be made of the recycled water at each use area.
 - e. The methods to be used to assure that the installation and operation of the recycled system will not result in cross connections between the recycled water and potable water piping systems. This shall include a description of the pressure, dye or other test methods to be used to test the system.
 - f. Plans and specifications which include following:
 - 1) Proposed piping system to be used.
 - 2) Pipe locations of both the recycled and potable systems.
 - 3) Type and location of the outlets and plumbing fixtures that will be accessible to the public.
 - 4) The methods and devices to be used to prevent backflow of recycled water into the potable water system.
 - 5) Plan notes relating to specific installation and use requirements.
8. The Discharger shall require the user(s) to designate an on-site supervisor responsible for the operation of the recycled water distribution system within the recycled water use area. The supervisor shall be responsible for enforcing this Order, prevention of potential hazards, the installation, operation and maintenance of the distribution system, maintenance of the distribution and irrigation system plans in "as-built" form, and for the distribution of the recycled wastewater in accordance with this Order.

V. RECEIVING WATER LIMITATIONS AND SPECIFICATIONS

A. Surface Water Limitations

1. Receiving water limitations are based upon water quality objectives contained in the Basin Plan. As such, they are a required part of this Order. The discharge shall not cause the following in the Santa Ana River, Reach 3, or in downstream Reaches of the Santa Ana River:
 - a. Coloration of the receiving waters, which causes a nuisance or adversely affects beneficial uses.
 - b. Deposition of oil, grease, wax or other materials in the receiving waters in concentrations which result in a visible film or in coating objects in the water, or which cause a nuisance or affect beneficial uses.
 - c. An increase in the amounts of suspended or settleable solids in the receiving waters, which will cause a nuisance or adversely affect beneficial uses as a result of controllable water quality factors.

- d. Taste or odor-producing substances in the receiving waters at concentrations, which cause a nuisance or adversely affect beneficial uses.
 - e. The presence of radioactive materials in the receiving waters in concentrations, which are deleterious to human, plant or animal life.
 - f. The depletion of the dissolved oxygen concentration below 5.0 mg/l.
 - g. The temperature of the receiving waters to be raised above 90°F (32°C) during the period of June through October, or above 78°F (26°C) during the rest of the year.
 - h. The concentration of pollutants in the water column, sediments, or biota to adversely affect the beneficial uses of the receiving water. The discharge shall not result in the degradation of inland surface water communities and populations, including vertebrate, invertebrate, and plant species.
2. The discharge of wastes shall not cause a violation of any applicable water quality standards for receiving waters adopted by the Regional Water Board or State Water Board, as required by the Clean Water Act and regulations adopted thereunder.
 3. Pollutants not specifically mentioned and limited in this Order shall not be discharged at levels that will bioaccumulate in aquatic resources to levels, which are harmful to human health.
 4. The discharge shall not contain constituent concentrations of mercury that will result in the bioaccumulation of methylmercury in fish flesh tissue greater than 0.3 milligram methylmercury/kilogram. (See also Section VI.C.1.b. and VI.C.2., below).

B. Groundwater Limitations

1. The use of recycled water shall not cause the underlying groundwater to be degraded, unreasonably affect beneficial uses, or cause a condition of pollution or nuisance overlying the Chino South Groundwater Management Zone.

VI. PROVISIONS

A. Standard Provisions

1. The Discharger shall comply with all Standard Provisions included in Attachment D of this Order.
2. The Discharger shall comply with the following provisions:
 - a. Neither the treatment nor the discharge of waste shall create, or threaten to create, a nuisance or pollution as defined by Section 13050 of the California Water Code.
 - b. The Discharger shall maintain a copy of this Order at the site so that it is available to site operating personnel at all times. Key operating personnel shall be familiar with its content.

- c. The Discharger shall take all reasonable steps to minimize any adverse impact to receiving waters resulting from noncompliance with any requirements specified in this Order, including such accelerated or additional monitoring as necessary to determine the nature and impact of the noncomplying discharge.
- d. The Discharger shall optimize chemical additions needed in the treatment process to meet waste discharge requirements so as to minimize total dissolved solid increases in the treated wastewater.
- e. The provisions of this Order are severable, and if any provision of this Order, or the application of any provisions of this Order to any circumstance, is held invalid, the application of such provision to other circumstances, and the remainder of this Order shall not be affected thereby.
- f. Collected screenings, sludge, and other solids removed from liquid wastes shall be disposed of in a manner approved by the Regional Water Board's Executive Officer.
- g. If the Discharger demonstrates a correlation between the biological oxygen demand (BOD₅) and total organic carbon (TOC) concentrations in the effluent to the satisfaction of the Executive Officer, compliance with the BOD₅ limits contained in this Order may be determined based on analyses of the TOC of the effluent.
- h. In the event of any change in control or ownership of land or waste discharge facility presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be forwarded to the Regional Water Board.
- i. The treatment facilities shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.
- j. Failure to comply with provisions or requirements of this Order, or violation of other applicable laws or regulations governing discharges from this facility, may subject the Discharger to administrative or civil liabilities, criminal penalties, and/or other enforcement remedies to ensure compliance. Additionally, certain violations may subject the Discharger to civil or criminal enforcement from appropriate local, state, or federal law enforcement entities.
- k. In the event the Discharger does not comply or will be unable to comply for any reason, with any prohibition, maximum daily effluent limitation, or receiving water limitation of this Order, the Discharger shall notify the Regional Water Board by telephone (951) 782-4130 within 24 hours of having knowledge of such noncompliance, and shall confirm this notification in writing within five days, unless the Regional Water Board waives confirmation. The written notification shall state the nature, time, duration, and cause of noncompliance, and shall describe the measures being taken to remedy the current noncompliance and, prevent recurrence including, where applicable, a schedule of implementation. Other noncompliance requires written notification as above at the time of the normal monitoring report.

B. Monitoring and Reporting Program Requirements

1. The Discharger shall comply with the Monitoring and Reporting Program, and future revisions thereto, in Attachment D of this Order. This monitoring and reporting program may be modified by the Executive Officer at any time during the term of this Order, and may include an increase in the number of parameters to be monitored, the frequency of the monitoring or the number and size of samples to be collected. Any increase in the number of parameters to be monitored, the frequency of the monitoring or the number and size of samples to be collected may be reduced back to the levels specified in the original monitoring and reporting program at the discretion of the Executive Officer.

C. Special Provisions

1. Reopener Provisions

- a. This Order may be reopened to address any changes in State or federal plans, policies or regulations that would affect the quality requirements for the discharges.
- b. This Order may be reopened to include effluent limitations for pollutants determined to be present in the discharge in concentrations that pose a reasonable potential to cause or contribute to violations of water quality objectives.
- c. This Order may be reopened and modified in accordance with the requirements set forth at 40 CFR 122 and 124, to include the appropriate conditions or limits to address demonstrated effluent toxicity based on newly available information, or to implement any EPA-approved new State water quality standards applicable to effluent toxicity.
- d. This Order may be reopened for modification, or revocation and reissuance, as a result of the detection of a reportable priority pollutant generated by special conditions included in this Order. These special conditions may be, but are not limited to, fish tissue sampling, whole effluent toxicity, monitoring requirements on internal waste stream(s), and monitoring for surrogate parameters. Additional requirements may be included in this Order as a result of the special condition monitoring data.
- e. This Order may be reopened to include an appropriate bioaccumulation based effluent limit for mercury if test results (as required in Attachment E of this Order) show that the concentration levels of methylmercury in the fish tissue are at or above 0.3 milligrams per kilogram.
- f. This Order may be reopened to incorporate appropriate biosolids requirements if the State Water Resources Control Board and the Regional Water Quality Control Board are given the authority to implement regulations contained in 40 CFR 503.

2. Special Studies, Technical Reports and Additional Monitoring Requirements

- a. By June 1, 2006, the Discharger shall notify the Executive Officer of its continuous involvement with the comprehensive mercury investigation program currently being conducted by a group of Santa Ana River system Dischargers. If the Discharger discontinues its involvement with this comprehensive program, the Discharger shall, within 60 days of that date, submit for the approval of the Executive Officer its plan for the annual testing of mercury levels in fish flesh samples collected from the Santa Ana River, upstream of, at, and downstream of the point of the discharge point. Upon approval, the Discharger shall implement the plan.
- b. By June 1, 2006, the Discharger shall submit for approval by the Executive Officer, a report that details the manner in which sampling, monitoring and reporting will be performed as required in the Order.
- c. Toxicity Reduction Requirements.
If the implemented IITRE as specified in Section IV.A.2.d. fails to identify the cause of, or to rectify the toxicity, a Toxicity Reduction Evaluation (TRE) shall be conducted as defined in Attachment A. The Discharger shall take all reasonable steps to control toxicity once the source of toxicity is identified. Failure to conduct the required toxicity tests or a TRE within a designated period shall result in the establishment of effluent limitations for chronic toxicity under this Order and/or appropriate enforcement action.

3. Best Management Practices and Pollution Prevention

- a. Pollutant Minimization Program⁵
 - 1) The Discharger shall develop and conduct a Pollutant Minimization Program (PMP) as further described below when there is evidence (e.g., sample results reported as DNQ when the effluent limitation is less than the MDL, sample results from analytical methods more sensitive than those methods required by this Order, presence of whole effluent toxicity, health advisories for fish consumption, results of benthic or aquatic organism tissue sampling) that a priority pollutant is present in the effluent above an effluent limitation and either:
 - a) A sample result is reported as DNQ and the effluent limitation is less than the RL;
or
 - b) A sample result is reported as ND and the effluent limitation is less than the MDL.
 - 2) The PMP shall include, but not be limited to, the following actions and submittals acceptable to the Regional Water Board:

⁵ See Definition and required reporting protocols described in Attachment "A".

- a) An annual review and semi-annual monitoring of potential sources of the reportable priority pollutant(s), which may include fish tissue monitoring and other bio-uptake sampling;
- b) Quarterly monitoring for the reportable priority pollutant(s) in the influent to the wastewater treatment system;
- c) Submittal of a control strategy designed to proceed toward the goal of maintaining concentrations of the reportable priority pollutant(s) in the effluent at or below the effluent limitation;
- d) Implementation of appropriate cost-effective control measures for the reportable priority pollutant(s), consistent with the control strategy; and
- e) An annual status report that shall be sent to the Regional Water Board including:
 - (1) All PMP monitoring results for the previous year;
 - (2) A list of potential sources of the reportable priority pollutant(s);
 - (3) A summary of all actions undertaken pursuant to the control strategy; and
 - (4) A description of actions to be taken in the following year.

4. Construction, Operation and Maintenance Specifications

- a. The Discharger's wastewater treatment plant shall be supervised and operated by persons possessing certificates of appropriate grade pursuant to Title 23, Division 3, Chapter 14, California Code of Regulations.
- b. The Discharger shall provide safeguards to assure that should there be reduction, loss, or failure of electric power, the Discharger will comply with the requirements of this Order.
- c. The Discharger shall update as necessary, the "Operation and Maintenance Manual (O&M Manual)" which it has developed for the treatment facility to conform to latest plant changes and requirements. The O&M Manual shall be readily available to operating personnel onsite. The O&M Manual shall include the following:
 - 1) Description of the treatment plant table of organization showing the number of employees, duties and qualifications and plant attendance schedules (daily, weekends and holidays, part-time, etc). The description should include documentation that the personnel are knowledgeable and qualified to operate the treatment facility so as to achieve the required level of treatment at all times.
 - 2) Detailed description of safe and effective operation and maintenance of treatment processes, process control instrumentation and equipment.
 - 3) Description of laboratory and quality assurance procedures.
 - 4) Process and equipment inspection and maintenance schedules.
 - 5) Description of safeguards to assure that, should there be reduction, loss, or failure of electric power, the Discharger will be able to comply with requirements of this Order.

- 6) Description of preventive (fail-safe) and contingency (response and cleanup) plans for controlling accidental discharges, and for minimizing the effect of such events. These plans shall identify the possible sources (such as loading and storage areas, power outage, waste treatment unit failure, process equipment failure, tank and piping failure) of accidental discharges, untreated or partially treated waste bypass, and polluted drainage.

5. Special Provisions for Municipal Facilities (POTWs Only)

a. Sludge Disposal Requirements

- 1) Collected screenings, sludge, and other solids removed from liquid wastes shall be disposed of in a manner that is consistent with State Water Resources Control Board and Integrated Waste Management Board's joint regulations (Title 27) of the California Code of Regulations and approved by the Water Board's Executive Officer.
- 2) The use and disposal of biosolids shall comply with existing Federal and State laws and regulations, including permitting requirements and technical standards included in 40 CFR 503.
- 3) Any proposed change in biosolids use or disposal practice from a previously approved practice should be reported to the Executive Officer and EPA Regional Administrator at least 90 days in advance of the change.
- 4) The Discharger shall take all reasonable steps to minimize or prevent any discharge or biosolids use or disposal that has the potential of adversely affecting human health or the environment.

b. Oxidized and Filtered Wastewater Requirements: The Discharger shall submit a monthly report that validates that recycled water used for recharge is an oxidized and filtered wastewater. The report shall include:

- 1) Description of when, how often and whether coagulation of the wastewater is employed in the treatment process. If coagulation is not used at all times, the Discharger shall:
 - a) Continuously monitor the turbidity of the influent to the filters. Turbidity exceedances of 10 NTU or above at any time, and of 5 NTU for more than 15 minutes, shall be included in the monthly report;
 - b) Certify that chemical addition for coagulation has been automatically employed when the filter influent turbidity exceeds 5 NTU for more than 15 minutes.
- 2) Description of the type and rate of filtration employed in the treatment process.

c. Pretreatment Program

- 1) The Discharger shall update as necessary and implement an acceptable pretreatment program.

- 2) The Discharger shall update as necessary the appropriate contractual agreements with all governmental agencies⁶. The contractual agreements shall give the Discharger the authority to implement and enforce the EPA approved pretreatment program within the sewer service areas of the treatment facility. The Discharger shall assure that any other steps necessary to provide this implementation and enforcement authority (e.g. adoption of ordinances, etc.) are taken by all governmental agencies. If a governmental agency has an EPA approved pretreatment program for any portion of the service area of the treatment facility, the Discharger's pretreatment program shall contain provisions ensuring that that governmental agency's program is implemented. In the event that any agency discharging to Discharger's facility fails to effectively implement its individual EPA approved pretreatment program, the Discharger shall implement and enforce its approved program within that agency's service area.
- 3) The Discharger shall ensure that the POTW⁷ pretreatment program for all contributory agencies discharging to the Discharger's treatment facility are implemented and enforced. The Discharger shall be responsible and liable for the performance of all Control Authority pretreatment requirements contained in 40 CFR 403, including any subsequent regulatory revisions to Part 403. Where Part 403 or subsequent revisions place mandatory actions upon the Discharger as Control Authority but does not specify a timetable for completion of the actions, the Discharger shall submit for approval of the Regional Water Board's Executive Officer, a schedule for implementation of the required actions and shall implement the approved schedule. The schedule for implementation shall be submitted within six months from the date that such mandatory actions are established. For violations of pretreatment requirements, the Discharger shall be subject to enforcement actions, penalties, fines and other remedies by the EPA, or other appropriate parties, as provided in the CWA, as amended (33 USC 1351 et seq.). The EPA or the Regional Water Board may also initiate enforcement action against an industrial user (IU) for non-compliance with applicable standards and requirements as provided in the CWA.
- 4) The Discharger shall perform the pretreatment functions as required in 40 CFR Part 403 including, but not limited to:
 - a) Enforce the pretreatment requirements under 40 CFR 403.5 and 403.6;
 - b) Implement the necessary legal authorities as provided in 40 CFR 403.8(f)(1);
 - c) Implement the programmatic functions as provided in 40 CFR 403.8(f)(2);
 - d) Publish a list of significant non-compliance as required by 40 CFR 403.8(f)(2)(vii); and

⁶ Member agencies and sewerage agencies discharging wastewater into the facility.

⁷ Publicly owned treatment works.

- e) Provide the requisite funding and personnel to implement the pretreatment program as provided in 40 CFR 403.8(f)(3).
- 5) The following wastes shall not be introduced into the treatment works:
 - a) Wastes which create a fire or explosion hazard in the treatment works;
 - b) Wastes which will cause corrosive structural damage to treatment works, but, in no case, wastes with a pH lower than 5.0 unless the works are designed to accommodate such wastes;
 - c) Wastes at a flow rate and/or pollutant discharge rate which is excessive over relatively short time periods so that there is a treatment process upset and subsequent loss of treatment efficiency;
 - d) Solid or viscous wastes in amounts that would cause obstruction to the flow in sewers or otherwise interfere with the proper operation of the treatment works.
- 6) The Discharger shall ensure compliance with any existing or future pretreatment standard promulgated by EPA under Section 307 of the CWA or amendments thereto for any discharge to the municipal system.
- 7) The Discharger shall comply with effluent standards or prohibitions established under Section 307(a) of the CWA for toxic pollutants within the time provided in the regulations that establish these standards or prohibitions, even if this Order has not yet been modified to incorporate the requirement.
- 8) The Discharger shall require each user not in compliance with any pretreatment standard to submit periodic notice (over intervals not to exceed nine months) of progress toward compliance with applicable toxic and pretreatment standards developed pursuant to the CWA or amendments thereto. The Discharger shall forward a copy of such notice to the Regional Water Board and to the EPA Regional Administrator.

6. Other Special Provisions – Not Applicable

7. Compliance Schedules – Not Applicable

VII. COMPLIANCE DETERMINATION

Compliance with the effluent limitations contained in Section IV of this Order will be determined as specified below:

A. General.

Compliance with effluent limitations for priority pollutants shall be determined using sample reporting protocols defined in the MRP and Appendix A of this Order. For purposes of reporting and administrative enforcement by the Regional and State Water Boards, Dischargers shall be deemed out of compliance with effluent limitations if the concentration of the priority pollutant in the monitoring sample is greater than the effluent limitation and greater than or equal to the reporting level (RL).

B. Multiple Sample Data.

When determining compliance with an AMEL for priority pollutants and more than one sample result is available in a month, the Discharger shall compute the arithmetic mean unless the data set contains one or more reported determinations of "Detected, but Not Quantified" (DNQ) or "Not Detected" (ND). In those cases, the Discharger shall compute the median in place of the arithmetic mean in accordance with the following procedure:

1. The data set shall be ranked from low to high, ranking the reported ND determinations lowest, DNQ determinations next, followed by quantified values (if any). The order of the individual ND or DNQ determinations is unimportant.
2. The median value of the data set shall be determined. If the data set has an odd number of data points, then the median is the middle value. If the data set has an even number of data points, then the median is the average of the two values around the middle unless one or both of the points are ND or DNQ, in which case the median value shall be the lower of the two data points where DNQ is lower than a value and ND is lower than DNQ.

C. Average Monthly Effluent Limitation (AMEL).

If the average of daily discharges over a calendar month exceeds the AMEL for a given parameter, the Discharger will be considered out of compliance for each day of that month for that parameter (e.g., resulting in 31 days of non-compliance in a 31-day month). The average of daily discharges over the calendar month that exceeds the AMEL for a parameter will be considered out of compliance for that month only. If only a single sample is taken during the calendar month and the analytical result for that sample exceeds the AMEL, the Discharger will be considered out of compliance for that calendar month. For any one calendar month during which no sample (daily discharge) is taken, no compliance determination can be made for that calendar month.

D. Average Weekly Effluent Limitation (AWEL).

If the average of daily discharges over a calendar week exceeds the AWEL for a given parameter, the Discharger will be considered out of compliance for each day of that week for that parameter, resulting in 7 days of non-compliance. The average of daily discharges over the calendar week that exceeds the AWEL for a parameter will be considered out of compliance for that week only. If only a single sample is taken during the calendar week and the analytical result for that sample exceeds the AWEL, the Discharger will be considered out of compliance for that calendar week. For any one calendar week during which no sample (daily discharge) is taken, no compliance determination can be made for that calendar week.

E. Maximum Daily Effluent Limitation (MDEL).

If a daily discharge exceeds the MDEL for a given parameter, the Discharger will be considered out of compliance for that parameter for that 1 day only within the reporting period. For any 1 day during which no sample is taken, no compliance determination can be made for that day.

F. Instantaneous Minimum Effluent Limitation.

If the analytical result of a single grab sample is lower than the instantaneous minimum effluent limitation for a parameter, the Discharger will be considered out of compliance for that parameter for that single sample. Non-compliance for each sample will be considered separately (e.g., the results of two grab samples taken within a calendar day that both are lower than the instantaneous minimum effluent limitation would result in two instances of non-compliance with the instantaneous minimum effluent limitation).

G. Instantaneous Maximum Effluent Limitation.

If the analytical result of a single grab sample is higher than the instantaneous maximum effluent limitation for a parameter, the Discharger will be considered out of compliance for that parameter for that single sample. Non-compliance for each sample will be considered separately (e.g., the results of two grab samples taken within a calendar day that both exceed the instantaneous maximum effluent limitation would result in two instances of non-compliance with the instantaneous maximum effluent limitation).

H. 12-Month Running Average Effluent Limitation (12-MRAEL).

Compliance with the 12-month running average limit under Discharge Specification IV.A.1.c. and IV.A.1.d. shall be determined by the arithmetic mean of the last twelve monthly averages.

I. Total Chlorine Residual Limitation (TCR).

Compliance determinations for total chlorine residual shall be based on 99% compliance. To determine 99% compliance with the effluent limitation for total chlorine residual, the following conditions shall be satisfied:

1. For discharges of tertiary treat wastewater as specified in Section IV.A.1.a.:
 - a) The total time during which the total chlorine residual values are above 0.1 mg/l (instantaneous maximum value) shall not exceed 7 hours and 26 minutes in any calendar month;
 - b) No individual excursion from 0.1 mg/l value shall exceed 30 minutes; and
 - c) No individual excursion shall exceed 5.0 mg/l.

2. For discharges of secondary treated and disinfected wastewater with 20:1 dilution, as specified in Section IV.A.3.:
 - a) The total time during which the total chlorine residual values are above 2.1 mg/l instantaneous maximum value shall not exceed 7 hours and 26 minutes in any calendar month;
 - b) No individual excursion from or 2.1 mg/l value shall exceed 30 minutes; and
 - c) No individual excursion shall exceed 10.5 mg/l.

J. Turbidity Limitations.

If the Discharger is using a properly operating backup turbidimeter, the reading of the backup turbidimeter shall be considered in determining whether there has been an actual noncompliance:

1. There are no excursions above the limits specified in Discharge Specifications IV.A.1.e.(1)(a) and (b) and IV.C.1.e.(1)(a) and (b);
2. Exceedances of the "10 NTU at any time" turbidity requirement do not exceed a duration of one minute.
3. The apparent exceedance was caused by interference with, or malfunctions of, the monitoring instrument.

K. Coliform Organism Effluent Limitations.

1. Compliance with the running median total coliform limit expressed in Discharge Specification IV.A.1.e.2) and IV.C.1.b.2) shall be based on a median of test results from the previous 7 days. To comply with the limit, the 7-day median MPN must not exceed 2.2 per 100 milliliters on any day during the week. However, only one violation is recorded for each calendar week, even if the 7-day median MPN value is greater than 2.2 for more than one day in the week.
2. Compliance with the running median total coliform limit expressed in Discharge Specification IV.A.1.e.3), IV. A.3.b.1), and IV.C.1.b.3) shall be based on a median of test results from the previous 7 days. To comply with the limit, the 7-day median MPN must not exceed 23 per 100 milliliters on any day during the week. However, only one violation is recorded for each calendar week, even if the 7-day median MPN value is greater than 23 for more than one day in the week.

L. pH Effluent Limitations.

Pursuant to 40 CFR 401.17, the Discharger shall be in compliance with the pH limitations specified in the Discharge Specification IV.A.1.a, above, provided that both of the following conditions are satisfied:

1. The total time during which the pH values are outside the required range of 6.5-8.5 pH values shall not exceed 7 hours and 26 minutes in any calendar month; and
2. No individual excursion from the range of pH values shall exceed 60 minutes.

M. Priority Pollutants.

The Discharger shall be deemed out of compliance with an effluent limitation if the concentration of the priority pollutant in the monitoring sample is greater than the effluent limitation. Compliance determination shall be based on the reporting level selected from minimum level (ML)⁸ specified in Attachment "I" of this Order, unless an alternative reporting level is approved by the Regional Water Board's Executive Officer. When there is more than one ML value for a given substance, the Discharger shall select the ML value that is below the calculated effluent limitation, and use its associated analytical method, listed in Attachment "I" of this Order. If no ML value is below the effluent limitation, then the Regional Water Board will select as the reporting level the lowest ML value and its associated analytical method.

N. Non-Priority Pollutants.

The discharge shall be considered to be in compliance with an effluent limitation that is less than or equal to the PQL specified in Attachment H of this Order if the arithmetic mean of all test results for the monitoring period is less than the constituent effluent limitation. Analytical results that are less than the specified PQL shall be assigned a value of zero.

O. Compliance Determination

Compliance determinations shall be based on available analyses for the time interval associated with the effluent limitation. Where only one sample analysis is available in a specified time interval (e. g., monthly or weekly average), that sample shall serve to characterize the discharge for the entire interval. If quarterly sample results show noncompliance with the average monthly limit and that sample result is used for compliance determinations for each month of the quarter, then three separate violations of the average monthly limit shall be deemed to have occurred.

Compliance with a single effluent limitation which applies to a group of chemicals (e.g., PCBs), based on a single sample shall be determined by considering the concentrations of individual members of the group to be zero if the analytical response for the individual chemical falls below the method detection limit (MDL or PQL) for that chemical.

⁸

Minimum level is the concentration at which the entire analytical system must give a recognizable signal and acceptable point. The ML is the concentration in a sample that is equivalent to the concentration of the lowest calibration standard analyzed by a specific analytical procedure, assuming that all the method specified sample weights, volumes, and processing steps have been followed.

ATTACHMENT A – DEFINITIONS

Arithmetic Mean (μ), also called the average, is the sum of measured values divided by the number of samples. For ambient water concentrations, the arithmetic mean is calculated as follows:

Arithmetic mean = $\mu = \Sigma x / n$ where: Σx is the sum of the measured ambient water concentrations, and
 n is the number of samples.

Average Monthly Effluent Limitation (AMEL): the highest allowable average of daily discharges over a calendar month, calculated as the sum of all daily discharges measured during a calendar month divided by the number of daily discharges measured during that month.

Average Weekly Effluent Limitation (AWEL): the highest allowable average of daily discharges over a calendar week (Sunday through Saturday), calculated as the sum of all daily discharges measured during a calendar week divided by the number of daily discharges measured during that week.

Best Management Practices (BMPs) are methods, measures, or practices designed and selected to reduce or eliminate the discharge of pollutants to surface waters from point and nonpoint source discharges including storm water. BMPs include structural and non-structural controls, and operation and maintenance procedures, which can be applied before, during, and/or after pollution producing activities.

Bioaccumulative pollutants are those substances taken up by an organism from its surrounding medium through gill membranes, epithelial tissue, or from food and subsequently concentrated and retained in the body of the organism.

Carcinogenic pollutants are substances that are known to cause cancer in living organisms.

Coefficient of Variation (CV) is a measure of the data variability and is calculated as the estimated standard deviation divided by the arithmetic mean of the observed values.

Criteria Continuous Concentration (CCC) equals the highest concentration of a pollutant to which aquatic life can be exposed for an extended period of time (4 days) without deleterious effects.

Criteria Maximum Concentration (CMC) equals the highest concentration of a pollutant to which aquatic life can be exposed for a short period of time without deleterious effects.

Daily Discharge: Daily Discharge is defined as either: (1) the total mass of the constituent discharged over the calendar day (12:00 am through 11:59 pm) or any 24-hour period that reasonably represents a calendar day for purposes of sampling (as specified in the permit), for a constituent with limitations expressed in units of mass or; (2) the unweighted arithmetic mean measurement of the constituent over the day for a constituent with limitations expressed in other units of measurement (e.g., concentration).

The daily discharge may be determined by the analytical results of a composite sample taken over the course of one day (a calendar day or other 24-hour period defined as a day) or by the arithmetic mean of analytical results from one or more grab samples taken over the course of the day.

Detected, but Not Quantified (DNQ) are those sample results less than the RL, but greater than or equal to the laboratory's MDL.

Dilution Credit is the amount of dilution granted to a discharge in the calculation of a water quality-based effluent limitation, based on the allowance of a specified mixing zone. It is calculated from the dilution ratio or determined through conducting a mixing zone study or modeling of the discharge and receiving water.

Dilution Ratio is the critical low flow of the upstream receiving water divided by the flow of the effluent discharged.

Effluent Concentration Allowance (ECA) is a value derived from the water quality criterion/objective, dilution credit, and ambient background concentration that is used, in conjunction with the coefficient of variation for the effluent monitoring data, to calculate a long-term average (LTA) discharge concentration. The ECA has the same meaning as waste load allocation (WLA) as used in U.S. EPA guidance (Technical Support Document For Water Quality-based Toxics Control, March 1991, second printing, EPA/505/2-90-001).

Estimated Chemical Concentration is the estimated chemical concentration that results from the confirmed detection of the substance by the analytical method below the ML value.

Existing Discharger means any discharger that is not a new discharger. An existing discharger includes an "increasing discharger" (i.e., an existing facility with treatment systems in place for its current discharge that is or will be expanding, upgrading, or modifying its existing permitted discharge after the effective date of this Policy).

Infeasible means not capable of being accomplished in a successful manner within a reasonable period of time, taking into account economic, environmental, legal, social, and technological factors.

Inland Surface Waters are all surface waters of the State that do not include the ocean, enclosed bays, or estuaries.

Instantaneous Maximum Effluent Limitation: the highest allowable value for any single grab sample or aliquot (i.e., each grab sample or aliquot is independently compared to the instantaneous maximum limitation).

Instantaneous Minimum Effluent Limitation: the lowest allowable value for any single grab sample or aliquot (i.e., each grab sample or aliquot is independently compared to the instantaneous minimum limitation).

Load Allocation (LA) is the portion of receiving water's total maximum daily load that is allocated to one of its nonpoint sources of pollution or to natural background sources.

Maximum Daily Effluent Limitation (MDEL) means the highest allowable daily discharge of a pollutant, over a calendar day (or 24-hour period). For pollutants with limitations expressed in units of mass, the daily discharge is calculated as the total mass of the pollutant discharged over the day. For pollutants with limitations expressed in other units of measurement, the daily discharge is calculated as the arithmetic mean measurement of the pollutant over the day.

MEC: Maximum Effluent Concentration.

Median is the middle measurement in a set of data. The median of a set of data is found by first arranging the measurements in order of magnitude (either increasing or decreasing order). If the number of measurements (n) is odd, then the median = $X_{(n+1)/2}$. If n is even, then the median = $(X_{n/2} + X_{(n/2)+1})/2$ (i.e., the midpoint between the $n/2$ and $n/2+1$).

Method Detection Limit (MDL) is the minimum concentration of a substance that can be measured and reported with 99 percent confidence that the analyte concentration is greater than zero, as defined in 40 CFR 136, Appendix B, revised as of May 14, 1999.

Minimum Level (ML) is the concentration at which the entire analytical system must give a recognizable signal and acceptable calibration point. The ML is the concentration in a sample that is equivalent to the concentration of the lowest calibration standard analyzed by a specific analytical procedure, assuming that all the method specified sample weights, volumes, and processing steps have been followed.

Mixing Zone is a limited volume of receiving water that is allocated for mixing with a wastewater discharge where water quality criteria can be exceeded without causing adverse effects to the overall water body.

New Discharger includes any building, structure, facility, or installation from which there is, or may be, a discharge of pollutants, the construction of which commenced after the effective date of this Policy.

Not Detected (ND) are those sample results less than the laboratory's MDL.

Objectionable Bottom Deposits are an accumulation of materials or substances on or near the bottom of a water body, which creates conditions that adversely impact aquatic life, human health, beneficial uses, or aesthetics. These conditions include, but are not limited to, the accumulation of pollutants in the sediments and other conditions that result in harm to benthic organisms, production of food chain organisms, or fish egg development. The presence of such deposits shall be determined by RWQCB(s) on a case-by-case basis.

Persistent pollutants are substances for which degradation or decomposition in the environment is nonexistent or very slow.

Pollutant Minimization Program (PMP) means waste minimization and pollution prevention actions that include, but are not limited to, product substitution, waste stream recycling, alternative waste management methods, and education of the public and businesses. The goal of the PMP shall be to reduce all potential sources of a priority pollutant(s) through pollutant minimization (control) strategies, including pollution prevention measures as appropriate, to maintain the effluent concentration at or below the water quality-based effluent limitation. Pollution prevention measures may be particularly appropriate for persistent bioaccumulative priority pollutants where there is evidence that beneficial uses are being impacted. The Regional Water Board may consider cost-effectiveness when establishing the requirements of a PMP. The completion and implementation of a Pollution Prevention Plan, if required pursuant to CWC Section 13263.3(d), shall be considered to fulfill the PMP requirements. The following reporting protocols and definitions are used in determining the need to conduct a Pollution Minimization Program (PMP). Reporting protocols in the Monitoring and Reporting Program, Attachment E, Section X.B.4 describe sample results that are to be reported as Detected but Not Quantified (DNQ) or Not Detected (ND). Definitions for a Minimum Level (ML) and Method Detection Limit (MDL) are provided in Attachment A. A Reporting Level (RL) is the ML associated with an analytical method selected by the Discharger that is authorized for monitoring effluent limitations under this Order.

Pollution Prevention means any action that causes a net reduction in the use or generation of a hazardous substance or other pollutant that is discharged into water and includes, but is not limited to, input change, operational improvement, production process change, and product reformulation (as defined in Water Code Section 13263.3). Pollution prevention does not include actions that merely shift a pollutant in wastewater from one environmental medium to another environmental medium, unless clear environmental benefits of such an approach are identified to the satisfaction of the SWRCB or RWQCB.

Process Optimization means minor changes to the existing facility and treatment plant operations that optimize the effectiveness of the existing treatment processes.

Public Entity includes the federal government or a state, county, city and county, city, district, public authority, or public agency.

Reporting Level (RL) is the ML corresponding to an approved analytical method for reporting a sample result that is selected either from Appendix 4 of the SIP by the Regional Water Board in accordance with Section 2.4.2 of the SIP or established in accordance with Section 2.4.3 of the SIP. The ML is based on the proper application of method-based analytical procedures for sample preparation and the absence of any matrix interferences. Other factors may be applied to the ML depending on the specific sample preparation steps employed. For example, the treatment typically applied in cases where there are matrix-effects is to dilute the sample or sample aliquot by a factor of ten. In such cases, this additional factor must be applied to the ML in the computation of the RL.

Source of Drinking Water is any water designated as municipal or domestic supply (MUN) in a RWQCB basin plan.

Standard Deviation (σ) is a measure of variability that is calculated as follows:

$$\sigma = \left(\frac{\sum[(x - \mu)^2]}{n - 1} \right)^{0.5}$$

where:

x is the observed value;

μ is the arithmetic mean of the observed values; and

n is the number of samples.


Toxicity Reduction Evaluation (TRE) is a study conducted in a step-wise process designed to identify the causative agents of effluent or ambient toxicity, isolate the sources of toxicity, evaluate the effectiveness of toxicity control options, and then confirm the reduction in toxicity. The first steps of the TRE consist of the collection of data relevant to the toxicity, including additional toxicity testing, and an evaluation of facility operations and maintenance practices, and best management practices. A Toxicity Identification Evaluation (TIE) may be required as part of the TRE, if appropriate. (A TIE is a set of procedures to identify the specific chemical(s) responsible for toxicity. These procedures are performed in three phases (characterization, identification, and confirmation) using aquatic organism toxicity tests.)

Use Attainability Analysis is a structured scientific assessment of the factors affecting the attainment of the use which may include physical, chemical, biological and economic factors as described in 40 CFR 131.10(g) (40 CFR 131.3, revised as of July 1, 1997).


Water Effect Ratio (WER) is an appropriate measure of the toxicity of a material obtained in a site water divided by the same measure of the toxicity of the same material obtained simultaneously in a laboratory dilution water.

12-Month Running Average Effluent Limitation (12-MRAEL): the highest allowable average of monthly discharges over last twelve months, calculated as the sum of all monthly discharges measured during last twelve months divided by the number of monthly discharges measured during that time period.


ATTACHMENT B – PLANT LOCATION MAP

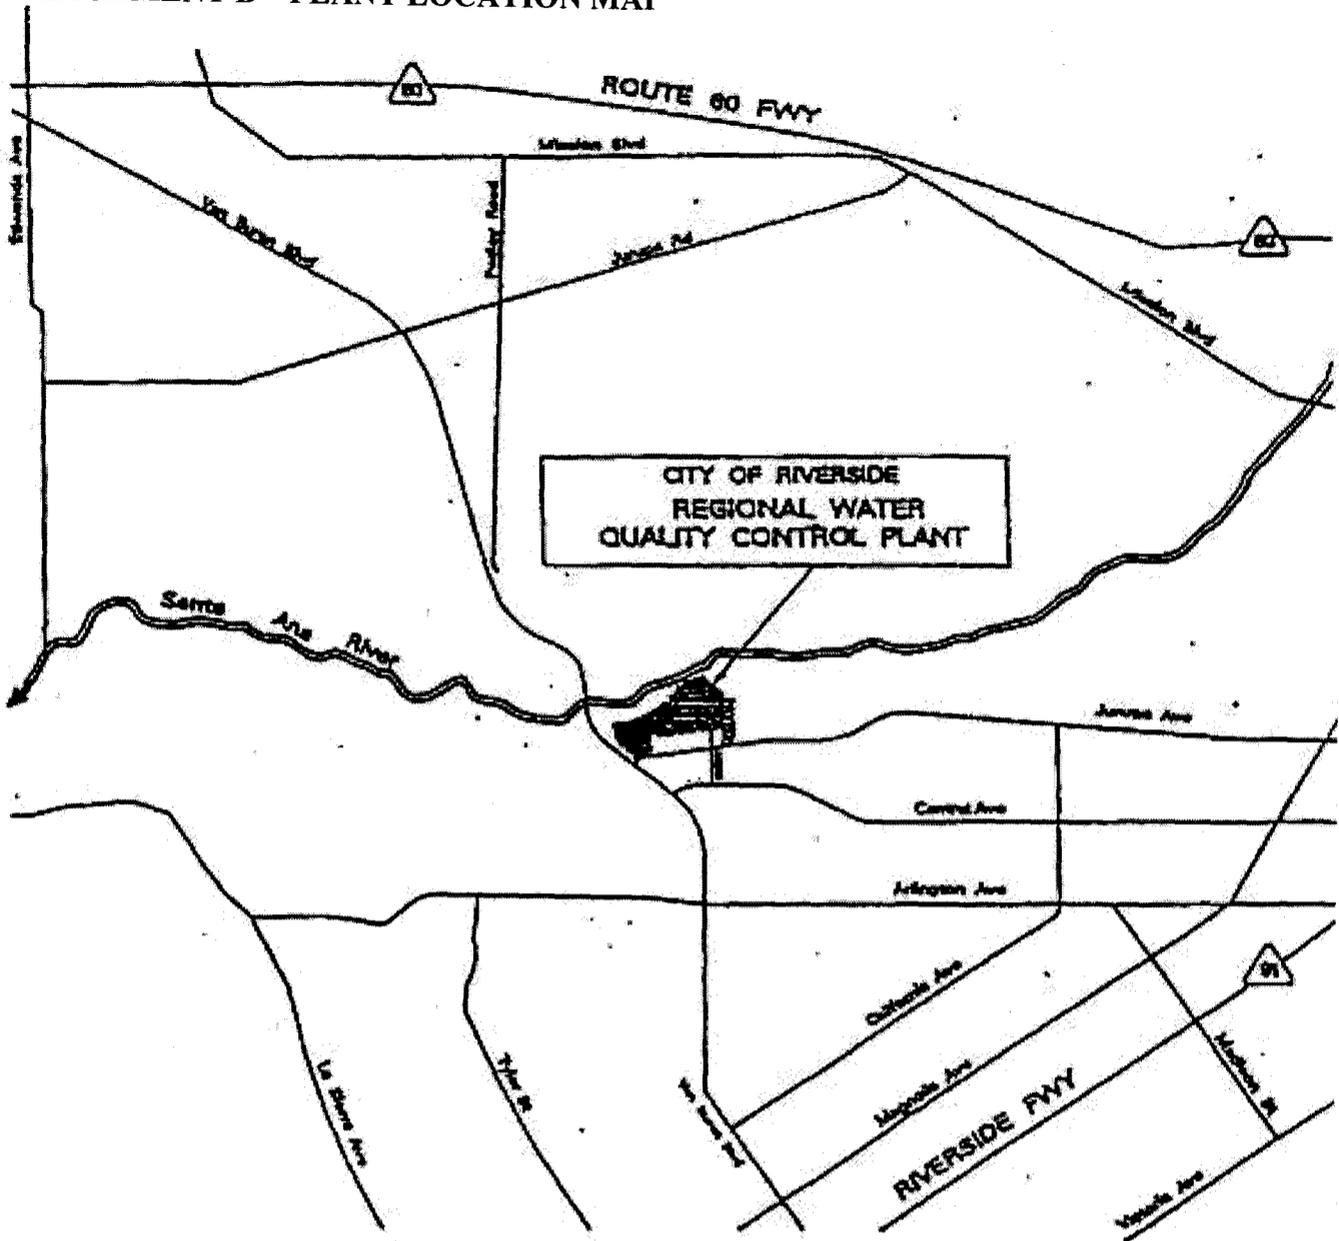

**CITY OF RIVERSIDE
REGIONAL WATER
QUALITY CONTROL PLANT
VICINITY MAP**

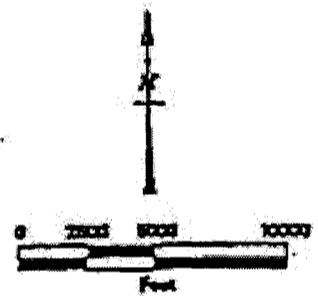

WETLANDS LOCATION MAP

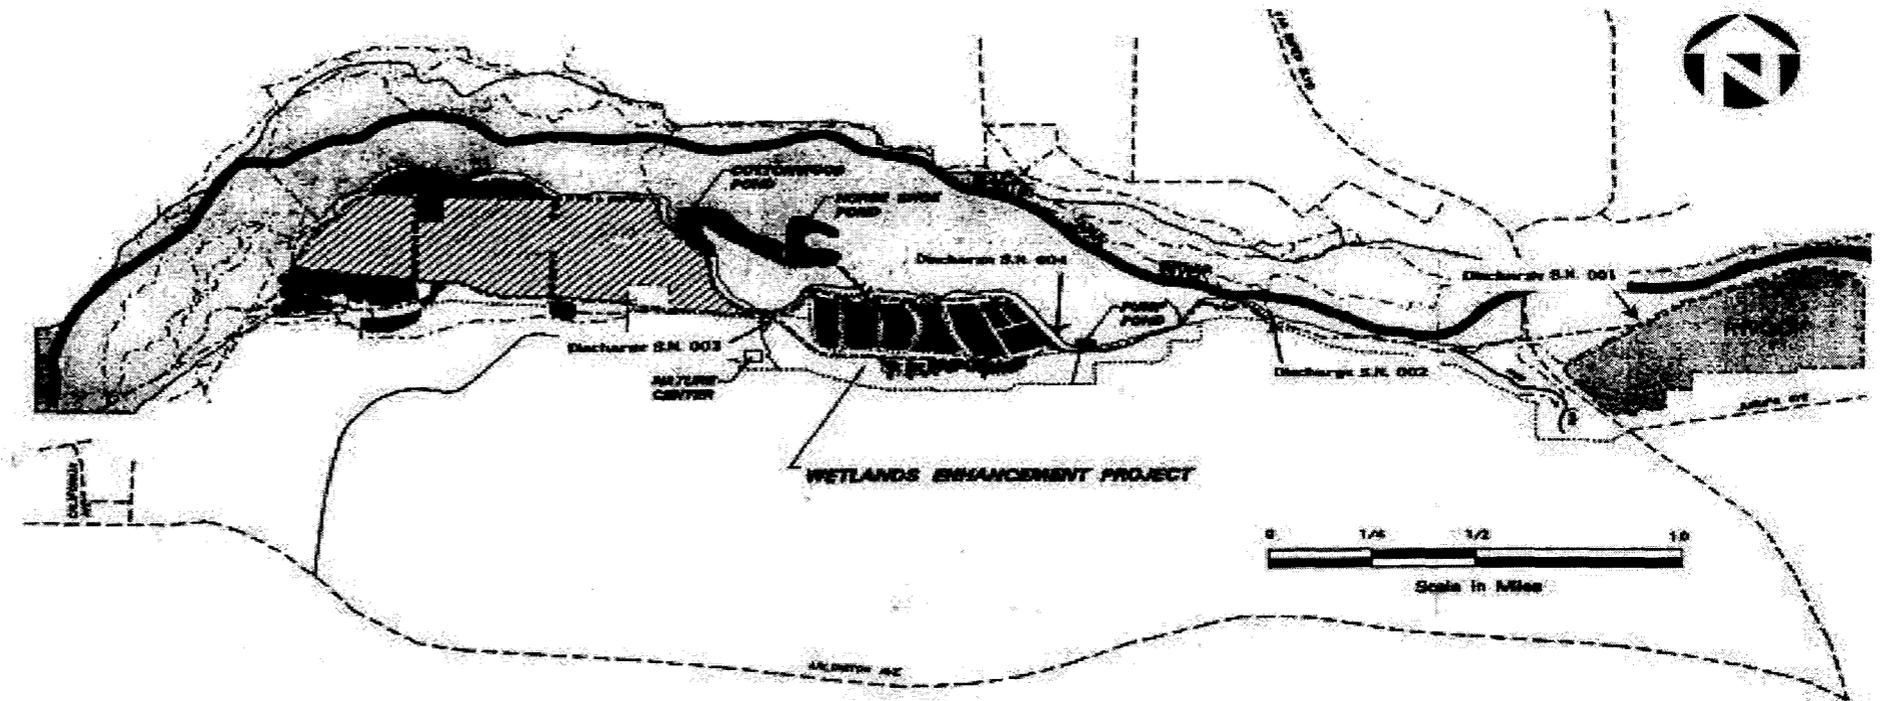


LEGEND

	DRAGED ROADS IN MICHON VALLEY		SANTA ANA RIVER
	PAVED STREETS		WETLANDS
	MAINTENANCE ROADS		WETLANDS POND NO.
	HORSE AND HIGH TRAILS		MOBILE/AVIATION VEHICLE ACCESS POINT
	CHANNELS		EXISTING PONDS
	AGRICULTURE COVERED AREA		AGRICULTURE AREAS

Location Map

ATTACHMENT C – FLOW SCHEMATIC

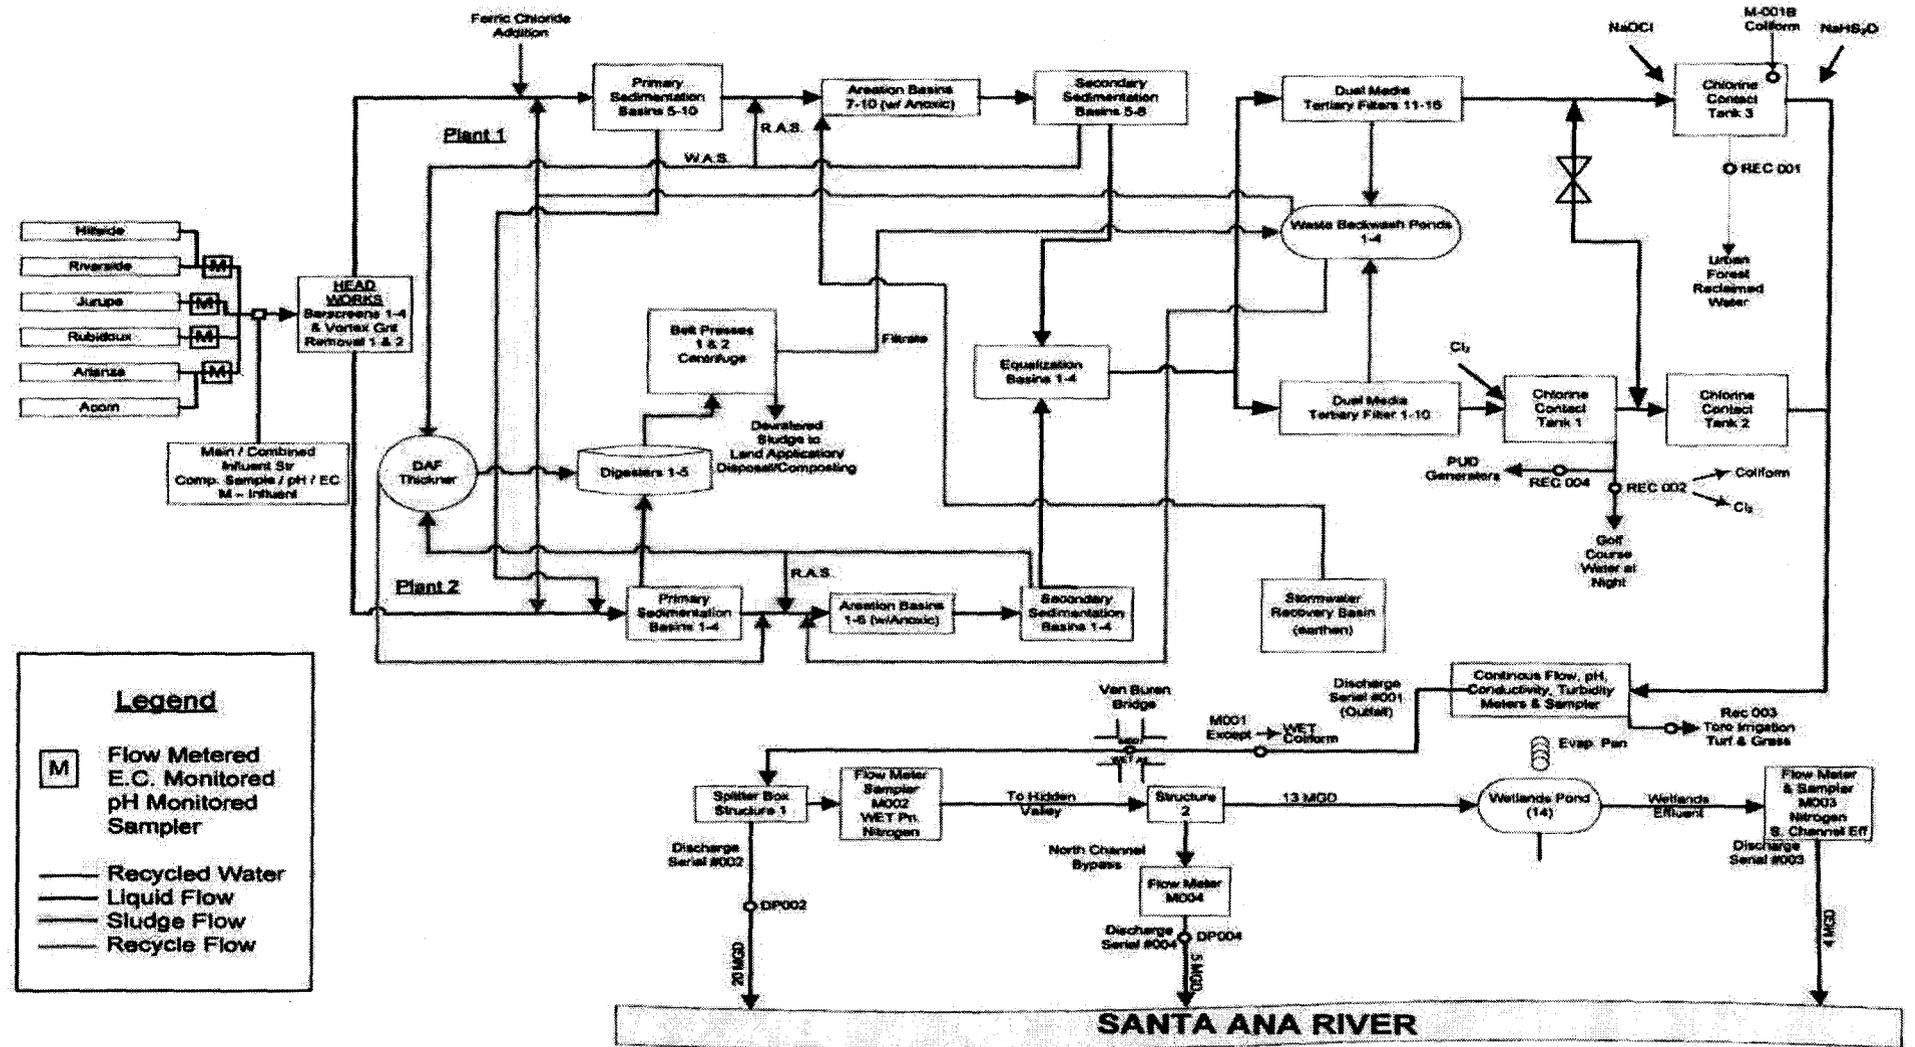

ATTACHMENT D – STANDARD PROVISIONS

I. STANDARD PROVISIONS – PERMIT COMPLIANCE

A. Duty to Comply

1. The Discharger must comply with all of the conditions of this Order. Any noncompliance constitutes a violation of the Clean Water Act (CWA) and the California Water Code (CWC) and is grounds for enforcement action, for permit termination, revocation and reissuance, or modification; or denial of a permit renewal application [40 CFR §122.41(a)].
2. The Discharger shall comply with effluent standards or prohibitions established under Section 307(a) of the CWA for toxic pollutants and with standards for sewage sludge use or disposal established under Section 405(d) of the CWA within the time provided in the regulations that establish these standards or prohibitions, even if this Order has not yet been modified to incorporate the requirement [40 CFR §122.41(a)(1)].

B. Need to Halt or Reduce Activity Not a Defense

It shall not be a defense for a Discharger in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this Order [40 CFR §122.41(c)].

C. Duty to Mitigate

The Discharger shall take all reasonable steps to minimize or prevent any discharge or sludge use or disposal in violation of this Order that has a reasonable likelihood of adversely affecting human health or the environment [40 CFR §122.41(d)].

D. Proper Operation and Maintenance

The Discharger shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed or used by the Discharger to achieve compliance with the conditions of this Order. Proper operation and maintenance also includes adequate laboratory controls and appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities or similar systems that are installed by a Discharger only when necessary to achieve compliance with the conditions of this Order [40 CFR §122.41(e)].

E. Property Rights

1. This Order does not convey any property rights of any sort or any exclusive privileges [40 CFR §122.41(g)].
2. The issuance of this Order does not authorize any injury to persons or property or invasion of other private rights, or any infringement of State or local law or regulations [40 CFR §122.5(c)].

F. Inspection and Entry

The Discharger shall allow the Regional Water Quality Control Board (RWQCB), State Water Resources Control Board (SWRCB), United States Environmental Protection Agency (USEPA), and/or their authorized representatives (including an authorized contractor acting as their representative), upon the presentation of credentials and other documents, as may be required by law, to [40 CFR §122.41(i)] [CWC 13383(c)]:

1. Enter upon the Discharger's premises where a regulated facility or activity is located or conducted, or where records are kept under the conditions of this Order [40 CFR §122.41(i)(1)];
2. Have access to and copy, at reasonable times, any records that must be kept under the conditions of this Order [40 CFR §122.41(i)(2)];
3. Inspect and photograph, at reasonable times, any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under this Order [40 CFR §122.41(i)(3)];
4. Sample or monitor, at reasonable times, for the purposes of assuring Order compliance or as otherwise authorized by the CWA or the CWC, any substances or parameters at any location [40 CFR §122.41(i)(4)].

G. Bypass

1. Definitions
 - a. "Bypass" means the intentional diversion of waste streams from any portion of a treatment facility [40 CFR §122.41(m)(1)(i)].
 - b. "Severe property damage" means substantial physical damage to property, damage to the treatment facilities, which causes them to become inoperable, or substantial and permanent loss of natural resources that can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production [40 CFR §122.41(m)(1)(ii)].
2. Bypass not exceeding limitations – The Discharger may allow any bypass to occur which does not cause exceedances of effluent limitations, but only if it is for essential maintenance to assure efficient operation. These bypasses are not subject to the provisions listed in Standard Provisions – Permit Compliance I.G.3, I.G.4, and I.G.5 below [40 CFR §122.41(m)(2)].
3. Prohibition of bypass – Bypass is prohibited, and the Regional Water Board may take enforcement action against a Discharger for bypass, unless [40 CFR §122.41(m)(4)(i)]:

- a. Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage [40 CFR §122.41(m)(4)(A)];
 - b. There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass that occurred during normal periods of equipment downtime or preventive maintenance [40 CFR §122.41(m)(4)(B)]; and
 - c. The Discharger submitted notice to the Regional Water Board as required under Standard Provisions – Permit Compliance I.G.5 below [40 CFR §122.41(m)(4)(C)].
4. The Regional Water Board may approve an anticipated bypass, after considering its adverse effects, if the Regional Water Board determines that it will meet the three conditions listed in Standard Provisions – Permit Compliance I.G.3 above [40 CFR §122.41(m)(4)(ii)].
5. Notice
- a. Anticipated bypass. If the Discharger knows in advance of the need for a bypass, it shall submit a notice, if possible at least 10 days before the date of the bypass [40 CFR §122.41(m)(3)(i)].
 - b. Unanticipated bypass. The Discharger shall submit notice of an unanticipated bypass as required in Standard Provisions - Reporting V.E below (24-hour notice) [40 CFR Section 122.41(m)(3)(ii)].

H. Upset

Upset means an exceptional incident in which there is unintentional and temporary noncompliance with technology based permit effluent limitations because of factors beyond the reasonable control of the permittee. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation [40 CFR §122.41(n)(1)].

1. Effect of an upset. An upset constitutes an affirmative defense to an action brought for noncompliance with such technology based permit effluent limitations if the requirements of Standard Provisions – Permit Compliance I.H.2 below are met. No determination made during administrative review of claims that noncompliance was caused by upset, and before an action for noncompliance, is final administrative action subject to judicial review [40 CFR Section 122.41(n)(2)].
2. Conditions necessary for a demonstration of upset. A Discharger who wishes to establish the affirmative defense of upset shall demonstrate, through properly signed, contemporaneous operating logs or other relevant evidence that [40 CFR §122.41(n)(3)]:

- a. An upset occurred and that the Discharger can identify the cause(s) of the upset [40 CFR §122.41(n)(3)(i)];
 - b. The permitted facility was, at the time, being properly operated [40 CFR §122.41(n)(3)(i)];
 - c. The Discharger submitted notice of the upset as required in Standard Provisions – Reporting V.E.2.b below (24-hour notice) [40 CFR Section 122.41(n)(3)(iii)]; and
 - d. The Discharger complied with any remedial measures required under Standard Provisions – Permit Compliance I.C above [40 CFR §122.41(n)(3)(iv)].
3. Burden of proof. In any enforcement proceeding, the Discharger seeking to establish the occurrence of an upset has the burden of proof [40 CFR §122.41(n)(4)].

II. STANDARD PROVISIONS – PERMIT ACTION

A. General

This Order may be modified, revoked and reissued, or terminated for cause. The filing of a request by the Discharger for modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance does not stay any Order condition [40 CFR §122.41(f)].

B. Duty to Reapply

If the Discharger wishes to continue an activity regulated by this Order after the expiration date of this Order, the Discharger must apply for and obtain a new permit [40 CFR §122.41(b)].

C. Transfers

This Order is not transferable to any person except after notice to the Regional Water Board. The Regional Water Board may require modification or revocation and reissuance of the Order to change the name of the Discharger and incorporate such other requirements as may be necessary under the CWA and the CWC [40 CFR §122.41(l)(3)] [40 CFR §122.61].

III. STANDARD PROVISIONS – MONITORING

- A. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity [40 CFR §122.41(j)(1)].
- B. Monitoring results must be conducted according to test procedures under 40 CFR Part 136 or, in the case of sludge use or disposal, approved under 40 CFR Part 136 unless otherwise specified in 40 CFR Part 503 unless other test procedures have been specified in this Order [40 CFR §122.41(j)(4)] [40 CFR §122.44(i)(1)(iv)].

IV. STANDARD PROVISIONS – RECORDS

A. Except for records of monitoring information required by this Order related to the Discharger's sewage sludge use and disposal activities, which shall be retained for a period of at least five years (or longer as required by 40 CFR Part 503), the Discharger shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by this Order, and records of all data used to complete the application for this Order, for a period of at least three (3) years from the date of the sample, measurement, report or application. This period may be extended by request of the Regional Water Board Executive Officer at any time [40 CFR §122.41(j)(2)].

B. Records of monitoring information shall include:

1. The date, exact place, and time of sampling or measurements [40 CFR §122.41(j)(3)(i)];
2. The individual(s) who performed the sampling or measurements [40 CFR §122.41(j)(3)(ii)];
3. The date(s) analyses were performed [40 CFR §122.41(j)(3)(iii)];
4. The individual(s) who performed the analyses [40 CFR §122.41(j)(3)(iv)];
5. The analytical techniques or methods used [40 CFR §122.41(j)(3)(v)]; and
6. The results of such analyses [40 CFR §122.41(j)(3)(vi)].

C. Claims of confidentiality for the following information will be denied [40 CFR §122.7(b)]:

1. The name and address of any permit applicant or Discharger [40 CFR §122.7(b)(1)]; and
2. Permit applications and attachments, permits and effluent data [40 CFR §122.7(b)(2)].

V. STANDARD PROVISIONS – REPORTING

A. Duty to Provide Information

The Discharger shall furnish to the Regional Water Board, SWRCB, or USEPA within a reasonable time, any information which the Regional Water Board, SWRCB, or USEPA may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this Order or to determine compliance with this Order. Upon request, the Discharger shall also furnish to the Regional Water Board, SWRCB, or USEPA copies of records required to be kept by this Order [40 CFR §122.41(h)] [CWC 13267].

B. Signatory and Certification Requirements

1. All applications, reports, or information submitted to the Regional Water Board, State Water Board, and/or USEPA shall be signed and certified in accordance with Standard Provisions – Reporting V.B.2, V.B.3, V.B.4, and V.B.5 below [40 CFR Section 122.41(k)].
2. All permit applications shall be signed by either a principal executive officer or ranking elected official. For purposes of this provision, a principal executive officer of a federal agency includes: (i) the chief executive officer of the agency, or (ii) a senior executive officer having responsibility for the overall operations of a principal geographic unit of the agency (e.g., Regional Administrators of USEPA) [40 CFR Section 122.22(a)(3)].
3. All reports required by this Order and other information requested by the Regional Water Board, State Water Board, or USEPA shall be signed by a person described in Standard Provisions – Reporting V.B.2 above, or by a duly authorized representative of that person. A person is a duly authorized representative only if:
 - a. The authorization is made in writing by a person described in Standard Provisions – Reporting V.B.2 above [40 CFR Section 122.22(b)(1)];
 - b. The authorization specified either an individual or a position having responsibility for the overall operation of the regulated facility or activity such as the position of plant manager, operator of a well or a well field, superintendent, position of equivalent responsibility, or an individual or position having overall responsibility for environmental matters for the company (a duly authorized representative may thus be either a named individual or any individual occupying a named position) [40 CFR Section 122.22(b)(2)]; and
 - c. The written authorization is submitted to the Regional Water Board, State Water Board, or USEPA [40 CFR Section 122.22(b)(3)].
4. If an authorization under Standard Provisions – Reporting V.B.3 above is no longer accurate because a different individual or position has responsibility for the overall operation of the facility, a new authorization satisfying the requirements of Standard Provisions – Reporting V.B.3 above must be submitted to the Regional Water Board, State Water Board or USEPA prior to or together with any reports, information, or applications, to be signed by an authorized representative [40 CFR Section 122.22(c)].
5. Any person signing a document under Standard Provisions – Reporting V.B.2 or V.B.3 above shall make the following certification:

“I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and

belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations” [40 CFR Section 122.22(d)].

C. Monitoring Reports

1. Monitoring results shall be reported at the intervals specified in the Monitoring and Reporting Program in this Order [40 CFR §122.41(l)(4)].
2. Monitoring results must be reported on a Discharge Monitoring Report (DMR) form or forms provided or specified by the Regional Water Board or SWRCB for reporting results of monitoring of sludge use or disposal practices [40 CFR §122.41(l)(4)(i)].
3. If the Discharger monitors any pollutant more frequently than required by this Order using test procedures approved under 40 CFR Part 136 or, in the case of sludge use or disposal, approved under 40 CFR Part 136 unless otherwise specified in 40 CFR Part 503, or as specified in this Order, the results of this monitoring shall be included in the calculation and reporting of the data submitted in the DMR or sludge reporting form specified by the Regional Water Board [40 CFR §122.41(l)(4)(ii)].
4. Calculations for all limitations, which require averaging of measurements, shall utilize an arithmetic mean unless otherwise specified in this Order [40 CFR §122.41(l)(4)(iii)].

D. Compliance Schedules

Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of this Order, shall be submitted no later than 14 days following each schedule date [40 CFR §122.41(l)(5)].

E. Twenty-Four Hour Reporting

1. The Discharger shall report any noncompliance that may endanger health or the environment. Any information shall be provided orally within 24 hours from the time the Discharger becomes aware of the circumstances. A written submission shall also be provided within five (5) days of the time the Discharger becomes aware of the circumstances. The written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance [40 CFR §122.41(l)(6)(i)].
2. The following shall be included as information that must be reported within 24 hours under this paragraph [40 CFR §122.41(l)(6)(ii)]:
 - a. Any unanticipated bypass that exceeds any effluent limitation in this Order [40 CFR §122.41(l)(6)(ii)(A)].

- b. Any upset that exceeds any effluent limitation in this Order [40 CFR §122.41(l)(6)(ii)(B)].
3. The Regional Water Board may waive the above-required written report under this provision on a case-by-case basis if an oral report has been received within 24 hours [40 CFR §122.41(l)(6)(iii)].

F. Planned Changes

The Discharger shall give notice to the Regional Water Board as soon as possible of any planned physical alterations or additions to the permitted facility. Notice is required under this provision only when [40 CFR §122.41(l)(1)]:

1. The alteration or addition to a permitted facility may meet one of the criteria for determining whether a facility is a new source in 40 CFR §122.29(b) [40 CFR §122.41(l)(1)(i)]; or
2. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants which are subject neither to effluent limitations in this Order nor to notification requirements under 40 CFR Part 122.42(a)(1) (see Additional Provisions—Notification Levels VII.A.1) [40 CFR §122.41(l)(1)(ii)].
3. The alteration or addition results in a significant change in the Discharger's sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use or disposal sites not reported during the permit application process or not reported pursuant to an approved land application plan [40 CFR §122.41(l)(1)(iii)].

G. Anticipated Noncompliance

The Discharger shall give advance notice to the Regional Water Board or SWRCB of any planned changes in the permitted facility or activity that may result in noncompliance with General Order requirements [40 CFR §122.41(l)(2)].

H. Other Noncompliance

The Discharger shall report all instances of noncompliance not reported under Standard Provisions – Reporting V.C, V.D, and V.E above at the time monitoring reports are submitted. The reports shall contain the information listed in Standard Provision – Reporting V.E above [40 CFR Section 122.41(l)(7)].

I. Other Information

When the Discharger becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to the

Regional Water Board, SWRCB, or USEPA, the Discharger shall promptly submit such facts or information [40 CFR §122.41(l)(8)].

VI. STANDARD PROVISIONS – ENFORCEMENT

- A. The Regional Water Board is authorized to enforce the terms of this permit under several provisions of the CWC, including, but not limited to, Sections 13385, 13386, and 13387.

VII. ADDITIONAL PROVISIONS – NOTIFICATION LEVELS

A. Publicly-Owned Treatment Works (POTWs)

All POTWs shall provide adequate notice to the Regional Water Board of the following [40 CFR Section 122.42(b)]:

1. Any new introduction of pollutants into the POTW from an indirect discharger that would be subject to Sections 301 or 306 of the CWA if it were directly discharging those pollutants [40 CFR Section 122.42(b)(1)]; and
2. Any substantial change in the volume or character of pollutants being introduced into that POTW by a source introducing pollutants into the POTW at the time of adoption of the Order [40 CFR Section 122.42(b)(2)].
3. Adequate notice shall include information on the quality and quantity of effluent introduced into the POTW as well as any anticipated impact of the change on the quantity or quality of effluent to be discharged from the POTW [40 CFR Section 122.42(b)(3)].

Attachment E – Monitoring and Reporting Program

Table of Contents

Attachment E – Monitoring and Reporting Program (MRP) 2

I. General Monitoring Provisions 2

 A. General Monitoring Provision..... 2

 B. Minimum Level (ML) Requirements 5

II. Monitoring Locations 5

III. Influent Monitoring Requirements 6

 A. Monitoring Locations at M-INFA through M-INFD 6

IV. Effluent Monitoring Requirements 7

 A. Tertiary Effluent Monitoring Locations M-001A and M-001B 8

 B. Tertiary Effluent Monitoring Locations M-002 and M-004 10

 C. Tertiary Effluent Monitoring Locations M-003 10

 D. Secondary Effluent Monitoring Locations M-001A and M-001B with 20:1 Dilution 11

V. Whole Effluent Toxicity Testing Requirements..... 12

 A. Toxicity Monitoring Requirements at M-001A 12

VI. Land Discharge Monitoring Requirements – Not Applicable..... 14

VII. Reclamation Monitoring Requirements 14

 A. Monitoring Locations REC-001, REC-002, REC-003and REC-004..... 14

 B. Monitoring Location M-001A..... 14

 C. Monitoring Users..... 15

VIII. Receiving Water Monitoring Requirements – Surface Water and Groundwater..... 15

 A. Monitoring Location R-001U for Surface Water 15

 B. Monitoring Location R-001D for Surface Water: 16

 C. Monitoring Location R-002 for Surface Water: 16

 D. Groundwater-Not Applicable 16

IX. Other Monitoring Requirements..... 17

 A. Biosolids Monitoring at B-001 17

 B. Water Supply Monitoring:..... 17

 C. Pretreatment Monitoring and Reporting: 17

X. Reporting Requirements 20

 A. General Monitoring and Reporting Requirements 20

 B. Self Monitoring Reports (SMRs) 22

 C. Discharge Monitoring Reports (DMRs)..... 25

 D. Other Reports – Not Applicable 25

ATTACHMENT E – MONITORING AND REPORTING PROGRAM (MRP)

The Code of Federal Regulations (CFR) at 40 CFR §122.48 requires that all NPDES permits specify monitoring and reporting requirements. CWC sections 13267 and 13383 also authorize the Regional Water Quality Control Board (RWQCB) to require technical and monitoring reports. This MRP establishes monitoring and reporting requirements that implement the federal and California regulations.

I. GENERAL MONITORING PROVISIONS

A. General Monitoring Provision

1. All sampling and sample preservation shall be in accordance with the current edition of "*Standard Methods for the Examination of Water and Wastewater*" (American Public Health Association).
2. All laboratory analyses shall be performed in accordance with test procedures under 40 CFR 136 (revised as of May 14, 1999) "Guidelines Establishing Test Procedures for the Analysis of Pollutants," promulgated by the United States Environmental Protection Agency (EPA), unless otherwise specified in this MRP. In addition, the Regional Water Board and/or EPA, at their discretion, may specify test methods that are more sensitive than those specified in 40 CFR 136. Unless otherwise specified herein, organic pollutants shall be analyzed using EPA method 8260, as appropriate.
3. Chemical, bacteriological, and bioassay analyses shall be conducted at a laboratory certified for such analyses by the California Department of Health Services in accordance with the provision of Water Code Section 13176, and must include quality assurance/quality control data with their reports, or EPA or at laboratories approved by the Regional Water Board's Executive Officer.
4. Whenever the Discharger monitors any pollutant more frequently than is required by this Order, the results of this monitoring shall be included in the calculation and reporting of the data submitted in the discharge monitoring report specified by the Executive Officer.
5. In conformance with federal regulations 40 CFR 122.45(c), analyses to determine compliance with the effluent limitations for metals shall be conducted using the total recoverable method. For Chromium (VI), the dissolved method in conformance with 40 CFR 136 may be used to measure compliance with the Chromium (VI) limitation.

6. For effluent wastewater monitoring:

The Discharger shall require its testing laboratory to calibrate the analytical system down to the minimum level (ML)¹ specified in Attachment "I" for priority pollutants with effluent limitations in this Order, unless an alternative minimum level is approved by the Regional Water Board's Executive Officer. When there is more than one ML value for a given substance, the Discharger shall use the ML values, and their associated analytical methods, listed in Attachment "I" that are below the calculated effluent limitation. The Discharger may select any one of those cited analytical methods for compliance determination. If no ML value is below the effluent limitation, then the lowest ML value and its associated analytical method, listed in Attachment "I" shall be used. Any internal quality control data associated with the sample must be reported when requested by the Executive Officer. The Regional Water Board will reject the quantified laboratory data if quality control data is unavailable or unacceptable.

7. The Discharger shall have, and implement an acceptable written quality assurance (QA) plan for laboratory analyses. Duplicate chemical analyses must be conducted on a minimum of ten percent (10%) of the samples, or at least one sample per month, whichever is greater. A similar frequency shall be maintained for analyzing spiked samples. When requested by the Regional Water Board or EPA, the Discharger will participate in the NPDES discharge monitoring report QA performance study.

8. Monitoring shall be in accordance with the following:

Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity.

- a) The monitoring and reporting of influent, effluent, and sludge shall be done more frequently as necessary to maintain compliance with this Order and or as specified in this order.
- b) A "grab" sample is defined as any individual sample collected in less than 15 minutes.
- c) A composite sample is defined as a combination of no fewer than eight individual grab samples obtained over the specified sampling period. The volume of each individual grab sample shall be proportional to the discharge flow rate at the time of sampling. The compositing period shall equal the specific sampling period, or 24 hours, if no period is specified.
- d) 24-hour composite samples shall be collected continuously during a 24-hour operation of the facility.

¹ Minimum level is the concentration at which the entire analytical system must give a recognizable signal and acceptable point. The ML is the concentration in a sample that is equivalent to the concentration of the lowest calibration standard analyzed by a specific analytical procedure, assuming that all the method specified sample weights, volumes, and processing steps have been followed.

- e) Daily samples shall be collected on each day of the week.
- f) Monthly samples shall be collected on any representative day of each month.
- g) Quarterly samples shall be collected by any representative day of January, April, July, and October.
- h) Annual samples shall be collected in accordance with the following schedule:

Year	Annual Samples
2006	July
2007	October
2008	January
2009	April
2010	July
2011	April

9. The Discharger shall assure that records of all monitoring information are maintained and accessible for a period of at least five years (this retention period supercedes the retention period specified in Section IV.A. of Attachment D) from the date of the sample, report, or application. This period of retention shall be extended during the course of any unresolved litigation regarding this discharge or by the request of the Regional Water Board at any time. Records of monitoring information shall include:
- a) The information listed in Attachment D- IV Standard Provisions – Records, subparagraph B. of this Order;
 - b) The laboratory which performed the analyses;
 - c) The date(s) analyses were performed;
 - d) The individual(s) who performed the analyses;
 - e) The modification(s) to analytical techniques or methods used;
 - f) All sampling and analytical results, including
 - 1) Units of measurement used;
 - 2) Minimum reporting level for the analysis (minimum level, practical quantitation level (PQL));
 - 3) Results less than the reporting level but above the method detection limit (MDL);
 - 4) Data qualifiers and a description of the qualifiers;
 - 5) Quality control test results (and a written copy of the laboratory quality assurance plan);
 - 6) Dilution factors, if used; and
 - 7) Sample matrix type.
 - g) All monitoring equipment calibration and maintenance records;
 - h) All original strip charts from continuous monitoring devices;
 - i) All data used to complete the application for this Order; and,

- j) Copies of all reports required by this Order.
 - k) Electronic data and information generated by the Supervisory Control And Data Acquisition (SCADA) System.
10. The flow measurement system shall be calibrated at least once per year or more frequently, to ensure continued accuracy.
11. All monitoring instruments and devices used by the Discharger to fulfill the prescribed monitoring program shall be properly maintained and calibrated as necessary to ensure their continued accuracy. In the event that continuous monitoring equipment is out of service for greater than a 24-hour period, the Discharger shall obtain a representative grab sample each day the equipment is out of service. The Discharger shall correct the cause(s) of failure of the continuous monitoring equipment as soon as practicable. In its monitoring report, the Discharger shall specify the period(s) during which the equipment was out of service and if the problem has not been corrected, shall identify the steps which the Discharger is taking or proposes to take to bring the equipment back into service and the schedule for these actions.

B. Minimum Level (ML) Requirements

For priority pollutants the methods must meet the lowest minimum levels (MLs) specified in Attachment I of this Order, where no methods are specified for a given pollutant, by methods approved by this Regional Water Board or the State Water Board. When there is more than one ML value for a given substance listed in Attachment I – ML Table², the Discharger shall select any one of those cited analytical methods for compliance determination when the associated ML is below the calculated effluent limitation.

If no ML value is below the effluent limitation, then the Discharger shall select as the reporting level (RL), the lowest ML value and its associated analytical method listed in Attachment I.

II. MONITORING LOCATIONS

The Discharger shall establish the following monitoring locations to demonstrate compliance with the effluent limitations, discharge specifications, and other requirements in this Order:

Table 1. Monitoring Station Locations

Discharge Point Name	Monitoring Location Name	Monitoring Location Description	Latitude	Longitude
--	M-INFA	Influent sampling at Riverside influent line, before Headworks	33° 57' 54.75" N	117° 27' 13.62" W
--	M-INFB	Influent sampling at Jurupa influent line, before Headworks	33° 57' 54.97" N,	117°27' 13.34" W
--	M-INFC	Influent sampling at Rubidoux influent line, before Headworks	33° 57' 54.89" N,	117° 27' 13.27" W

² The ML table includes all ML values and their associated analytical methods.

Table 1. Monitoring Station Locations

Discharge Point Name	Monitoring Location Name	Monitoring Location Description	Latitude	Longitude
--	M-INFD	Influent sampling at Arlanza influent line, before Headworks	33° 51' 51.33" N	117° 27' 13.77" W
001	M-001A	Effluent to Reach 3 of Santa Ana River, close to the end of effluent pipeline	33° 57' 48.30" N	117° 27' 40.95" W
001	M-001B	At the end of the chlorine contact tank 3 for coliform testing, same monitoring location as REC-001	33° 57' 42.24" N	117° 27' 40.98" W
002	M-002	Effluent to Reach 3 of Santa Ana River, after splitter box	33° 57' 48.87" N	117° 28' 35.97" W
003	M-003	Effluent to Reach 3 of Santa Ana River, at "Flow Meter & Sampler" after 14 wetland ponds	33° 57' 48.73" N	117° 29' 52.95" W
004	M-004	Effluent commingled with water from Hole Lake channeled to farm field, then to Reach 3 of Santa Ana River, at "Flow Meter" after structure 2	33° 57' 44" N	117° 29' 7.29" W
005	REC-004	Recycled water for Riverside Energy Resource Center	33° 57' 44.38" N	117° 27' 32.33" W
006	REC-001	Recycled water for irrigation of urban forest, at the end of the chlorine contact tank 3	33° 57' 42.15" N	117° 27' 41.49" W
007	REC-002	Recycled water for irrigation of Golf Course, at the end of the chlorine contact tank 1	33° 57' 44.38" N	117° 27' 32.33" W
008	REC-003A	Recycled water for irrigation of Toro turf, at the end of the chlorine contact tank 3, same as REC-001	Same as REC-001	Same as REC-001
008	REC-003B	Recycled water for irrigation of Toro turf, at the end of the effluent line, close to M-001A	33° 57' 47.25" N	117° 27' 39.79" W
--	R-001U	Receiving surface water, upstream of Santa Ana River at the Metropolitan Water District pipeline crossing.	33° 58' 4.53" N	117° 26' 52.93" W
--	R-001D	Santa Ana river, downstream of the most downstream point of discharge	33° 57' 29.69" N	117° 1' 42.75" W
--	R-002	Santa Ana River	--	--
--	B-001	Biosolids monitoring at end of dewatering	33° 57' 44.24" N	117° 27' 27.67" W

III. INFLUENT MONITORING REQUIREMENTS

A. Monitoring Locations at M-INFA through M-INFD

1. Sampling stations shall be established for the points of inflow to the treatment plant. The sampling station(s) shall be located upstream of any in-plant return flows and where representative sample(s) of the influent of the treatment plant can be obtained.

2. The Discharger shall monitor the combined influent into the facility at M-INFA, M-INFB, M-INFC, and M-INFD as follows:

Table 2. Influent Monitoring

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Flow	mgd	Recorder/ Totalizer	Continuous	--
Specific Conductance	µmhos/cm	Recorder	"	See Sections I.A.2., I.A.3. & I.B., above of this MRP
pH	pH units	Recorder	Continuous	"
BOD ₅	mg/L	24-hr Composite	Weekly	"
Suspended Solids	"	"	Weekly	"
Ammonia-Nitrogen	"	Grab	Monthly	"
Total Inorganic Nitrogen	"	24-hr Composite	"	"
Total Dissolved Solids	"	24-hr Composite	Monthly	"
Boron	"	"	Quarterly	"
Chloride	"	"	"	"
Fluoride	"	"	"	"
Sulfate	"	"	"	"
Total Hardness	mg/L	"	"	"
Arsenic	µg/L	"	"	"
Cadmium	"	"	"	"
Chromium, VI or Total chromium	µg/L	24-hr Composite	Quarterly	See Sections I.A.2., I.A.3. & I.B., above of this MRP
Copper	"	"	"	"
Cyanide (Free)	µg/L	Grab	Quarterly	"
Lead	"	24-hr Composite	"	"
Mercury	"	"	"	"
Nickel	"	"	"	"
Silver	"	"	"	"
Zinc	µg/L	24-hr Composite	Quarterly	"
Volatile organic portion of EPA Priority Pollutants ³ (See Attachment "G")	µg/L	Grab	Annually	"
Remaining EPA Priority Pollutants ⁴ (See Attachment "G")	µg/L	24-hr Composite	Annually	"

IV. EFFLUENT MONITORING REQUIREMENTS

The Discharger shall monitor tertiary effluent at monitoring locations as follows. If more than one analytical test method is listed for a given parameter, the Discharger may select from the listed methods and associated Reporting Level⁵:

A. Tertiary Effluent Monitoring Locations M-001A and M-001B

1. The Discharger shall monitor tertiary effluent at monitoring location M-001A as follows:

Table 3a. Effluent Monitoring at M-001A

<u>Parameter</u>	<u>Units</u>	<u>Sample Type</u>	<u>Minimum Sampling Frequency</u>	<u>Required Analytical Test Method and Reporting Level as noted herein</u>
Flow	mgd	Recorder/ Totalizer	Continuous	---
pH	pH units	"	"	See Sections I.A.2., I.A.3. & I.B., above of this MRP
Specific Conductance	µmhos/cm	Recorder	Continuous	See Sections I.A.2., I.A.3. & I.B., above of this MRP
Total Chlorine Residual	mg/L	"	"	"
Turbidity	NTU ⁶	Recorder/Turbidimeter	Continuous ⁷	"
Ammonia-Nitrogen	mg/L	24-hr Composite	Weekly	"
BOD ₅	"	"	"	"
Nitrate Nitrogen	"	"	"	"
Suspended Solids	"	"	"	"
Temperature	°C	grab	Weekly	"
Total Dissolved Solids	mg/L	24-hr Composite	Monthly	"
Total Inorganic Nitrogen	"	"	"	"
Total Hardness	"	"	"	"
Toxicity Monitoring	---	See Section V, Below	Monthly, See Section V, Below	"
Cyanide (Free)	µg/L	grab	Monthly	See Sections I.A.2., I.A.3. & I.B., above of this MRP
Chromium (VI) or Total Chromium ⁸	"	24-hr Composite	"	See Sections I.A.2., I.A.3. & I.B., above of this MRP and RL 5 µg/L, Total Cr, RL 2 µg/L

³ EPA priority pollutants are those remaining volatile organic pollutants listed in Attachment "G" which are not specifically listed in this monitoring program table.

⁴ Remaining EPA priority pollutants are those pollutants listed in Attachment "G" which are not volatile organics and pollutants not specifically listed in this monitoring program table.

⁵ Reporting Level (RL) Selection: When there is more than one ML value for a given substance, the Regional Water Board shall include as RLs in the permit, all ML values, and their associated analytical methods, listed in Appendix 4 of the SIP that are below the calculated effluent limitation. The Discharger may select any one of those cited analytical methods for compliance determination. If no ML value is below the effluent limitation, then the Regional Water Board shall select as the RL the lowest ML value and its associated analytical method listed in Appendix 4 for inclusion in the permit.

⁶ NTU = Nephelometric Turbidity Units

⁷ Turbidity analysis shall be continuous, performed by a continuous recording turbidimeter. Compliance with the daily average operating filter effluent turbidity shall be determined by averaging the levels of recorded turbidity taken at a minimum of four-hour intervals over a 24-hour period. The results of the daily average turbidity determinations shall be reported monthly.

⁸ Cr(VI) and Hg shall be monitored monthly for one year, if all reported data are "ND" at approved reporting level, the monitoring frequency may be reduced to quarterly with prior approval from the Executive Officer or designee.

Table 3a. Effluent Monitoring at M-001A

<u>Parameter</u>	<u>Units</u>	<u>Sample Type</u>	<u>Minimum Sampling Frequency</u>	<u>Required Analytical Test Method and Reporting Level as noted herein</u>
Mercury	"	"	"	See Sections I.A.2., I.A.3. & I.B., above of this MRP
Cadmium	µg/L	24-hr Composite	Quarterly	See Sections I.A.2., I.A.3. & I.B., above of this MRP and RL 0.5 µg/L
Copper	"	"	"	See Sections I.A.2., I.A.3. & I.B., above of this MRP and RL 5 µg/L
Lead	"	24-hr Composite	"	See Sections I.A.2., I.A.3. & I.B., above of this MRP and RL 5 µg/L
Selenium	"	"	"	See Sections I.A.2., I.A.3. & I.B., above of this MRP and RL 2 µg/L
Silver	"	"	"	See Sections I.A.2., I.A.3. & I.B., above of this MRP and RL 1 µg/L
Aluminum	mg/L	"	Quarterly	See Sections I.A.2., I.A.3. & I.B., above of this MRP
Boron	mg/L	24-hr Composite	Quarterly	"
Calcium	mg/L	24-hr Composite	Quarterly	See Sections I.A.2., I.A.3. & I.B., above of this MRP
Carbonate	"	"	"	"
Chloride	"	"	"	"
Fluoride	"	"	"	"
Magnesium	"	"	"	"
Manganese	"	"	"	"
Sodium	"	"	"	"
Sulfate	"	"	"	"
Total organic carbon	"	"	Quarterly	"
Arsenic	µg/L	24-hr Composite	Quarterly (See IV.A.3., below)	"
Barium	"	"	"	"
Cobalt	"	"	"	"
Iron	"	"	"	"
Nickel	"	"	"	"
Zinc	"	"	"	"
Chloroform	µg/L	Grab	"	"
Phenolic Compounds	µg/L	Grab	Quarterly (See IV. A.3., below)	"
Remaining volatile organic portion of EPA Priority Pollutants (See Attachment "G)	"	"	Annually (See IV. A.4., below)	"
Remaining EPA Priority Pollutants (See Attachment "G)	"	"	Annually (See IV. A.4., below)	"

2. The Discharger shall monitor tertiary treated effluent at M-001B as follows:

Table 3b. Effluent Monitoring at M-001B

<u>Parameter</u>	<u>Units</u>	<u>Sample Type</u>	<u>Minimum Sampling Frequency</u>	<u>Required Test Method</u>
Coliform Organisms	MPN per 100 ml ⁹	Grab	Daily ¹⁰	See Sections I.A.2., I.A.3. & I.B., above of this MRP

3. The monitoring frequency for those priority pollutants that are detected during the required quarterly monitoring at a concentration greater than fifty percent of the most stringent applicable receiving water objectives (freshwater or human health (consumption of organisms only) as specified for that pollutant¹¹ in Attachment J) shall be accelerated to monthly. To return to the monitoring frequency specified, the Discharger shall request and receive approval from the Regional Water Board's Executive Officer or designee.
4. The monitoring frequency for those priority pollutants that are detected during the required annual monitoring at a concentration greater than fifty percent of the most stringent applicable receiving water objectives (freshwater or human health (consumption of organisms only) as specified for that pollutant¹² in 40 CFR 131.38) shall be accelerated to quarterly for one year. To return to the monitoring frequency specified, the Discharger shall request and receive approval from the Regional Water Board's Executive Officer or designee.

B. Tertiary Effluent Monitoring Location M-004

1. When flow is present, the he Discharger shall monitor tertiary treated effluent at M-004 as follows:

Table 3c. Effluent Monitoring at M-004

<u>Parameter</u>	<u>Units</u>	<u>Sample Type</u>	<u>Minimum Sampling Frequency</u>	<u>Required Test Method</u>
Flow	mgd	Recorder/Totalizer	Continuous	---

C. Tertiary Effluent Monitoring Locations M-002 and M-003

1. When flow is present, the Discharger shall monitor tertiary treated effluent at M-002 and M-003 as follows:

⁹ MPN/100mL = Most Probable Number per 100 milliliters

¹⁰ Weekdays excluding holidays

¹¹ For those priority pollutants without specified criteria values, accelerated monitoring is not required.

¹² For those priority pollutants without specified criteria values, accelerated monitoring is not required.

Table 3d. Effluent Monitoring at M-002 and M-003

<u>Parameter</u>	<u>Units</u>	<u>Sample Type</u>	<u>Minimum Sampling Frequency</u>	<u>Required Test Method</u>
Flow ¹³	mgd	Recorder/ Totalizer	Continuous	---
Total Inorganic Nitrogen	mg/L	Composite	Monthly	See Sections I.A.2., I.A.3. & I.B., above of this MRP

D. Secondary Effluent Monitoring Locations M-001A and M-001B with 20:1 Dilution

1. The Discharger shall monitor secondary treated effluent at M-001A when 20:1 dilution is provided by the Santa Ana River at the time of the discharge, as follows:

Table 3e. Secondary Effluent Monitoring at M-001A with 20:1 Dilution

<u>Parameter</u>	<u>Units</u>	<u>Sample Type</u>	<u>Minimum Sampling Frequency</u>	<u>Required Test Method</u>
Flow	mgd	Recorder/ Totalizer	Continuous	--
pH	pH units	Grab	Daily	See Sections I.A.2., I.A.3. & I.B., above of this MRP
Suspended Solids	mg/L	"	"	"
BOD ₅	"	"	"	"
Total Chlorine Residual	"	"	"	"

2. The Discharger shall monitor secondary treated effluent at M-001B as follows:

Table 3f. Secondary Effluent Monitoring at M-001B with 20:1 Dilution

<u>Parameter</u>	<u>Units</u>	<u>Sample Type</u>	<u>Minimum Sampling Frequency</u>	<u>Required Test Method</u>
Coliform Organisms	MPN per 100 ml ¹⁴	Grab	Daily ¹⁵	See Sections I.A.2., I.A.3. & I.B., above of this MRP

¹³ Flow may be measured at M-004

¹⁴ MPN/100mL = Most Probable Number per 100 milliliters

¹⁵ Weekdays excluding holidays

V. WHOLE EFFLUENT TOXICITY TESTING REQUIREMENTS

A. Toxicity Monitoring Requirements at M-002

1. The Discharger shall conduct critical life stage chronic toxicity testing in accordance with Method 1002.0 - Survival and Reproduction test for water flea, *Ceriodaphnia dubia* as specified in "Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms", Fourth Edition, Environmental Monitoring Systems Laboratory, U.S. Environmental Protection Agency 2002, Cincinnati, Ohio (October 2002, EPA-821-R-02-013).
2. The Discharger shall establish procedures to ensure that the toxicity testing laboratory notifies the Discharger of the results of toxicity testing by the end of the next business day following the completion of such tests.
3. A minimum of one monthly chronic toxicity test shall be conducted on 24-hour composite samples. A grab sample taken at peak flow may be substituted for a composite sample when the M-002 site is not available and the Van Buren sample site is used.
4. The Discharger shall increase the frequency of chronic toxicity testing to, at a minimum of every two weeks whenever any test result exceeds 1.0 TUc. The first test under the accelerated schedule shall be conducted within two weeks of receiving notice of the test that exceeds 1.0 TUc, and every two weeks thereafter. The Discharger may resume the regular test schedule when two consecutive chronic toxicity tests result in 1.0 TUc, or when the results of the Initial Investigation Reduction Evaluation conducted by the Discharger have adequately addressed the identified toxicity problem.
5. The presence of chronic toxicity shall be estimated as specified in Short Term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms. Fourth Edition. EPA-821-R-02-013.
6. Results for both survival and reproduction endpoints shall be reported in TUc, where $TUc = 100/NOEC$ or $100/IC_p$ or EC_p (p is the percent effluent). The no observed effect concentration (NOEC) is the highest concentration of toxicant to which organisms are exposed in a chronic test, that causes no observable adverse effect on the tests organisms (e.g., the highest concentration of toxicant to which the values for the observed responses are not statistically significant different from the controls). The inhibition concentration (IC) is a point estimate of the toxicant concentration that causes a given percent reduction in a non-quantal biological measurement (e.g., reproduction or growth) calculated from a continuous model (the EPA Interpolation Method). The effective concentration (EC) is a point estimate of the toxicant concentration that would cause a given percent reduction in quantal biological measurement (e.g., larval development, survival) calculated from a continuous model (e.g., probit).

7. Additional Testing Requirements.

- a. A series of at least five dilutions and a control will be tested. Five dilutions of the series shall be within 60% to 100% effluent concentration.
- b. If organisms are not cultured in-house, concurrent testing with reference toxicants shall be conducted. Where organisms are cultured in-house, monthly reference toxicant testing is sufficient. Reference toxicants shall also be conducted using the same test conditions as the effluent toxicity test (e.g., same test duration, etc).
- c. If either of the reference toxicant test or the effluent tests do not meet all test acceptability criteria as specified in the manual¹⁶, then the Discharger must re-sample and re-test within 14 days or as soon as the Discharger receives notification of failed tests.
- d. Control and dilution water should be receiving water or lab water. If the dilution water used is different from the culture water, a second control, using culture water shall also be used.

8. Quality Assurance/Control:

- a. A quality assurance/quality control (QA/QC) program shall be instituted to verify the results of the effluent toxicity-monitoring program. The QA/QC program shall include but shall not be limited to the following: (1) Selection of an independent testing laboratory; (2) Approval by the Regional Board's Executive Officer or Executive Officer's designee of the independent testing laboratory; (3) Once during the year, the Discharger shall split samples with the independent laboratory for conducting chronic toxicity testing; (4) Results from the independent laboratory shall be submitted to the Regional Board and the Discharger for evaluation; (5) The Discharger shall review the test acceptability criteria in accordance with the EPA test protocols, EPA-821-R-02-013.
 - b. Results from the independent laboratory of the annual QA/QC split samples are to be used for Quality Assurance/Quality Control (QA/QC) purposes only and not for purposes of determining compliance with other requirements of this Order.
9. The use of alternative methods for measuring chronic toxicity may be considered by the Executive Officer on a case-by-case basis. The use of a different test species, in lieu of conducting the required test species may be considered/approved by the Executive Officer on a case-by case basis upon submittal of the documentation supporting Discharger's determination that a different species is more sensitive and appropriate.

¹⁶ Refers to USEPA Manual "Short-Term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms. Fourth Edition. EPA-821-R-02-013.

10. Reporting: Results of all toxicity testing conducted within the month following the reporting period shall be submitted monthly in accordance with "Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms", third edition, Environmental Monitoring Systems Laboratory, U.S. Environmental Protection Agency 2002, Cincinnati, Ohio (October 2002, EPA-821-R-02-013). The report shall include a determination of the median value of all chronic toxicity testing results conducted during the two previous months.
11. Whenever an Initial Investigation Reduction Evaluation is conducted, the results of the evaluation shall be submitted upon completion. In addition, monthly status reports shall be submitted as part of the Discharger's monitoring report.

VI. LAND DISCHARGE MONITORING REQUIREMENTS – Not Applicable

VII. RECLAMATION MONITORING REQUIREMENTS

A. Monitoring Locations REC-001, REC-002, REC-003 and REC-004

The Discharger shall monitor recycled wastewater at REC-001, REC-002, REC-003 and REC-004

Table 4a. Reclaimed Water Monitoring at REC-001, REC-002, REC-003 and REC-004

Parameter	Units	Sample Type	Minimum Sampling & Testing Frequency	Required Analytical Test Method
Flow	mgd	Recorder/Totalizer	Continuous	---
Coliform Organisms	MPN per 100 ml	Grab	Daily ¹⁷	See Sections I.A.2., I.A.3. & I.B., above of this MRP

B. Monitoring Location M-001A

The Discharger shall monitor recycled wastewater at M-001A for REC-001, REC-002, and REC-003

¹⁷ Weekdays excluding holidays – Coliform for REC-002 and REC-004 is measured in chlorine contact basin #1, Coliform for REC-001 and REC-003 is measured at M-001B.

Table 4b. Reclaimed Water Monitoring at M-001A

Parameter	Units	Sample Type	Minimum Sampling & Testing Frequency	Required Analytical Test Method
BOD ₅	mgd	24-hr composite	Monthly	See Sections I.A.2., I.A.3. & I.B., above of this MRP
Suspended Solids	mg/L	24-hr composite	Monthly	"
Total Inorganic Nitrogen	mg/L	24-hr composite	Monthly	"
pH	pH units	Grab	Monthly	"

C. Monitoring Users

Whenever recycled water is supplied to a user, the Discharger shall record on a permanent log: the volume of recycled water supplied; the user of recycled water; the locations of those sites including the names of the groundwater management zones underlying the recycled water use sites; type of use (e.g. irrigation, industrial, etc); and the dates at which water is supplied. The Discharger shall submit annually a summary report of the recorded information by groundwater management zone.

VIII. RECEIVING WATER MONITORING REQUIREMENTS – SURFACE WATER AND GROUNDWATER

A. Monitoring Location R-001U for Surface Water

1. The Discharger shall make measurement of the receiving water flow at R-001U in the Santa Ana River and determine whether a 20:1 dilution exists at the point of discharge before discharging secondary treated effluent. A dilution of 20:1 or more is required at the point of discharge. Flow measurements shall be made prior to any direct discharge to the river and shall continue on a daily basis until the discharged is terminated. By June 1, 2006, the Discharger shall submit for approval by the Executive Officer a proposed plan for measuring the receiving water flow at R-001U in the Santa Ana River. The proposed plan can be included in the report required in Section VI.C.2.b. of the Order and shall be implemented upon approval.

2. The Discharger shall monitor receiving water at R-001U as follows:

Table 5a. Receiving Water Monitoring at R-001U

Parameter	Units	Sample Type	Minimum Sampling & Testing Frequency	Required Analytical Test Method
Dissolved Oxygen	mg/L	Grab	Weekly	See Sections I.A.2., I.A.3. & I.B., above of this MRP
Temperature	°C	"	"	"
pH	pH unit	Grab	"	"
EPA Priority Pollutants	µg/L	"	Annually	"

B. Monitoring Location R-001D for Surface Water:

1. The Discharger shall monitor receiving water at R-001D as follows:

Table 5b. Receiving Water Monitoring at R-001D

Parameter	Units	Sample Type	Minimum Sampling & Testing Frequency	Required Analytical Test Method
Dissolved Oxygen	mg/L	Grab	Weekly	See Sections I.A.2., I.A.3. & I.B., above of this MRP
Temperature	°C	"	"	"
pH	pH unit	Grab	"	"
Color change, foam, deposition of material, odor	--	observe	Weekly	"

C. Monitoring Location R-002 for Surface Water:

Unless otherwise directed by the Regional Water Board Executive Officer, the Discharger shall implement the approved plan for the annual sampling and testing of mercury levels in fish flesh samples collected from the Santa Ana River. The frequency of monitoring and submission of reports shall be as stipulated in the approved plan.

D. Groundwater-Not Applicable

IX. OTHER MONITORING REQUIREMENTS

A. Biosolids Monitoring at B-001

1. Biosolids monitoring shall be conducted as follows:

Table 6. Biosolids Monitoring at B-001

Parameter	Units	Sample Type	Minimum Sampling & Testing Frequency	Required Analytical Test Method
Priority Pollutants	mg/kg	A composite of six grab samples	Semi-annually	See Sections I.A.2., I.A.3. & I.B., above of this MRP
Moisture Content (% solid)	mg/kg	Grab	quarterly	"

2. The Discharger shall maintain a permanent log of solids hauled away from the treatment facilities for use/disposal elsewhere, including the date hauled, the volume or weight (in dry tons), type (screening, grit, raw sludge, biosolids), application (agricultural, composting, etc), and destination. This information shall be reported semi-annually.

B. Water Supply Monitoring:

1. A sample of each source of the water supplied to the sewered area shall be obtained at least annually and analyzed for total dissolved solids concentration expressed in "mg/L".
2. Monthly reports shall be submitted stating the amount (in percentage or acre-feet) supplied to the sewered area from each source of water and the resulting flow-weighted water supply quality for total dissolved solids.

C. Pretreatment Monitoring and Reporting:

1. The Discharger shall submit to the Regional Water Board and the EPA Region 9, a quarterly compliance status report. The quarterly compliance status reports shall cover the periods January 1 - March 31, April 1 - June 30, July 1 - September 30, and October 1 -December 31. Each report shall be submitted by the end of the month following the quarter, except that the report for October 1 - December 31 may be included in the annual report. This quarterly reporting requirement shall commence for the first full quarter following issuance of this Order. The reports shall identify:
 - a. All significant industrial users (SIUs) which violated any standards or reporting requirements during that quarter;
 - b. The violations committed (distinguish between categorical and local limits);
 - c. The enforcement actions undertaken; and

- d. The status of active enforcement actions from previous periods, including closeouts (facilities under previous enforcement actions which attained compliance during the quarter).
2. Annually, the Discharger shall submit a report to the Regional Water Board, the State Water Resources Control Board and the EPA Region 9 describing the pretreatment activities within the service area during the previous year. In the event that any control authority within the service area is not in compliance with any conditions or requirements of this Order or their approved pretreatment program (such as due to industrial user discharges, interjurisdictional agency agreement implementation issues, or other causes,) then the Discharger shall also include the reasons for non-compliance and state how and when the Discharger and the control authority shall comply with such conditions and requirements. This annual report shall cover operations from January 1 through December 31 of each fiscal year and is due on April 1 of each year. The report shall contain, but not be limited to, the following information:
 - a. A summary of analytical results from representative, flow-proportioned, 24-hour composite sampling of the POTW's influent and effluent wastewaters for those pollutants which are known or suspected to be discharged by industrial users (IUs) as identified by EPA under Section 307(a) of the CWA. The summary will include the result of annual full priority pollutant scan, with quarterly samples analyzed only for those pollutants¹⁸ detected in the full scan. The Discharger shall also provide any influent or effluent monitoring data for non-priority pollutants which the Discharger believes may be causing or contributing to Interference, Pass Through or adversely impacting sludge quality. Sampling and analysis shall be performed in accordance with the techniques prescribed in 40 CFR 136 and amendments thereto.
 - b. A discussion of any upset, interference, or pass-through incidents at the treatment plant (if any), which the Discharger knows or suspects were caused by IUs of the POTW system. The discussion shall include the following:
 - 1) The reasons why the incidents occurred, the corrective actions taken, and, if known, the name and address of the IU(s) responsible.
 - 2) A review of the applicable pollutant limitations to determine whether any additional limitations, or changes to existing requirements, may be necessary to prevent pass through, interference or noncompliance with sludge disposal requirements.
 - c. A complete and updated list of the Discharger's significant industrial users (SIUs), including names, North American Industry Classification System (NAICS) and addresses, and a list of any SIU deletions and/or additions. The Discharger shall provide a brief explanation for each deletion. The SIU list shall identify the SIUs subject to Federal Categorical Standards by specifying which set(s) of standards are applicable to each SIU. The list shall also indicate which SIUs are subject to local limitations more stringent than Federal Categorical Standards and those, which are not subject to local limits.

¹⁸ *The Discharger is not required to analyze for asbestos.*

- d. A list or table characterizing the industrial compliance status of each SIU, including:
- 1) SIU name;
 - 2) Industrial category;
 - 3) The type (processes) of wastewater treatment in place;
 - 4) Number of samples taken by the POTW during the year;
 - 5) Number of samples taken by the SIU during the year;
 - 6) Whether all needed certifications (if allowed) were provided by SIUs which have limits for total toxic organics;
 - 7) Federal and Regional Standards violated during the year, reported separately;
 - 8) Whether the SIU at any time in the year was in Significant Noncompliance (SNC)¹⁹, as defined by 40 CFR 403.12 (f)(2)(vii); and
 - 9) A summary of enforcement actions against the SIU taken during the year, including the type of action, final compliance date, and amount of fines assessed/collected (if any). Proposed actions, if known, should be included.
 - 10) Number of inspections conducted at each SIU during the year.
- e. A compliance summary table which includes:
- 1) SIU's which were in SNC at any time during the year;
 - 2) The total number of SIUs which are in SNC with pretreatment compliance schedules during the year;
 - 3) The total number of notices of violation and administrative orders issued against SIUs during the year;
 - 4) The total number of civil and criminal judicial actions filed against SIUs during the year;
 - 5) The number of SIUs which were published as being in SNC during the year; and
 - 6) The number of IUs from which penalties were collected during the year.
- f. A short description of any significant changes in operating the pretreatment program which differ from the previous year including, but not limited to changes concerning:
- 1) The program's administrative structure;
 - 2) Local industrial discharge limitations;
 - 3) Monitoring program or monitoring frequencies;
 - 4) Legal authority or enforcement policy;
 - 5) Funding mechanisms; and
 - 6) Resource requirements and/or staffing levels.
- g. A summary of the annual pretreatment budget, including the cost of pretreatment program functions and equipment purchases.
- h. A summary of public participation activities to involve and inform the public.

¹⁹ SNC is determined at the beginning of each quarter based on data of the previous six months.

- i. A description of any changes in sludge disposal methods and a discussion of any concerns not described elsewhere in the report.
3. The cumulative number of industrial users that the Discharger has notified regarding Baseline Monitoring Reports and the cumulative number of industrial user responses.
4. The Discharger shall submit the quarterly compliance status reports and the annual pretreatment report to EPA Region 9, the State Board and the Regional Water Board.

X. REPORTING REQUIREMENTS

A. General Monitoring and Reporting Requirements

1. The Discharger shall comply with all Standard Provisions (Attachment D) related to monitoring, reporting, and recordkeeping.
2. All analytical data shall be reported with method detection limit²⁰ (MDLs) and with identification of either reporting level, practical quantitation levels (PQLs²¹) or limits of quantitation (LOQs).
3. Laboratory data for effluent samples must quantify each constituent down to the PQLs specified in Attachment "H" for non-priority pollutants and down to the MLs specified in Attachment "I" for priority pollutants. Any internal quality control data associated with the sample must be reported when requested by the Executive Officer. The Regional Water Board will reject the quantified laboratory data if quality control data are unavailable or unacceptable.
4. Discharge monitoring data shall be submitted in a format acceptable by the Regional Water Board. Specific reporting format may include preprinted forms and/or electronic media. The results of all monitoring required by this Order shall be reported to the Regional Water Board, and shall be submitted in such a format as to allow direct comparison with the limitations and requirements of this order.
5. The Discharger shall tabulate the monitoring data to clearly illustrate compliance and/or noncompliance with the requirements of the Order.
6. The Discharger shall submit to the Regional Water Board reports necessary to determine compliance with effluent limitations in this Order and shall follow the chemical nomenclature and sequential order of priority pollutant constituents shown in Attachment "G" – Priority Pollutant Lists. The Discharger shall report with each sample result:

²⁰ The standardized test procedure to be used to determine the method detection limit (MDL) is given at Appendix B, "Definition and Procedure for the Determination of the Method Detection Limit" of 40 CFR 136.

²¹ PQL is the lowest concentration of a substance that can be determined within ± 20 percent of the true concentration by 75 percent of the analytical laboratories tested in a performance evaluation study. Alternatively, if performance data are not available, the PQL is the method detection limit (MDL) $\times 5$ for carcinogens and MDL $\times 10$ for noncarcinogens.

- a) The reporting level achieved by the testing laboratory; and
 - b) The laboratory’s current MDL, as determined by the procedure found in 40 CFR 136 (revised as of May 14, 1999).
 - c) For receiving water monitoring and for those priority pollutants without effluent limitations, the Discharger shall require its testing laboratory to quantify constituent concentrations to the lowest achievable MDL as determined by the procedure found in 40 CFR 136 (revised as of May 14, 1999). In situations where the most stringent applicable receiving water objective (freshwater or human health (consumption of organisms only), as specified for that pollutant in 40 CFR 131.38²² is below the minimum level value specified in Attachment “I” and the Discharger cannot achieve an MDL value for that pollutant below the ML value, the Discharger shall submit justification why a lower MDL value cannot be achieved. Justification shall be submitted together with monthly monitoring reports.
7. For non-priority pollutants monitoring, all analytical data shall be reported with identification of practical quantitation levels and with method detection limits, as determined by the procedure found in 40 CFR 136 (revised as of May 14, 1999).
 8. For every item of monitoring data where the requirements are not met, the monitoring report shall include a statement discussing the reasons for noncompliance, and of the actions undertaken or proposed which will bring the discharge into full compliance with requirements at the earliest time, and an estimate of the date when the Discharger will be in compliance. The Discharger shall notify the Regional Water Board by letter when compliance with the time schedule has been achieved.
 9. The monthly reports for June and December shall include a roster of plant personnel, including job titles, duties, and level of State certification for each individual.
 10. At any time during the term of this Order when electronic submittal of monitoring reports has become the norm, the State or Regional Water Board may notify the Discharger to discontinue submittal of hard copies of reports. When such notification is given, the Discharger shall stop submitting hard copies of required monitoring reports.
 11. The Discharger shall report monitoring results for specific parameters in accordance with the following table:

Table 7. Reporting Requirements

Parameter	Measurement
Flow	Daily total flow
pH	Daily high and daily low
Total Chlorine Residual	Daily Maximum
Electrical Conductivity	Daily High
Turbidity	Daily maximum

²² See Federal Register/ Vol. 65, No. 97 / Thursday, May 18, 2000 / Rules and Regulations.

12. The Discharger shall file a written report with the Regional Board within ninety (90) days after the average dry-weather waste flow for any month equals or exceeds 75 percent of the design capacity of the waste treatment and/or disposal facilities. The Discharger's senior administrative officer shall sign a letter that which transmits that report and certifies that the policy making body is adequately informed about it. The report shall include:
 - a. Average daily flow for the month, the date on which the instantaneous peak flow occurred, the rate of that peak flow, and the total flow for the day.
 - b. The Discharger's best estimate of when the average daily dry-weather flow rate will equal or exceed the design capacity of the treatment facilities.
 - c. The Discharger's intended schedule for studies, design, and other steps needed to provide additional capacity for the waste treatment and/or disposal facilities before the waste flow rate equals the capacity of present units.

B. Self Monitoring Reports (SMRs)

1. At any time during the term of this permit, the State or Regional Water Board may notify the Discharger to electronically submit Self-Monitoring Reports (SMRs) using the State Water Board's California Integrated Water Quality System (CIWQS) Program Web site (<http://www.waterboards.ca.gov/ciwqs/index.html>). Until such notification is given, the Discharger shall submit hard copy SMRs in accordance with the requirements described in subsection B.5 below. The CIWQS Web site will provide additional directions for SMR submittal in the event there will be service interruption for electronic submittal.
2. The Discharger shall report in the SMR the results for all monitoring specified in this MRP under sections III through IX. Additionally, the Discharger shall report in the SMR the results of any special studies, acute and chronic toxicity testing, TRE/TIE, PMP, and Pollution Prevention Plan required by Special Provisions – VI.C. list of this Order. The Discharger shall submit monthly, quarterly, and annual SMRs including the results of all required monitoring using USEPA-approved test methods or other test methods specified in this Order. If the Discharger monitors any pollutant more frequently than required by this Order, the results of this monitoring shall be included in the calculations and reporting of the data submitted in the SMR.
3. Monitoring periods and reporting for all required monitoring shall be completed according to the following schedule:

Table 8. Monitoring and Reporting Schedule

Sampling Frequency	Monitoring Period Begins On	Monitoring Period	SMR Due Date
Continuous	April 21, 2006	All	Submit with monthly SMR
Daily	April 21, 2006	(Midnight through 11:59 PM) or any 24-hour period that reasonably represents a calendar day for purposes of sampling.	Submit with monthly SMR
Weekly	April 21, 2006	Sunday through Saturday	Submit with monthly SMR
Monthly	May 1, 2006	1 st day of calendar month through last day of calendar month	30 days from the end of the monitoring period, submit as monthly SMR
Quarterly	May 1, 2006	January 1 through March 31 April 1 through June 30 July 1 through September 30 October 1 through December 31	30 days from the end of the monitoring period, submit with monthly SMR
Semiannually	July 1, 2006	January 1 through June 30 July 1 through December 31	30 days from the end of the monitoring period, submit with monthly SMR
Annually	March 1, 2006	January 1 through December 31	30 days from the end of the monitoring period, submit with monthly SMR

4. Reporting Protocols. The Discharger shall report with each sample result the applicable Reporting Level (RL) and the current Method Detection Limit (MDL), as determined by the procedure in 40 CFR Part 136.

The Discharger shall report the results of analytical determinations for the presence of chemical constituents in a sample using the following reporting protocols:

- a. Sample results greater than or equal to the RL shall be reported as measured by the laboratory (i.e., the measured chemical concentration in the sample).
- b. Sample results less than the RL, but greater than or equal to the laboratory's MDL, shall be reported as "Detected, but Not Quantified," or DNQ. The estimated chemical concentration²³ of the sample shall also be reported.

For the purposes of data collection, the laboratory shall write the estimated chemical concentration next to DNQ as well as the words "Estimated Concentration" (may be shortened to "Est. Conc."). The laboratory may, if such information is available, include numerical estimates of the data quality for the reported result. Numerical estimates of data quality may be percent accuracy (\pm a percentage of the reported value), numerical ranges (low to high), or any other means considered appropriate by the laboratory.

- c. Sample results less than the laboratory's MDL shall be reported as "Not Detected," or ND.

²³ See definition in Attachment "A"

- d. Dischargers are to instruct laboratories to establish calibration standards so that the ML value (or its equivalent if there is differential treatment of samples relative to calibration standards) is the lowest calibration standard. At no time is the Discharger to use analytical data derived from *extrapolation* beyond the lowest point of the calibration curve.
5. The Discharger shall submit SMRs (with an original signature) when required by subsection B.1 above in accordance with the following requirements:
 - a. The Discharger shall arrange all reported data in a tabular format. The data shall be summarized to clearly illustrate whether the facility is operating in compliance with interim and/or final effluent limitations. The Discharger is not required to duplicate the submittal of data that is entered in a tabular format within CIWQS. When electronic submittal of data is required and CIWQS does not provide for entry into a tabular format within the system, the Discharger shall electronically submit the data in a tabular format as an attachment.
 - b. The Discharger shall attach a cover letter to the SMR. The information contained in the cover letter shall clearly identify violations of the WDRs; discuss corrective actions taken or planned; and the proposed time schedule for corrective actions. Identified violations must include a description of the requirement that was violated and a description of the violation.
 - c. SMRs must be submitted to the Regional Water Board, signed and certified as required by the Standard Provisions (Attachment D), to the address listed below:

California Regional Water Quality Control Board
Santa Ana Region
3737 Main Street, Suite 500
Riverside, CA 92501-3348
 6. The Discharger shall attach a cover letter to the SMR. The information contained in the cover letter shall clearly identify violations of the WDRs; discuss corrective actions taken or planned; and identify the proposed time schedule for corrective actions. Identified violations must include a description of the requirement that was violated and a description of the violation.
 7. By April 1 of each year, the Discharger shall submit an annual report to the Regional Water Board. The annual report shall include the following:
 - a. Tabular and graphical summaries of the monitoring data obtained during the previous year;
 - b. A discussion of the compliance record and the corrective actions taken or planned, which may be needed to bring the discharge into full compliance with the waste discharge requirements;
 - c. A summary of the quality assurance (QA) activities for the previous year; and

- d. For priority pollutant constituents that do not have effluent limitations but are required to be monitored, the Discharger shall evaluate the monitoring data obtained during the previous year and determine whether detected constituents are at levels that would warrant reopening the permit to include effluent limitations for such constituent(s). To conduct this evaluation, the concentration of detected constituents shall be compared to the most stringent applicable receiving water objectives (freshwater or human health (consumption of organisms only) as specified for that pollutant²⁴ in 40 CFR 131.38²⁵). For metals and selenium, site-specific translators approved by the Regional Board may be applied in this evaluation. The Discharger shall include a discussion of the corrective actions taken or planned to address values above receiving water objectives.

C. Discharge Monitoring Reports (DMRs)

1. As described in Section X.B.1 above, at any time during the term of this permit, the State or Regional Water Board may notify the Discharger to electronically submit SMRs that will satisfy federal requirements for submittal of Discharge Monitoring Reports (DMRs). Until such notification is given, the Discharger shall submit DMRs in accordance with the requirements described below.
2. DMRs must be signed and certified as required by the standard provisions (Attachment D). The Discharger shall submit the original DMR and one copy of the DMR to the address listed below:

State Water Resources Control Board
Discharge Monitoring Report Processing Center
Post Office Box 671
Sacramento, CA 95812

3. All discharge-monitoring results must be reported on the official USEPA pre-printed DMR forms (EPA Form 3320-1). Forms that are self-generated or modified cannot be accepted.

Regional Administrator
U. S. Environmental Protection Agency
Region 9 – Attention WTR – 7
75 Hawthorne Street
San Francisco, CA 94105

D. Other Reports – Not Applicable

²⁴ For those priority pollutants without specified criteria values, accelerated monitoring is not required.
²⁵ See Federal Register/ Vol. 65, No. 97 / Thursday, May 18, 2000 / Rules and Regulations

ATTACHMENT F – FACT SHEET

Table of Contents

ATTACHMENT F – FACT SHEET.....3

I. Permit Information3

II. Facility Description4

 A. Description of Wastewater and Biosolids Treatment or Controls..... 4

 B. Discharge Points and Receiving Waters 5

 C. Summary of Existing Requirements and Self-Monitoring Report (SMR) Data 6

 D. Compliance Summary 8

 E. Planned Changes 9

III. Applicable Plans, Policies, and Regulations.....9

 A. Legal Authorities 9

 B. California Environmental Quality Act (CEQA)..... 9

 C. State and Federal Regulations, Policies, and Plans 10

 D. Impaired Water Bodies on CWA 303(d) List - Not Applicable..... 12

 E. Other Plans, Policies and Regulations - Not Applicable 12

IV. Rationale For Effluent Limitations and Discharge Specifications.....12

 A. Discharge Prohibitions 12

 B. Technology-Based Effluent Limitations 12

 1. Scope and Authority 12

 2. Applicable Technology-Based Effluent Limitations 13

 C. Water Quality-Based Effluent Limitations (WQBELs) 13

 1. Scope and Authority 13

 2. Applicable Water Quality Criteria and Objectives 13

 3. Determining the Need for WQBELs..... 16

 4. WQBEL Calculations 17

 5. Whole Effluent Toxicity (WET)..... 19

 D. Best Professional Judgment -Based Effluent Limitations..... 19

 E. Summary of Effluent Limitations..... 19

 E. Interim Effluent Limitations – Not Applicable 20

 F. Land Discharge Specifications – Not Applicable 20

 G. Reclamation Specifications for DPs 005, 006, 007, and 008 20

V. Rationale for Receiving Water Limitations and Specifications.....21

 A. Surface Water 21

 B. Groundwater 21

VI. Rationale for Monitoring and Reporting Requirements.....21

 A. Influent Monitoring 21

 B. Effluent Monitoring..... 21

 C. Whole Effluent Toxicity Testing Requirements 22

 D. Receiving Water Monitoring..... 23

 1. Surface Water..... 23

 2. Groundwater – Not Applicable..... 23

 E. Other Monitoring Requirements 23

VII. Rationale for Provisions.....23

 A. Standard Provisions..... 23

 B. Special Provisions 24

VIII. Public Participation.....25

A. Notification of Interested Parties..... 25
B. Written Comments 25
C. Public Hearing 26
D. Waste Discharge Requirements Petitions..... 26
E. Information and Copying 26
F. Register of Interested Persons 26
G. Additional Information..... 26

ATTACHMENT F – FACT SHEET

As described in Section II of this Order, this Fact Sheet includes the legal requirements and technical rationale that serve as the basis for the requirements of this Order.

I. PERMIT INFORMATION

The following table summarizes administrative information related to the facility.

Table 1. Facility Information

WDID	8 330117003
Discharger	City of Riverside/Department of Public Works/City of Riverside
Name of Facility	Riverside Regional Water Quality Control Plant, City of Riverside
Facility Address	5950 Acorn Street
	Riverside, CA 92504
	Riverside County
Facility Contact, Title and Phone	Rodney Cruze, Wastewater Operations Manager, (951) 351-6011
Authorized Person to Sign and Submit Reports	Stephen Schultz, Wastewater Systems Manager, (951) 351-6140
Mailing Address	Same
Billing Address	Same
Type of Facility	POTW
Major or Minor Facility	Major
Threat to Water Quality	1
Complexity	A
Pretreatment Program	Y
Reclamation Requirements	Y
Facility Permitted Flow	40 mgd
Facility Design Flow	40 mgd
Watershed	Santa Ana River
Receiving Water	Reach 3 of Santa Ana River, near Van Buren Bridge
Receiving Water Type	Freshwater – River

- A. The City of Riverside, Department of Public Works (hereinafter Discharger) is the owner and operator of the Riverside Regional Water Quality Control Plant (hereinafter Facility), a public owned wastewater treatment plant with tertiary treatment processes.

- B. The Facility discharges wastewater to Reach 3 of the Santa Ana River, a water of the United States, and is currently regulated by Order No. 01-3, which was adopted on January 19, 2001 and expired on January 1, 2006. The terms and conditions of the current Order have been automatically continued and remain in effect until new Waste Discharge Requirements and NPDES permit are adopted pursuant to this Order.

- C. The Discharger filed a report of waste discharge and submitted an application for renewal of its Waste Discharge Requirements (WDRs) and National Pollutant Discharge Elimination System (NPDES) permit on April 13, 2005. Supplemental Information was requested starting July 8, 2005. The latest supplemental information was received on November 18, 2005. A site visit was conducted on October 12, 2005, to observe operations and collect additional data to develop permit limitations and conditions.

II. FACILITY DESCRIPTION

A. Description of Wastewater and Biosolids Treatment or Controls

The City of Riverside operates the Riverside Regional Water Quality Control Plant (RRWQCP). The RRWQCP is a municipal wastewater treatment plant located on a 105-acre site at 5950 Acorn Street in the City of Riverside, south of the Santa Ana River near the intersection of Van Buren Boulevard. The RRWQCP discharges tertiary treated wastewater to Reach 3 of the Santa Ana River.

The plant started operation in 1946 and underwent major upgrading in 1992. The City completed construction of the Hidden Valley wetlands in March 1995. Approximately 50 acres of constructed wetlands are being used for additional wastewater treatment (nitrogen removal).

The RRWQCP treats wastewater from the City of Riverside and from the following sewerage agencies that have contractual agreements with the City of Riverside: Edgemont Community Services District, Jurupa Community Services District, and Rubidoux Community Services District. The RRWQCP services a population of 319,200.

The RRWQCP is designed to tertiary treat 40 million gallons per day (mgd) of wastewater. In the year 2004, the annual average daily flow discharged from this plant was 33 mgd.

The RRWQCP consists of two secondary treatment plants (Plants 1 and 2), one tertiary treatment plant that treats the flow from both Plants 1 and 2, and solids handling facilities that treat the sludge produced from wastewater treatment.

Influent flows into the RRWQCP are independently metered. Sampling is conducted at influent lines from each service area ahead of and into the common headworks structure of the Facility. The headworks structure consists of barscreens and vortex grit removal. Effluent from the headworks is proportionately channeled to Plant 1 and Plant 2. The following table shows the appurtenant structures in each plant:

Table 2. Facility Capacity

Plant 1: 20 MGD Capacity	Plant 2: 20 MGD Capacity
6 primary sedimentation basins	4 primary sedimentation basins
4 aeration basins w/ anoxic zones	6 aeration basins w/ anoxic zones
4 secondary sedimentation basins	4 secondary sedimentation basins

Prior to tertiary treatment, flows from Plants 1 and 2 are combined in equalization basins. Tertiary treatment consists of alum and/or polymer injection, dual media filtration (16 filters), chlorination (3 chlorine contact tanks), and dechlorination by sodium bisulfite. Tertiary treated wastewater is then discharged to Reach 3 of the Santa Ana River. Currently, a portion of the tertiary treated wastewater is directed through constructed wetland ponds in Hidden Valley for further nitrogen removal. About 0.3 mgd of the tertiary treated and disinfected wastewater is recycled for irrigation in the area overlying the Chino South Groundwater Management Zone.

On-site storm water is collected and returned to Plant 1 secondary aeration basins. Therefore, no storm runoff discharges to off-site storm drains.

Solids handling includes dissolved air flotation (DAF) thickeners, anaerobic digestion (5 digesters), dewatering (2 belt presses and centrifuge) and air-drying as required.

B. Discharge Points and Receiving Waters

1. Discharge Points

RRWQCP discharges tertiary treated wastewater to the Santa Ana River, Reach 3 at four points designated Discharge Point (DP) 001, 002, 003, and No. 004, see Attachments B and C. The Discharger constructed a sandy/earthen bermed channel in the river along the riverbank to the wetland ponds in Hidden Valley. The earthen bermed channel and wetland ponds are considered part of the wastewater treatment system. The discharge flow path is described as follows: wastewater from the Facility is discharged at DP 001 into an earthen channel that leads to a splitter box where the waste stream is split into two: one stream discharges directly into the river (DP 002) and the other goes to Structure 2. At Structure No. 2, the waste stream is again split into two: one stream goes to a metering structure, which leads to DP 004, while the other goes to 14 wetland ponds, which lead to DP 003. The Discharger delivers recycled water to four users for irrigation of trees, lawn, golf course, and a farm, and for supply of recycled water to Riverside Resource Center at DP 005, DP 006, DP 007, and DP 008.

Table 3. Summary of Discharge Points

Discharge Serial No.	Latitude	Longitude	Description	Flow & Frequency
001	33°57'55"	117°27'28"	Direct discharge of tertiary treated effluent into the River when earthen channel is washed out or direct discharge of secondary treated effluent into the River when there is 20:1 dilution	33 mgd 5 times per year, average duration of each discharge 10 days
002	33°57'48"	117°28'30"	Direct discharge of tertiary treated effluent into the River when earthen channel exists	20 mgd for 315 days per year
003	33°57'48"	117°29'52"	Tertiary treated effluent - Split from structure 2 via 14 wetland ponds, then to River	9-10 mgd for 315 days per year

Discharge Serial No.	Latitude	Longitude	Description	Flow & Frequency
004	33°57'44"	117°29'7.29"	Tertiary treated effluent - Split from structure 2, North channel bypass to horseshoe pond, then to farmer's field, then to Reach 3 of Santa Ana River. Effluent commingles with Hole Lake flows.	1.5 mgd for 150 days from May to September
005	33°57'50.22"	117°27'13.8"	Recycled water for Riverside Energy Resource Center	100-200 days per year and use between 250,000 and 500,000 gal/day All water will be used in the operation.
006	33°57'35"	117°27'46"	Recycled water for urban forest irrigation	0.0023 mgd for 250 days per year
007	33°57'33"	117°27'41"	Recycled water for Golf course irrigation	0.13 mgd for 330 days per year
008	33°57'49"	117°27'41"	Recycled water for lawn irrigation at Toro company	0.16 mgd for 330 days per year

The facility location is shown in Attachment "B" of this Order.

A schematic diagram of the treatment process and discharge points is shown in Attachment "C-1" of this Order. A map for wetland ponds for DP 001 through DP 004 is shown in Attachment "C-2" of this Order.

2. Receiving Surface Water

Approximately two thirds of the tertiary treated waste water effluent flow from the plant is discharged into Reach 3 of the Santa Ana River and the remaining flow is diverted to the Hidden Valley Wetlands for further nitrogen removal before final disposal into the River, downstream of the Van Buren Bridge. The Santa Ana River is a water of the US.

3. Receiving Groundwater

Recycled water for irrigation is used in the area overlying the Chino South Groundwater Management Zone.

C. Summary of Existing Requirements and Self-Monitoring Report (SMR) Data

Effluent limitations/Discharge Specifications contained in the existing Order No. 01-3 for discharges from Discharge Point 001 (Monitoring Location No. M-001) and representative monitoring data from the term of the previous Order are as follows:

Table 4a. Historic Effluent Limitations and Monitoring Data

Parameter (units)	Effluent Limitation			Monitoring Data (From January 1, 2002 – To December 31, 2004)			
	Average Monthly or as noted herein	Average Weekly	Maximum Daily	Highest Average Monthly Discharge	Highest Average Weekly Discharge	Highest Daily Discharge	Highest 12-Month Average
BOD ₅ (mg/L)	20	30		5	5	6.0	
Suspended Solids (mg/L)	20	30		4	4	12.0	
Electrical conductivity				1042		1088	
TDS (mg/L)	12 month - 650						587
Total Inorganic Nitrogen (mg/L)	12 month - 13						11.2
Chloride (mg/L)						122	
Iron (mg/L)						.327	
Manganese (mg/L)						.032	
Sodium (mg/L)						111	
Sulfate(mg/L)						104	
Fluoride (mg/L)						.74	

Table 4b. Historic Effluent Limitations and Monitoring Data

Parameter (units)	Effluent Limitation			Monitoring Data (From January 1, 2002 – To December 31, 2005)		
	Average Monthly	Average Weekly	Maximum Daily	Highest Average Monthly Discharge	Highest Average Weekly Discharge	Highest Daily Discharge
Antimony (µg/L)						N/A
Arsenic (µg/L)						<0.2
Beryllium (µg/L)						N/A
Boron (µg/L)						.406
Cadmium (µg/L)						<0.1
Chromium-Total Cr, (µg/L)						22.0
Lead (µg/L)						8.0
Mercury (µg/L)						0.9
Nickel (µg/L)						18.0
Selenium (µg/L)						2.0
Silver (µg/L)						<0.1
Thallium (µg/L)						N/A
Zinc (µg/L)						79.0
Copper (µg/L)	41.2		82.7			24.6

Table 4b. Historic Effluent Limitations and Monitoring Data

Parameter (units)	Effluent Limitation			Monitoring Data (From January 1, 2002 – To December 31, 2005)		
	Average Monthly	Average Weekly	Maximum Daily	Highest Average Monthly Discharge	Highest Average Weekly Discharge	Highest Daily Discharge
Cyanide						20
Bromodichloromethane						
Chloroethane						
Chloroform						28.0
Chloromethane						
Dibromochloromethane						
Ammonia Nitrogen	5.0					6.1 [#]

[#] plant upset August 2004

D. Compliance Summary

The Discharger was in compliance with discharge limitations and monitoring and reporting requirements except for the following exceedances:

1. June 2002 Report:
Chlorine Residual – one violation to the limit for chlorine residual on June 8, due to a failure of the motor-driven SO₂ gas injection unit. We exceeded the 30-minute limit on excursions as the chlorine residual remained above 0.1 mg/L for 61 minutes and 26 second, but the residual peaked at 1.14 mg/L.
2. June 2003 Report:
Coliform limit – one violation of the 23/100 ml coliform limit (within 30 days) as two samples of the effluent resulted in a value of 30/100 ml with four days (June 22 and June 26, 2003).
3. August 2004 Report:
We failed to meet the monthly average ammonia nitrogen limit for this month. This was initially reported on September 17 followed by a detailed report on September 23, 2004.
4. January 2005 Report:
Chlorine Residual – failed to meet requirement of paragraph G.6.b. of our permit for Chlorine residual on January 2 (0.200 mg/L for 45 minutes) due to de-chlorination process failure.
5. February 2005 Report:
pH violation – During our 20:1 dilution bypass, the pH level dropped to 6.41 SU on February 21, 2005. This condition persisted for approximately 2 ½ hours.
6. In October and November 2005, there were two sewage spills in the City’s lift station at Wood Road pump station.

E. Planned Changes

The following projects are presently scheduled for initiation or completion within this permit cycle:

1. Replacement of plant 1 primaries – planning to begin within 1 year.
2. Secondary treatment expansion – planning to begin within 1 year.
3. Refurbish Chlorine Contact Basin #2 for possible use on reclaimed water – 1 year.
4. Construct new recycled water pump station – completion in 1-2 years.
5. Installation of new centrifuge for solids dewatering – completion within 1 year.
6. Replacement of influent flow meters – project to begin in 2 years.
7. Install new waste-gas flare – 1-2 years.
8. Institute restaurant grease treatment program to increase digester gas production - within 6 months.
9. Construct gas storage system – in discussion stage.

A Master Plan revision will be performed during this period. The results of that engineering assessment may modify present priorities and identify new ones. The City will provide updates as they become available.

III. APPLICABLE PLANS, POLICIES, AND REGULATIONS

The requirements contained in the proposed Order are based on the requirements and authorities described in this section.

A. Legal Authorities

This Order is issued pursuant to Section 402 of the Federal Clean Water Act (CWA) and implementing regulations adopted by the U.S. Environmental Protection Agency (USEPA) and Chapter 5.5, Division 7 of the California Water Code (CWC). It shall serve as a NPDES permit for point source discharges from this facility to surface waters. This Order also serves as Waste Discharge Requirements (WDRs) pursuant to Article 4, Chapter 4 of the CWC.

B. California Environmental Quality Act (CEQA)

This action to adopt an NPDES permit is exempt from the provisions of Chapter 3 of Division 13 of the Public Resources Code in accordance with Section 13389 of the CWC.

C. State and Federal Regulations, Policies, and Plans

- 1. Water Quality Control Plans.** The Regional Water Board adopted a Water Quality Control Plan for the Santa Ana Basin (hereinafter Basin Plan) on January 24, 1995. The Basin Plan designates beneficial uses, establishes water quality objectives, and contains implementation programs and policies to achieve those objectives for all waters addressed through the plan. In addition, State Water Resources Control Board (State Water Board) Resolution No. 88-63 (Sources of Drinking Water Policy) requires that, with certain exceptions, the Regional Water Board assign the municipal and domestic water supply use to water bodies. Based on the exception criteria specified in Resolution No. 88-63, the Regional Board excepted Reach 3 of the Santa Ana River and downstream reaches from the municipal and domestic supply beneficial use.

On January 22, 2004, the Regional Water Board adopted Resolution No. R8-2004-0001, amending the Basin Plan to incorporate revised boundaries for groundwater subbasins, now termed “management zones”, new nitrate-nitrogen and TDS objectives for the new management zones, and new nitrogen and TDS management strategies applicable to both surface and ground waters. The State Water Resources Control Board and Office of Administrative Law (OAL) approved the N/TDS Amendment on September 30, 2004 and December 23, 2004, respectively. The surface water standards components of the N/TDS Amendment are awaiting EPA approval. Effluent limitations for TDS and TIN in this Order are based on applicable surface water components of the N/TDS Amendment (i.e., N and TDS wasteload allocations) and are at least as stringent as the limits in the prior Order.

As previously discussed, the Facility discharges into Reach 3 of the Santa Ana River and affects downstream receiving surface and ground waters. The beneficial uses of these affected waterbodies are as follows:

Table 5. Basin Plan Beneficial Uses

Discharge Point	Receiving Water Name	Beneficial Use(s)
001, 002, 003, and 004	Reach 3 of Santa Ana River	<u>Present or Potential:</u> Agricultural supply, groundwater recharge, water contact recreation, non-contact water recreation, warm freshwater habitat, wildlife habitat, and rare, threatened or endangered species.
006, 007, 008	Chino South Groundwater management zone	<u>Present or Potential:</u> Municipal and domestic supply, agricultural supply, industrial service supply, and industrial process supply.
001, 002, 003, and 004	Downstream groundwater management zone (Orange)	<u>Present or Potential:</u> Municipal and domestic supply, agricultural supply, industrial service supply, and industrial process supply.

- 3 **National Toxics Rule (NTR) and California Toxics Rule (CTR).** USEPA adopted the NTR on December 22, 1992, and later amended it on May 4, 1995 and November 9, 1999. About forty criteria in the NTR applied in California. On May 18, 2000, USEPA adopted the CTR, which incorporated the NTR criteria that were applicable in California. The CTR was amended on February 13, 2001. These rules contain water quality criteria for priority pollutants.
4. **State Implementation Policy.** On March 2, 2000, the State Water Board adopted the *Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California* (State Implementation Policy or SIP). The SIP became effective on April 28, 2000 with respect to the priority pollutant criteria promulgated for California by the USEPA through the NTR and to the priority pollutant objectives established by the Regional Water Board in the Basin Plan. The SIP became effective on May 18, 2000 with respect to the priority pollutant criteria promulgated by the USEPA through the California Toxics Rule. The State Water Board adopted amendments to the SIP on February 24, 2005 that became effective on July 13, 2005.
5. **Alaska Rule.** On March 30, 2000, USEPA revised its regulation that specifies when new and revised State and Tribal water quality standards (WQS) become effective for CWA purposes (40 CFR 131.21, 65 FR 24641, April 27, 2000). Under the revised regulation (also known as the Alaska rule), new and revised standards submitted to USEPA after May 30, 2000, must be approved by USEPA before being used for CWA purposes. The final rule also provides that standards already in effect and submitted to USEPA by May 30, 2000, may be used for CWA purposes, whether or not approved by USEPA.
- 6 **Antidegradation Policy.** Section 131.12 of 40 CFR requires that State water quality standards include an antidegradation policy consistent with the federal policy. The State Water Board established California's antidegradation policy in State Water Board Resolution 68-16, which incorporates the requirements of the federal antidegradation policy. Resolution 68-16 requires that existing water quality is maintained unless degradation is justified based on specific findings. As discussed in this Fact Sheet, the permitted discharge is consistent with the antidegradation provision of 40 CFR §131.12 and State Water Board Resolution 68-16.
7. **Anti-Backsliding Requirements.** Sections 402(o)(2) and 303(d)(4) of the CWA and 40 CFR §122.44(l) prohibit backsliding in NPDES permits. These anti-backsliding provisions require that effluent limitations in a reissued permit must be as stringent as those in the previous permit, with some exceptions in which limitations may be relaxed. All effluent limitations in the Order are at least as stringent as the effluent limitations in the previous Order.
8. **Monitoring and Reporting Requirements.** Section 122.48 of 40 CFR requires that all NPDES permits specify requirements for recording and reporting monitoring results. Sections 13267 and 13383 of the CWA authorizes the Regional Water Board to require technical and monitoring reports. The Monitoring and Reporting Program (MRP) establishes monitoring and reporting requirements to implement federal and State requirements. This MRP is provided in Attachment E.

D. Impaired Water Bodies on CWA 303(d) List - Not Applicable

E. Other Plans, Polices and Regulations - Not Applicable

IV. RATIONALE FOR EFFLUENT LIMITATIONS AND DISCHARGE SPECIFICATIONS

The CWA requires point source discharges to control the amount of conventional, non-conventional, and toxic pollutants that are discharged into the waters of the United States. The control of pollutants discharged is established through effluent limitations; and other requirements in NPDES permits. There are two principal bases for effluent limitations: 40 CFR §122.44(a) requires that permits include applicable technology-based limitations and standards; and 40 CFR §122.44(d) requires that permits include water quality-based effluent limitations to attain and maintain applicable numeric and narrative water quality criteria to protect the beneficial uses of the receiving water. Where numeric water quality objectives have not been established, three options exist to protect water quality: 1) 40 CFR §122.44(d) specifies that WQBELs may be established using USEPA criteria guidance under CWA Section 304(a); 2) proposed State criteria or a State policy interpreting narrative criteria supplemented with other relevant information may be used; or 3) an indicator parameter may be established.

A. Discharge Prohibitions

1. The discharge prohibitions are based on the Federal Clean Water Act, Basin Plan, State Water Resources Control Board's plans and policies, U.S. Environmental Protection Agency guidance and regulations, and previous permit Order No. 01-3 provisions and are consistent with the requirements set for other discharges regulated by NPDES permits adopted by the Regional Water Board.

B. Technology-Based Effluent Limitations

1. Scope and Authority

Regulations promulgated in 40 CFR §125.3(a)(1) require technology-based effluent limitations for municipal Dischargers to be placed in waste discharge requirements based on Secondary Treatment Standards or Equivalent to Secondary Treatment Standards.

The Federal Water Pollution Control Act Amendments of 1972 (PL 92-500) established the minimum performance requirements for POTWs [defined in Section 304(d)(1)]. Section 301(b)(1)(B) of that Act requires that such treatment works must, as a minimum, meet effluent limitations based on secondary treatment as defined by the USEPA Administrator.

Based on this statutory requirement, USEPA developed secondary treatment regulations, which are specified in 40 CFR Part 133. These technology-based regulations apply to all municipal wastewater treatment plants and identify the minimum level of effluent quality attainable by secondary treatment in terms of biochemical oxygen demand (BOD₅), total suspended solids (TSS), and pH.

2. Applicable Technology-Based Effluent Limitations

This facility meets the technology-based regulations for the minimum level of effluent quality attainable by secondary treatment in terms of BOD₅, total suspended solids and removal rate as summarized in Table 6, below. These effluent limitations have been carried over from the previous Order for secondary treated wastewater discharge under conditions of 20:1 dilution provided by natural flow in the river.

Table 6. Summary of Technology-based Effluent Limitations under 20:1 Dilution

Constituent	Average Weekly (mg/L)	Average Monthly (mg/L)	Average Monthly Removal Rate %
Biochemical Oxygen Demand, 5-day 20°C	45	30	85
Total Suspended Solids	45	30	85

C. Water Quality-Based Effluent Limitations (WQBELs)

1. Scope and Authority

As specified in 40 CFR Section 122.44(d)(1)(i), permits are required to include WQBELs for pollutants (including toxicity) that are or may be discharged at levels that cause, have reasonable potential to cause, or contribute to an in-stream excursion above any State water quality standard. The process for determining reasonable potential and calculating WQBELs when necessary is intended to protect the designated uses of the receiving water as specified in the Basin Plan, and achieve applicable water quality objectives and criteria that are contained in other State plans and policies, or any applicable water quality criteria contained in the CTR and NTR.

2. Applicable Water Quality Criteria and Objectives

- a. The Basin Plan specifies narrative and numeric water quality objectives applicable to this discharge:

Table 7a. Summary of Applicable Basin Plan Water Quality Objectives

Constituents	Basis for Limitations
Ammonia Nitrogen	Dissociates under certain conditions to the toxic un-ionized form. Thus nitrogen discharges to the Santa Ana River pose a threat to aquatic life and instream beneficial uses, as well as to the beneficial uses of affected groundwater. The Basin Plan specifies total ammonia and un-ionized ammonia objectives and an effluent limit of 5 mg/L for discharges to certain waters.
Hydrogen Ion (pH)	Hydrogen Ion (pH) is a measure of Hydrogen Ion concentration in the water. A pH range of 6.5 to 8.5 for surface water discharges is specified.
Oil & Grease	Oil and related materials have a high surface tension and are not soluble in water, resulting in odors and visual impacts.
Total Chlorine Residual	Chlorine and its reaction product are toxic to aquatic life. To protect aquatic life, the Basin Plan specifies that for wastewater discharged into inland surface waters the chlorine residual should not exceed 0.1 mg/L.
Total Dissolved Solids	High levels of TDS can adversely impact aquatic life. The TDS limit for surface water discharges is based on the amended Basin Plan <u>wasteload allocation of 650 mg/L at 40 mgd flow.</u>
Total Inorganic Nitrogen	Nitrogen discharges to the Santa Ana River pose a threat to aquatic life and instream beneficial uses, as well as to the beneficial uses of affected groundwater. The TIN limit for surface water discharges is based on the amended Basin Plan wasteload allocation of 13 mg/L <u>for flows up to 38 mgd; flows above 38 mgd are held to 10 mg/L.</u>

This Order also includes a TDS limit based on the quality of the water supplied to the service area plus a reasonable use increment for TDS of 250 mg/L. This reasonable use increment is discussed and authorized in the Basin Plan. The more restrictive of the TDS wasteload allocation-based limit or the TDS limit based on water quality plus a reasonable use increment applies to discharges from the facility.

In accordance with 40 CFR Section 122.45(d), there may be instances in which the basis for a limit for a particular continuous discharge may be impracticable to be stated as a maximum daily, average weekly, or average monthly effluent limitation. The Regional Water Board has determined that it is not practicable to express TDS and TIN effluent limitations as average weekly and average monthly effluent limitations because the TDS and TIN objectives in the Basin Plan were established primarily to protect the underlying groundwater. Consequently, a 12-month average period is believed to be more appropriate.

b. CTR and SIP

The California Toxics Rule (CTR) and State Implementation Policy specify numeric objectives for toxic substances and the procedures whereby these objectives are to be implemented. The procedures include those used to conduct reasonable potential analysis to determine the need for effluent limitations for priority and non-priority pollutants.

c. Requirement to meet 2.2 total coliform bacteria limit in the effluent

Article 3, Section 60305 of Title 22, Chapter 3, "Use of Recycled water for impoundments" of the California Code of Regulations specifies that recycled water used as a source of supply in a nonrestricted recreational impoundment shall be at all times an adequately disinfected, oxidized, coagulated, clarified, filtered wastewater (tertiary treated). The degree of treatment specified represents an approximately 5-log reduction in the virus content of the water. The California State Department of Health Services (CDHS) has determined that this degree of virus removal is necessary to protect the health of people using these impoundments for water contact recreation. The CDHS has developed wastewater disinfection guidelines ("Wastewater Disinfection for Health Protection", Department of Health Services, Sanitary Engineering Branch, February 1987) for discharges of wastewater to surface waters where water contact recreation (REC-1) is a beneficial use. The disinfection guidelines recommend the same treatment requirements for wastewater discharges to REC-1 waters as those stipulated in Title 22 for supply of recycled water to nonrestricted recreational impoundments, since the public health risks under both scenarios are analogous. The disinfection guidelines are based on sound science and are widely used as guidance to assure public health and beneficial use protection.

Santa Ana River, Reach 3 is not a "nonrestricted recreational impoundment," nor is "recycled water¹" being used as a supply source for the River pursuant to the definitions in Title 22. However, except during major storms, most of the flow in the River is composed of treated municipal wastewater discharges. The River is used for water contact recreation and, accordingly, is designated REC-1 (water contact beneficial use). People recreating in the River face an exposure similar to those coming in contact with recycled water in an impoundment. Therefore, to protect the water contact recreation beneficial use and to prevent nuisance and health risk, it is necessary and appropriate to require the same degree of treatment for wastewater discharges to the River as would be required for the use of recycled water in a nonrestricted recreational impoundment. Thus, this Order specifies requirements based on tertiary or equivalent treatment.

d. Discharge of secondary treated and disinfected wastewater when the natural flows in the river provide at least 20:1 dilution:

¹ *As defined in the Reclamation Criteria, recycled water means water which, as a result of treatment of domestic wastewater, is suitable for a direct beneficial use or a controlled use that would not otherwise occur.*

The Department of Health Services has determined that public health and water contact recreation (REC-1) beneficial uses will be protected provided that at least 20:1 dilution of secondary treated and disinfected wastewater discharges by natural receiving waters is achieved ("Wastewater Disinfection Guidelines Feb. 1987; these guidelines are based on sound science and are widely used as guidance to assure public health and beneficial use protection). Based on best professional judgment of the effluent limitations necessary to prevent nuisance and to assure public health and REC-1 use protection, it is necessary and appropriate to implement these guidelines in this Order.

The Santa Ana River is not naturally perennial. In dry weather, flow in the Santa Ana River is comprised predominantly of effluent discharges from municipal wastewater treatment facilities (POTWs), and very little natural flow exists. Under storm conditions, 20:1 (natural receiving waters to effluent) dilution of the effluent by storm flows may be provided. These storm conditions may also threaten the operational safety of the wastewater treatment facility through influx of infiltrated storm flows into the sanitary sewer system. The discharge of secondary effluent when 20:1 dilution is provided by the receiving waters may be necessary to protect the integrity of these facilities.

3. Determining the Need for WQBELs

In accordance with Section 1.3 of the SIP, the Regional Water Board conducted a reasonable potential analysis (RPA) for each priority pollutant with an applicable criterion or objective to determine if a WQBEL is required in the Order. The Regional Water Board analyzed effluent data to determine if a pollutant in a discharge has the reasonable potential to cause or contribute to an excursion above a state water quality standard. For all parameters that have the reasonable potential to cause or contribute to an excursion above a water quality standard, numeric WQBELs are required. The RPA considers criteria from the CTR, and when applicable, water quality objectives specified in the Basin Plan.

Sufficient data are needed to conduct a complete RPA. If data are not sufficient, the Discharger will be required to gather the appropriate data for the Regional Water Board to conduct the RPA. Upon review of the data, and if the Regional Water Board determines that WQBELs are needed to protect the beneficial uses, the permit will be reopened for appropriate modification.

The RPA was performed for the priority pollutants for which effluent data were available. These data were used in the RPA and are summarized in the following Table. The priority pollutant cyanide was determined to have reasonable potential to exceed water quality objectives. Consequently, effluent limitations for that constituent are included in this Order

Table 7d is a summary of the RPA evaluation for cyanide using monitoring data submitted by the Discharger.

Table 7d. RPA Evaluation

<u>Parameter</u>	<u>Unit</u>	<u>Effluent</u>	<u>CTR</u>		<u>Is Effluent Limit Required?</u>	
		<u>MEC</u>	<u>CMC</u>	<u>CCC</u>	<u>CMC</u>	<u>CCC</u>
Cyanide	µg/L	12	22	5.2	No	Yes

4. WQBEL Calculations

Total Chlorine Residual: For discharges under conditions of 20:1 or more dilution , the total chlorine residual effluent limitation in Section IV.A.3.a. is calculated using the equation specified in the State Implementation Policy Section 1.4 - Calculation of Effluent Limitation:

ECA, mg/L = C + D x (C-B) where:

ECA= Effluent Concentration allowance/effluent limit

B= Ambient background concentration

C= Criterion/objective

D= Dilution Credit

$$ECA = 0.1 + 20 \times (0.1 - 0) = 2.1 \text{ mg/L}$$

For priority pollutants, water quality based effluent limits are based on monitoring results and the calculation process outlined in Section 1.4 of the California Toxic Rule and the Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays and Estuaries of California are summarized in the following tables.

Table 7f – Effluent limit calculation.

Riverside Water Quality Control Plant

Unit $\mu\text{g/L}$

Constituent	Caltoxics				CV = 0.6			Aquatic		Human		Permit Limit	
	Freshwater		Human Health		Acute M	Chronic M	LTA	Objective/limits		Health Limits		Concentration Limit	
	CMC	CCC	H2O+Org	Org only	Acute LTA	Chronic LTA		MDEL	AMEL	MDEL	AMEL	MDEL	AMEL
Cyanide	22.00	5.20			7.06	2.74	2.74	8.52	4.25			8.5	4.2

5. Whole Effluent Toxicity (WET)

This Order does not specify WET limits. The monitoring data indicated that all chronic toxicity results were less than TUC of 1. See Section VI.C, below.

D. Best Professional Judgment -Based Effluent Limitations

- 1) For tertiary treated wastewater, the BOD₅ and TSS concentration limits are based on Best Professional Judgment. The secondary treatment standards specify BOD₅ and TSS concentration limits that are less stringent.

Table 7c. Tertiary Effluent BOD₅ and TSS Limits

Constituent	Average Weekly	Average Monthly	Average Weekly Emission Rate ² lbs/day	Average Monthly Emission Rate
Biochemical Oxygen Demand	30 mg/L	20 mg/L	10,008 lbs/day	6,672 lbs/day
Suspended Solids	30 mg/L	20 mg/L	10,008 lbs/day	6,672 lbs/day

E. Summary of Effluent Limitations

Table 7g. Summary of Water Quality-based Effluent Limitations for DP 001, 002, 003 and 004

Parameter	Units	Effluent Limitations					Basis
		Average Monthly or as noted herein	Average Weekly	Max Daily	Instantaneous Minimum	Instantaneous Maximum	
Ammonia-Nitrogen	mg/L	5.0					BP
BOD ₅	mg/L	20	30	--	--	--	CO
pH	Std. unit	--	--	--	6.5	8.5	BP
TDS	mg/L	650 (12-M avg)					BP
TIN	mg/L	12-m avg 13					BP
Total Suspended Solids	mg/L	20	30	--	--	--	CO
Total Residual Chlorine	mg/L	--	--		--	0.1	BP, CO
Cyanide	µg/L	4.2		8.5			CTR, SIP
Coliform	MPN/ 100mL		2.2 Medium in 7 day				CO

² Except for TDS and TIN, mass emission rates are based on 40 mgd.

Parameter	Units	Effluent Limitations					Basis
		Average Monthly or as noted herein	Average Weekly	Max Daily	Instantaneous Minimum	Instantaneous Maximum	
Coliform	MPN/100mL		23 No more than one in 30 day				“
Coliform	MPN/100mL		240 Not one				“

Notes: CO= Current Order; BP= Basin Plan

E. Interim Effluent Limitations – Not Applicable

F. Land Discharge Specifications – Not Applicable

G. Reclamation Specifications for DPs 005, 006, 007, and 008

1. Section 13523 of the California Water Code provides that a Regional Water Board, after consulting with and receiving the recommendations from the CDHS and any party who has requested in writing to be consulted, and after any necessary hearing, shall prescribe water reclamation requirements for water which is used or proposed to be used as recycled water, if, in the judgment of the Board, such requirements are necessary to protect the public health, safety, or welfare. Section 13523 further provides that such requirements shall include, or be in conformance with, the statewide uniform water recycling criteria established by the CDHS pursuant to California Water Code Section 13521.
2. Reclamation specifications in the proposed Order are based on the recommendations from CDHS in accordance with recycling criteria contained in Title 22, Division 4, Chapter 3, Sections 60301 through 60355, California Code of Regulations, “Guidelines for Use of Reclaimed Water” by CDHS, and the California Water Code Section 13521.
3. Discharges from this facility to Reach 3 of the Santa Ana River affect the Chino South Groundwater Management Zone. Analyses conducted as part of the development of the revised nitrogen and TDS wasteload allocations in the N/TDS Amendment demonstrated that the wasteload allocations identified in the Amendment for the RWQCP were adequate to protect groundwater quality affected by RWQCP discharges. This Order includes surface water discharge limitations for TDS and total inorganic nitrogen based on these wasteload allocations. These limits are adequate to protect affected groundwater.

V. RATIONALE FOR RECEIVING WATER LIMITATIONS AND SPECIFICATIONS

A. Surface Water

1. The surface water receiving water limitations in the proposed Order are based upon the water quality objectives contained in the Basin Plan.

B. Groundwater

1. The groundwater water receiving water limitations in the proposed Order are based upon the water quality objectives contained in the Basin Plan.

VI. RATIONALE FOR MONITORING AND REPORTING REQUIREMENTS

Section 122.48 of 40 CFR requires all NPDES permits to specify recording and reporting of monitoring results. Sections 13267 and 13383 of the California Water Code authorize the Water Boards to require technical and monitoring reports. The Monitoring and Reporting Program, Attachment E of this Order, establishes monitoring and reporting requirements to implement federal and state requirements. The following provides the rationale for the monitoring and reporting requirements contained in the Monitoring and Reporting Program for this facility.

A. Influent Monitoring

Influent monitoring is required to determine the effectiveness of the treatment process, assess treatment plant performance and protect treatment operation.

This Order carries forward the treatment plant influent monitoring requirements without change.

B. Effluent Monitoring

The Discharger is required to conduct monitoring of the permitted discharges in order to evaluate compliance with permit conditions. Monitoring requirements are given in the proposed monitoring and reporting program (Attachment E). This provision requires compliance with the monitoring and reporting program, and is based on 40 CFR 122.44(i), 122.62, 122.63 and 124.5. The SMP is a standard requirement in almost all NPDES permits (including the proposed Order) issued by the Regional Water Board. In addition to containing definitions of terms, it specifies general sampling/analytical protocols and the requirements of reporting of spills, violations, and routine monitoring data in accordance with NPDES regulations, the California Water Code, and Regional Water Board's policies. The monitoring and reporting program also contains sampling program specific for the Discharger's wastewater treatment plant. It defines the sampling stations and frequency, pollutants to be monitored, and additional reporting requirements. Pollutants to be monitored include all pollutants for which effluent limitations are specified. Further, in accordance with Section 1.3 of the SIP, periodic monitoring is required for all priority pollutants defined by the CTR, for which criteria apply and for which no effluent limitations have been established, to evaluate reasonable potential to cause or contribute to an excursion above a water quality standard.

This Order requires the Discharger to conduct a priority pollutant scan once annually. This Order also requires the Discharger to conduct accelerated monitoring for those constituents that are detected in the annual priority pollutant scan.

C. Whole Effluent Toxicity Testing Requirements

Whole effluent toxicity (WET) protects the receiving water quality from the aggregate toxic effect of a mixture of pollutants in the effluent. WET tests measure the degree of response of exposed aquatic test organisms to an effluent. The WET approach allows for protection of the narrative “no toxics in toxic amounts” criterion while implementing numeric criteria for toxicity. There are two types of WET tests: acute and chronic. An acute toxicity test is conducted over shorter time period and measures mortality. A chronic toxicity test is conducted over a longer period of time and may measure mortality, reproduction, and growth.

The Basin Plan specifies a narrative objective for toxicity, requiring that all waters be maintained free of toxic substances in concentrations that are lethal to or produce other detrimental response on aquatic organisms. Detrimental response includes but is not limited to decreased growth rate, decreased reproductive success of resident or indicator species, and/or significant alterations in population, community ecology, or receiving water biota.

In addition to the Basin Plan requirements, Section 4 of the SIP states that a chronic toxicity effluent limitation is required in permits for all discharges that will cause, have the reasonable potential to cause, or contribute to chronic toxicity in receiving waters. Therefore, in accordance with the SIP, this Order requires the Discharger to conduct chronic toxicity testing. In addition, the Order establishes thresholds that when exceeded requires the Discharger to conduct accelerated toxicity testing and/or conduct toxicity identification evaluation (TIE) studies.

This Order requires the Discharger to conduct chronic toxicity testing of the effluent on a monthly basis. The Order also requires the Discharger to conduct an Initial Investigation Toxicity Reduction Evaluation (IITRE) program when either the two-month median of toxicity test results exceeds 1 TUc or any single test exceeds 1.7 TUc for survival endpoint. Based on the results of this investigation program and at the discretion of the Executive Officer, a more rigorous Toxicity Reduction Evaluation/Toxicity Identification Evaluation (TRE/TIE) may be required. A re-opener provision is included in the Order to incorporate a chronic toxicity effluent limitation if warranted by the toxicity test results.

D. Receiving Water Monitoring

1. Surface Water

- a. For discharges of secondary treated and disinfected effluent when 20:1 or more dilution is provided by the creek at the point of discharge, the Order requires the Discharger to establish a sampling station(s) at a suitable location(s) where the flow³ in the River at the point of discharge can be determined. The Order also requires that flow measurements in the river are made prior to any direct discharge to the river and shall continue on a daily basis until the discharge is terminated.
- b. Receiving water monitoring is required to determine compliance with receiving water limitations and to characterize the water quality of the receiving water. Requirements are based on the Basin Plan.

2. Groundwater – Not Applicable

E. Other Monitoring Requirements

1. **Water Supply Monitoring** - The Discharger will be required to collect a sample of each source of water supplied and analyze for total dissolved solids. The result of this monitoring will show compliance with TDS limitations in the Order.
2. **Biosolids Monitoring** - This Order continues the monitoring requirements specified in Order No. 01-3, with minor modification.
3. **Pretreatment Monitoring** - These monitoring and reporting requirements are established pursuant EPA 40 CFR 403 regulations.

VII. RATIONALE FOR PROVISIONS

A. Standard Provisions

Standard Provisions, which in accordance with 40 CFR §§122.41 and 122.42, apply to all NPDES discharges and must be included in every NPDES permit, are provided in Attachment D to the Order.

Title 40 CFR Section 122.41(a)(1) and (b) through (n) establish conditions that apply to all state-issued NPDES permits. These conditions must be incorporated into the permits either expressly or by reference. If incorporated by reference, a specific citation to the regulations must be included in the Order. 40 CFR Section 123.25(a)(12) allows the State to omit or modify conditions to impose more stringent requirements. In accordance with Section 123.25, this Order omits federal conditions that address enforcement authority specified in 40 CFR Sections 122.41(j)(5) and (k)(2) because the enforcement authority under the CWC is more stringent. In lieu of these conditions, this Order incorporates by reference CWC section 13387(e).

³ *Exclusive of discharges to surface waters from upstream publicly owned treatment works.*

B. Special Provisions

1. Reopener Provisions

This provision is based on 40 CFR Part 123. The Regional Water Board may reopen the permit to modify permit conditions and requirements. Causes for modifications include the promulgation of new regulations, modification in sludge use or disposal practices, or adoption of new regulations by the State Board or Regional Water Board, including revisions to the Basin Plan.

2. Special Studies and Additional Monitoring Requirements

- a. Toxicity Identification Evaluations or Toxicity Reduction Evaluations. This provision is based on the SIP, Section 4, Toxicity Control Provisions.
- b. Antidegradation Analysis. This provision is based on State Water Resources Control Board Resolution No. 68-16, which requires the Board in regulating the discharge of waste to maintain high quality waters of the state (the Discharger must demonstrate that it has implemented adequate controls (e.g., adequate treatment capacity) to ensure that high quality waters will be maintained.
- c. To assure that discharges occur only when the receiving waters can provide 20:1 dilution, the Order requires the Discharger to make provisions for the measurement of the receiving water flow at a suitable location with the Santa Ana River and determine whether a 20:1 dilution exists at the point of discharge before discharging secondary treated effluent.

3. Best Management Practices and Pollution Prevention- The requirements are based on the SIP Section 2.4.5.1

4. Construction, Operation, and Maintenance Specifications - The requirements are based on requirements that were specified in the prior Order.

5. Special Provisions for Municipal Facilities (POTWs Only)

- a. Biosolids: On February 19, 1993, the USEPA issued a final rule for the use and disposal of sewage sludge, 40 CFR, Part 503. This rule requires that producers of sewage sludge meet certain reporting, handling, and disposal requirements. The State of California has not been delegated the authority to implement this program, therefore, the U.S. Environmental Protection Agency is the implementing agency.
- b. Oxidized and Filtered Wastewater Requirements: These requirements are based on Title 22 requirements for the use of recycled water.

- c. Pretreatment: The treatment plant capacity is 40 mgd and there are significant industrial users within the service areas. Consequently, this Order contains requirements for the implementation of an effective pretreatment program pursuant to Section 307 of the Federal Clean Water Act; Parts 35 and 403 of Title 40, Code of Federal Regulations (40 CFR 35 and 40 CFR 403); and/or Section 2233, Title 23, California Code of Regulations.
6. Other Specific Provision – Not Applicable
 7. Compliance Schedules – Not Applicable

VIII. PUBLIC PARTICIPATION

The California Regional Water Quality Control Board, Santa Ana Region (Regional Water Board) is considering the issuance of waste discharge requirements (WDRs) that will serve as a National Pollutant Discharge Elimination System (NPDES) permit for the Riverside Regional Water Quality Control Plant. As a step in the WDR adoption process, the Regional Water Board staff has developed tentative WDRs. The Regional Water Board encourages public participation in the WDR adoption process.

A. Notification of Interested Parties

The Regional Water Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for the discharge and has provided them with an opportunity to submit their written comments and recommendations. Notification was provided through the posting of Notice of Public Hearing at Riverside City Hall and publication at the local newspaper “The Press-Enterprise”; and at the Regional Water Board website: <http://www.waterboards.ca.gov/santaana> on March 21, 2006.

B. Written Comments

The staff determinations are tentative. Interested persons are invited to submit written comments concerning these tentative WDRs. Comments should be submitted either in person or by mail to the Executive Office at the Regional Water Board at the address above on the cover page of this Order.

To be fully responded to by staff and considered by the Regional Water Board, written comments should be received at the Regional Water Board offices by 5:00 p.m. on April 3, 2006 to:

Jane Qiu
California Regional Water Quality Control Board
Santa Ana Region
3737 Main Street, Suite 500
Riverside, CA 92501-3348

C. Public Hearing

The Regional Water Board will hold a public hearing on the tentative WDRs during its regular Board meeting on the following date and time and at the following location:

Date: April 21, 2006
Time: 9:00 A.M.
Location: City of Loma Linda
25541 Barton Road
Loma Linda, CA

Interested persons are invited to attend. At the public hearing, the Regional Water Board will hear testimony, if any, pertinent to the discharge, WDRs, and permit. Oral testimony will be heard; however, for accuracy of the record, important testimony should be in writing.

Please be aware that dates and venues may change. Our web address is <http://www.waterboards.ca.gov/santaana> where you can access the current agenda for changes in dates and locations.

D. Waste Discharge Requirements Petitions

Any aggrieved person may petition the State Water Resources Control Board to review the decision of the Regional Water Board regarding the final WDRs. The petition must be submitted within 30 days of the Regional Water Board's action to the following address:

State Water Resources Control Board
Office of Chief Counsel
P.O. Box 100, 1001 I Street
Sacramento, CA 95812-0100

E. Information and Copying

The Report of Waste Discharge (RWD), related documents, tentative effluent limitations and special provisions, comments received, and other information are on file and may be inspected at the address above at any time between 9:00 a.m. and 3:00 p.m. Monday through Friday. Copying of documents may be arranged through the Regional Water Board by calling (951) 782-4130.

F. Register of Interested Persons

Any person interested in being placed on the mailing list for information regarding the WDRs and NPDES permit should contact the Regional Water Board, reference this facility, and provide a name, address, and phone number.

G. Additional Information

Requests for additional information or questions regarding this Order should be directed to Jane Qiu at (951) 320-2008.

ATTACHMENT G - EPA PRIORITY POLLUTANT LIST

EPA PRIORITY POLLUTANT LIST		
Metals	Acid Extractibles	Base/Neutral Extractibles (continuation)
1. Antimony	45. 2-Chlorophenol	91. Hexachloroethane
2. Arsenic	46. 2,4-Dichlorophenol	92. Indeno (1,2,3-cd) Pyrene
3. Beryllium	47. 2,4-Dimethylphenol	93. Isophorone
4. Cadmium	48. 2-Methyl-4,6-Dinitrophenol	94. Naphthalene
5a. Chromium (III)	49. 2,4-Dinitrophenol	95. Nitrobenzene
5b. Chromium (VI)	50. 2-Nitrophenol	96. N-Nitrosodimethylamine
6. Copper	51. 4-Nitrophenol	97. N-Nitrosodi-N-Propylamine
7. Lead	52. 3-Methyl-4-Chlorophenol	98. N-Nitrosodiphenylamine
8. Mercury	53. Pentachlorophenol	99. Phenanthrene
9. Nickel	54. Phenol	100. Pyrene
10. Selenium	55. 2, 4, 6 - Trichlorophenol	101. 1,2,4-Trichlorobenzene
11. Silver	Base/Neutral Extractibles	Pesticides
12. Thallium	56. Acenaphthene	102. Aldrin
13. Zinc	57. Acenaphthylene	103. Alpha BHC
	Miscellaneous	104. Beta BHC
14. Cyanide	58. Anthracene	105. Delta BHC
15. Asbestos (not required unless requested)	59. Benzidine	106. Gamma BHC
16. 2,3,7,8-Tetrachlorodibenzo-P-Dioxin (TCDD)	60. Benzo (a) Anthracene	107. Chlordane
	Volatile Organics	108. 4, 4' - DDT
17. Acrolein	62. Benzo (b) Fluoranthene	109. 4, 4' - DDE
18. Acrylonitrile	63. Benzo (g,h,i) Perylene	110. 4, 4' - DDD
19. Benzene	64. Benzo (k) Fluoranthene	111. Dieldrin
20. Bromoform	65. Bis (2-Chloroethoxy) Methane	112. Alpha Endosulfan
21. Carbon Tetrachloride	66. Bis (2-Chloroethyl) Ether	113. Beta Endosulfan
22. Chlorobenzene	67. Bis (2-Chloroisopropyl) Ether	114. Endosulfan Sulfate
23. Chlorodibromomethane	68. Bis (2-Ethylhexyl) Phthalate	115. Endrin
24. Chloroethane	69. 4-Bromophenyl Phenyl Ether	116. Endrin Aldehyde
25. 2-Chloroethyl Vinyl Ether	70. Butylbenzyl Phthalate	117. Heptachlor
26. Chloroform	71. 2-Chloronaphthalene	118. Heptachlor Epoxide
27. Dichlorobromomethane	72. 4-Chlorophenyl Phenyl Ether	119. PCB 1016
28. 1,1-Dichloroethane	73. Chrysene	120. PCB 1221
29. 1,2-Dichloroethane	74. Dibenzo (a,h) Anthracene	121. PCB 1232
30. 1,1-Dichloroethylene	75. 1,2-Dichlorobenzene	122. PCB 1242
31. 1,2-Dichloropropane	76. 1,3-Dichlorobenzene	123. PCB 1248
32. 1,3-Dichloropropylene	77. 1,4-Dichlorobenzene	124. PCB 1254
33. Ethylbenzene	78. 3,3'-Dichlorobenzidine	125. PCB 1260
34. Methyl Bromide	79. Diethyl Phthalate	126. Toxaphene
35. Methyl Chloride	80. Dimethyl Phthalate	
36. Methylene Chloride	81. Di-n-Butyl Phthalate	
37. 1,1,2,2-Tetrachloroethane	82. 2,4-Dinitrotoluene	
38. Tetrachloroethylene	83. 2,6-Dinitrotoluene	
39. Toluene	84. Di-n-Octyl Phthalate	
40. 1,2-Trans-Dichloroethylene	85. 1,2-Dipenylhydrazine	
41. 1,1,1-Trichloroethane	86. Fluoranthene	
42. 1,1,2-Trichloroethane	87. Fluorene	
43. Trichloroethylene	88. Hexachlorobenzene	
44. Vinyl Chloride	89. Hexachlorobutadiene	
	90. Hexachlorocyclopentadiene	

Attachment H – Practical Quantitation Levels for Compliance Determination

PRACTICAL QUANTITATION LEVELS FOR COMPLIANCE DETERMINATION			
	Constituent	RL, µg/L	Analysis Method
1	Arsenic	7.5	GF/AA
2	Barium	20	ICP/GFAA
3	Cadmium	15	ICP
4	Chromium (VI)	15.0	ICP
5	Cobalt	10.0	GF/AA
6	Copper	19.0	GF/ICP
7	Cyanide	50.0	335.2/335.3
8	Iron	100.0	ICP
9	Lead	26.0	GF/AA
10	Manganese	20.0	ICP
11	Mercury	0.5	CV/AA
12	Nickel	50.0	ICP
13	Selenium	14.0	GF/HYDRIDE GENERATION
14	Silver	16.0	ICP
15	Zinc	20	ICP
16	1,2 - Dichlorobenzene	5.0	601/602/624
17	1,3 - Dichlorobenzene	5.0	601
18	1,4 - Dichlorobenzene	5.0	601
18	2,4 - Dichlorophenol	10.0	625/604
20	4 - Chloro -3- methylphenol	10.0	625/604
21	Aldrin	0.04	608
22	Benzene	1.0	602/624
23	Chlordane	0.30	608
24	Chloroform	5.0	601/624
25	DDT	0.10	608
26	Dichloromethane	5.0	601/624
27	Dieldrin	0.10	608
28	Fluorantene	10.0	625/610
29	Endosulfan	0.50	608
30	Endrin	0.10	608
31	Halomethanes	5.0	601/624
32	Heptachlor	0.03	608
33	Hepthachlor Epoxide	0.05	608
34	Hexachlorobenzene	10.0	625
35	Hexachlorocyclohexane		
	Alpha	0.03	608
	Beta	0.03	608
	Gamma	0.03	608
36	PAH's	10.0	625/610
37	PCB	1.0	608
38	Pentachlorophenol	10.0	625/604
39	Phenol	10.0	625/604
40	TCDD Equivalent	0.05	8280
41	Toluene	1.0	602/625
42	Toxaphene	2.0	608
43	Tributyltin	0.02	GC
44	2,4,6-Trichlorophenol	10.0	625/604

ATTACHMENT I – MINIMUM LEVELS

MINIMUM LEVELS IN PPB (µg/L)

Table 1- VOLATILE SUBSTANCES¹	GC	GCMS
Acrolein	2.0	5
Acrylonitrile	2.0	2
Benzene	0.5	2
Bromoform	0.5	2
Carbon Tetrachloride	0.5	2
Chlorobenzene	0.5	2
Chlorodibromomethane	0.5	2
Chloroethane	0.5	2
Chloroform	0.5	2
Dichlorobromomethane	0.5	2
1,1 Dichloroethane	0.5	1
1,2 Dichloroethane	0.5	2
1,1 Dichloroethylene	0.5	2
1,2 Dichloropropane	0.5	1
1,3 Dichloropropylene (volatile)	0.5	2
Ethylbenzene	0.5	2
Methyl Bromide (<i>Bromomethane</i>)	1.0	2
Methyl Chloride (<i>Chloromethane</i>)	0.5	2
Methylene Chloride (<i>Dichloromethane</i>)	0.5	2
1,1,2,2 Tetrachloroethane	0.5	1
Tetrachloroethylene	0.5	2
Toluene	0.5	2
trans-1,2 Dichloroethylene	0.5	1
1,1,1 Trichloroethane	0.5	2
1,1,2 Trichloroethane	0.5	2
Trichloroethylene	0.5	2
Vinyl Chloride	0.5	2
1,2 Dichlorobenzene (volatile)	0.5	2
1,3 Dichlorobenzene (volatile)	0.5	2
1,4 Dichlorobenzene (volatile)	0.5	2

Selection and Use of Appropriate ML Value:

ML Selection: When there is more than one ML value for a given substance, the discharger may select any one of those ML values, and their associated analytical methods, listed in this Attachment that are below the calculated effluent limitation for compliance determination. If no ML value is below the effluent limitation, then the discharger shall select the lowest ML value, and its associated analytical method, listed in the PQL Table.

ML Usage: The ML value in this Attachment represents the lowest quantifiable concentration in a sample based on the proper application of all method-based analytical procedures and the absence of any matrix interferences. Assuming that all method-specific analytical steps are followed, the ML value will also represent, after the appropriate application of method-specific factors, the lowest standard in the calibration curve for that specific analytical technique. Common analytical practices sometimes require different treatment of the sample relative to calibration standards.

Note: chemical names in parenthesis and italicized is another name for the constituent.

¹ The normal method-specific factor for these substances is 1, therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance.

MINIMUM LEVELS IN PPB (µg/L)

Table 2 – Semi-Volatile Substances ²	GC	GCMS	LC
2-Chloroethyl vinyl ether	1	1	
2 Chlorophenol	2	5	
2,4 Dichlorophenol	1	5	
2,4 Dimethylphenol	1	2	
4,6 Dinitro-2-methylphenol	10	5	
2,4 Dinitrophenol	5	5	
2- Nitrophenol		10	
4- Nitrophenol	5	10	
4 Chloro-3-methylphenol	5	1	
2,4,6 Trichlorophenol	10	10	
Acenaphthene	1	1	0.5
Acenaphthylene		10	0.2
Anthracene		10	2
Benzidine		5	
Benzo (a) Anthracene (1,2 Benzanthracene)	10	5	
Benzo(a) pyrene (3,4 Benzopyrene)		10	2
Benzo (b) Flouranthene (3,4 Benzofluoranthene)		10	10
Benzo(g,h,i)perylene		5	0.1
Benzo(k)fluoranthene		10	2
bis 2-(1-Chloroethoxyl) methane		5	
bis(2-chloroethyl) ether	10	1	
bis(2-Chloroisopropyl) ether	10	2	
bis(2-Ethylhexyl) phthalate	10	5	
4-Bromophenyl phenyl ether	10	5	
Butyl benzyl phthalate	10	10	
2-Chloronaphthalene		10	
4-Chlorophenyl phenyl ether		5	
Chrysene		10	5
Dibenzo(a,h)-anthracene		10	0.1
1,2 Dichlorobenzene (semivolatile)	2	2	
1,3 Dichlorobenzene (semivolatile)	2	1	
1,4 Dichlorobenzene (semivolatile)	2	1	
3,3' Dichlorobenzidine		5	
Diethyl phthalate	10	2	
Dimethyl phthalate	10	2	
di-n-Butyl phthalate		10	
2,4 Dinitrotoluene	10	5	
2,6 Dinitrotoluene		5	
di-n-Octyl phthalate		10	
1,2 Diphenylhydrazine		1	
Fluoranthene	10	1	0.05
Fluorene		10	0.1
Hexachloro-cyclopentadiene	5	5	
1,2,4 Trichlorobenzene	1	5	

MINIMUM LEVELS IN PPB (µg/L)

Table 2 - SEMI-VOLATILE SUBSTANCES ²	GC	GCMS	LC	COLOR
Pentachlorophenol	1	5		
Phenol ³	1	1		50
Hexachlorobenzene	5	1		
Hexachlorobutadiene	5	1		
Hexachloroethane	5	1		
Indeno(1,2,3,cd)-pyrene		10	0.05	
Isophorone	10	1		
Naphthalene	10	1	0.2	
Nitrobenzene	10	1		
N-Nitroso-dimethyl amine	10	5		
N-Nitroso -di n-propyl amine	10	5		
N-Nitroso diphenyl amine	10	1		
Phenanthrene		5	0.05	
Pyrene		10	0.05	

Table 3- INORGANICS ⁴	FAA	GFA A	IC P	ICPMS	SPGFA A	HYDRID E	CVAA	COLO R	DCP
Antimony	10	5	50	0.5	5	0.5			1000
Arsenic		2	10	2	2	1		20	1000
Beryllium	20	0.5	2	0.5	1				1000
Cadmium	10	0.5	10	0.25	0.5				1000
Chromium (total)	50	2	10	0.5	1				1000
Chromium VI	5							10	
Copper	25	5	10	0.5	2				1000
Lead	20	5	5	0.5	2				10000
Mercury				0.5			0.2		
Nickel	50	5	20	1	5				1000
Selenium		5	10	2	5	1			1000
Silver	10	1	10	0.25	2				1000
Thallium	10	2	10	1	5				1000
Zinc	20		20	1	10				1000
Cyanide								5	

² With the exception of phenol by colorimetric technique, the normal method-specific factor for these substances is 1000, therefore, the lowest standards concentration in the calibration curve is equal to the above ML value for each substance multiplied by 1000.

³ Phenol by colorimetric technique has a factor of 1.

⁴ The normal method-specific factor for these substances is 1, therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance.

MINIMUM LEVELS IN PPB (µg/L)

Table 4- PESTICIDES – PCBs⁵	GC
Aldrin	0.005
alpha-BHC (<i>a-Hexachloro-cyclohexane</i>)	0.01
beta-BHC (<i>b-Hexachloro-cyclohexane</i>)	0.005
Gamma-BHC (<i>Lindane; g-Hexachloro-cyclohexane</i>)	0.02
Delta-BHC (<i>d-Hexachloro-cyclohexane</i>)	0.005
Chlordane	0.1
4,4'-DDT	0.01
4,4'-DDE	0.05
4,4'-DDD	0.05
Dieldrin	0.01
Alpha-Endosulfan	0.02
Beta-Endosulfan	0.01
Endosulfan Sulfate	0.05
Endrin	0.01
Endrin Aldehyde	0.01
Heptachlor	0.01
Heptachlor Epoxide	0.01
PCB 1016	0.5
PCB 1221	0.5
PCB 1232	0.5
PCB 1242	0.5
PCB 1248	0.5
PCB 1254	0.5
PCB 1260	0.5
Toxaphene	0.5

Techniques:

- GC - Gas Chromatography
- GCMS - Gas Chromatography/Mass Spectrometry
- HRGCMS - High Resolution Gas Chromatography/Mass Spectrometry (i.e., EPA 1613, 1624, or 1625)
- LC - High Pressure Liquid Chromatography
- FAA - Flame Atomic Absorption
- GFAA - Graphite Furnace Atomic Absorption
- HYDRIDE - Gaseous Hydride Atomic Absorption
- CVAA - Cold Vapor Atomic Absorption
- ICP - Inductively Coupled Plasma
- ICPMS - Inductively Coupled Plasma/Mass Spectrometry
- SPGFAA - Stabilized Platform Graphite Furnace Atomic Absorption (i.e., EPA 200.9)
- DCP - Direct Current Plasma
- COLOR – Colorimetric

⁵ *The normal method-specific factor for these substances is 100, therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance multiplied by 100.*

ATTACHMENT J – TRIGGERS FOR QUARTERLY MONITORING OF PRIORITY POLLUTANTS

The values shown in the table below are fifty percent of the most stringent applicable receiving water objectives (freshwater or human health (consumption of organisms only) as specified for that pollutant in 40 CFR 131.38⁶). For hardness dependent metals, the hardness value used is 272 mg/L and for pentachlorophenol, the pH value used is 7.5 standard units.

	Constituent	µg/L
1	Antimony	2150
2	Arsenic	75
3	Beryllium	
4	Cadmium	6.1
5a	Chromium III	235
5b	Chromium VI	5.7
6	Copper	27
7	Lead	22
8	Mercury	0.026
9	Nickel	61
10	Selenium	2.5
11	Silver	11
12	Thallium	3.2
13	Zinc	140
14	Cyanide	2.6
15	Asbestos	--
16	2,3,7,8-TCDD (Dioxin)	0.000000007
17	Acrolein	390
18	Acrylonitrile	0.33
19	Benzene	36
20	Bromoform	180
21	Carbon Tetrachloride	2.2
22	Chlorobenzene	10500
23	Chlorodibromomethane	17
24	Chloroethane	--
25	2-Chloroethyl vinyl ether	--
26	Chloroform	
27	Dichlorobromomethane	23
28	1,1-Dichloroethane	--
29	1,2-Dichloroethane	50
30	1,1-Dichloroethylene	1.6
31	1,2-Dichloropropane	20
32	1,3-Dichloropropylene	850
33	Ethylbenzene	14500
34	Methyl Bromide	2000
35	Methyl Chloride	--
36	Methylene Chloride	800
37	1,1,2,2-Tetrachloroethane	5.5

	Constituent	µg/L
38	Tetrachloroethylene	4.43
39	Toluene	100000
40	1,2,-Trans-dichloroethylene	70000
41	1,1,1-Trichloroethane	--
42	1,1,2-Trichloroethane	21
43	Trichloroethylene	41
44	Vinyl Chloride	263
45	2-Chlorophenol	200
46	2,4-Dichlorophenol	395
47	2,4-Dimethylphenol	1150
48	4,6-Dinitro-O-cresol	383
49	2,4-Dinitrophenol	7000
50	2-Nitrophenol	--
51	4-Nitrophenol	--
52	3-Methyl-4-Chlorophenol	--
53	Pentachlorophenol	4.1
54	Phenol	2300000
55	2,4,6-Trichlorophenol	3.3
56	Acenaphthene	1350
57	Acenaphthylene	--
58	Anthracene	55000
59	Benzidine	0.00027
60	Benzo (a) anthracene	0.025
61	Benzo (a) pyrene	0.025
62	Benzo (b) fluoranthene	0.025
63	Benzo (g,h,i) pyrylene	--
64	Benzo (k) fluorantene	0.025
65	Bis (2-Chloroethoxy) methane	--
66	Bis (2-Chloroethyl) ether	0.7
67	Bis (2-Chloroisopropyl) ether	85000
68	Bis (2-ethyhexyl) phthalate	3
69	4-Bromophenyl phenyl ether	--
70	Butyl benzyl phthalate	2600
71	2- Chloronapthalene	2150
72	4-Chlorophenyl phenyl ether	--
73	Chrysene	0.025
74	Dibenzo (a,h) anthracene	0.025
75	1,2-Dichlorobenzene	8500

⁶ See Federal Register/ Vol. 65, No. 97 / Thursday, May 18, 2000 / Rules and Regulations

ATTACHMENT J -Continued

	Constituent	µg/L
76	1,3-Dichlorobenzene	1300
77	1,4-Dichlorobenzene	1300
78	3,3-Dichlorobenzidine	0.039
79	Diethyl phthalate	60000
80	Dimethyl phthalate	1450000
81	Di-N-butyl phthalate	6000
82	2,4-Dinitrotoluene	4.6
83	2,6-Dinitrotoluene	--
84	Di-N-octyl phthalate	--
85	1,2-Diphenylhydrazine	0.27
86	Fluoranthene	185
87	Fluorene	7000
88	Hexachlorobenzene	0.00039
89	Hexachlorobutadiene	25
90	Hexachlorocyclopentadiene	8500
91	Hexachloroethane	4.5
92	Indeno (1,2,3-cd) pyrene	0.025
93	Isophorone	300
94	Naphthalene	--
95	Nitrobenzene	950
96	N-Nitrosodimethylamine	4.05
97	N-Nitrosodi-N-propylamine	0.7
98	N-Nitrosodiphenylamine	8
99	Phenantrene	--
100	Pyrene	5500
101	1,2,4 -Trichlorobenzene	--
102	Aldrin	0.00007
103	BHC Alpha	0.0065
104	BHC Beta	0.023
105	BHC Gamma	0.0315
106	BHC Delta	--
107	Chlordane	0.0003
108	4,4-DDT	0.0003
109	4,4-DDE	0.0003
110	4,4-DDD	0.00042
111	Dieldrin	0.00007
112	Endosulfan Alpha	0.028
113	Endosulfan Beta	0.028
114	Endosulfan Sulfate	120
115	Endrin	0.018
116	Endrin Aldehyde	0.41
117	Heptachlor	0.00011
118	Heptachlor Epoxide	0.000055
119	PCB 1016	0.000085
120	PCB 1221	0.000085
125	PCB 1260	0.000085
126	Toxaphene	0.00038