

**State Of California**  
**California Regional Water Quality Control Board**  
**Santa Ana Region**

3737 Main Street, Suite 500, Riverside, California 92501-3348  
 Phone (951) 782-4130 • Fax (951) 781-6288 • TDD (951) 782-3221  
<http://www.waterboards.ca.gov/santaana>

**ORDER NO. R8-2015-0006**  
**NPDES NO. CA8000188**

**WASTE DISCHARGE REQUIREMENTS**  
**FOR**  
**EASTERN MUNICIPAL WATER DISTRICT**  
**RECYCLED WATER SYSTEM**  
**TEMESCAL CREEK DISCHARGE**  
**RIVERSIDE COUNTY**

The following Discharger is subject to waste discharge requirements as set forth in this Order:

**Table 1. Discharger/Facility Information**

<b>Discharger/ Operator</b>	Eastern Municipal Water District					Rancho California Water District (RCWD)
<b>Name of Facilities</b>	Recycled Water System - Temescal Creek Discharge					
	San Jacinto Valley RWF <sup>1</sup>	Moreno Valley RWF	Perris Valley RWF	Sun City RWF	Temecula Valley <sup>2</sup> RWF	Santa Rosa Water Reclamation Facility <sup>2</sup>
<b>Facility Address</b>	770 North Sanderson Avenue	17140 Kitching Street	1301 Case Road	29285 Valley Blvd.	42565 Avenida Alvarado	26266 Washington Avenue
	San Jacinto, CA 92582	Moreno Valley, CA 92553	Perris, CA 92570	Sun City, CA 92586	Temecula, CA 92590	Murrieta, CA 92562
	Riverside County					
The U.S. Environmental Protection Agency (USEPA) and the Regional Water Quality Control Board have classified this discharge as a <b>major</b> discharge.						

<sup>1</sup> RWF = Regional Water Reclamation Facility.

<sup>2</sup> Wastewater discharges from the Temecula Valley RWF and Santa Rosa Water Reclamation Facility are also regulated by the San Diego Regional Water Quality Control Board.

Discharges by the Eastern Municipal Water District, from the discharge points identified below are subject to waste discharge requirements as set forth in this Order:

**Table 2. Discharge Locations**

Discharge Point	Effluent Description	Discharge Point (Latitude)	Discharge Point (Longitude)	Receiving Water
001	Tertiary or secondary treated effluent	33° 40' 52.00" N	117° 19' 54.00" W	Primary discharge point is approximately 40 feet upstream of confluence of Wasson Canyon flood control channel and Reach 5 of Temescal Creek
S-01	Stormwater from San Jacinto Valley RWRf	33° 47' 53.14" N	117° 00' 26.18" W	Conveyance to San Jacinto River
S-02	Stormwater from Moreno Valley RWRf	33° 52' 12.37" N	117° 13' 02.50" W	Perris Storm Channel to San Jacinto River
S-03		33° 52' 01.96" N	117° 13' 04.29" W	
S-04	Storm Water from Sun City RWRf	33° 41' 40.80" N	117° 12' 34.01" W	Salt Creek
S-05		33° 41' 10.87" N	117° 12' 36.43" W	
S-06		33° 41' 40.53" N	117° 12' 39.15" W	
S-07		33° 41' 42.30" N	117° 12' 38.94" W	
S-08		33° 41' 45.60" N	117° 12' 34.40" W	
S-09		33° 41' 29.65" N	117° 29' 56.80" W	
S-10		33° 41' 25.27" N	117° 13' 01.22" W	
S-11	Storm Water from Perris Valley RWRf	33° 45' 40.63" N	117° 12' 06.99" W	Conveyance to San Jacinto River

**Table 3. Administrative Information**

This Order was adopted by the Regional Water Board on:	September 18, 2015
This Order shall become effective on:	October 1, 2015
This Order shall expire on:	September 30, 2020
The Discharger shall file a Report of Waste Discharge in accordance with Title 23, California Code of Regulations, as application for issuance of new waste discharge requirements no later than:	April 1, 2020

IT IS HEREBY ORDERED, that this Order supersedes and rescinds Order No. R8-2009-0014 except for enforcement purposes, and, in order to meet the provisions contained in Division 7 of the California Water Code (commencing with section 13000) and regulations adopted thereunder, and the provisions of the federal Clean Water Act (CWA) and regulations and guidelines adopted thereunder, the Discharger shall comply with the requirements in this Order. The Discharger is hereby authorized to discharge recycled water from its recycled water system and storm water from its publicly owned treatment works under the terms and conditions specified in this Order.

I, Kurt V. Berchtold, Executive Officer, do hereby certify that this Order with all attachments is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Santa Ana Region, on September 18, 2015.



---

**Kurt V. Berchtold, Executive Officer**

## Table of Contents

I.	Discharger/Facility Information.....	6
II.	Findings .....	6
III.	Discharge Prohibitions .....	7
IV.	Effluent Limitations and Discharge Specifications.....	8
A.	Effluent Limitations – Discharge Point 001 .....	8
1.	Effluent Limitations (Without 20:1 Dilution in the Receiving Water).....	8
2.	Effluent Limitations Under Conditions of 20:1 or More Dilution in the Receiving Water.....	11
3.	Toxicity Requirements .....	12
B.	Land Discharge Specifications – Not Applicable.....	13
C.	Reclamation Specifications – Not Applicable.....	13
D.	Stormwater Discharge Specifications .....	13
V.	Receiving Water Limitations.....	13
A.	Surface Water Limitations.....	13
B.	Groundwater Limitations .....	14
VI.	Provisions.....	15
A.	Standard Provisions.....	15
B.	Monitoring and Reporting Program (MRP) Requirements .....	17
C.	Special Provisions .....	17
1.	Reopener Provisions .....	17
2.	Special Studies, Technical Reports and Additional Monitoring Requirements .....	18
3.	Best Management Practices and Pollution Prevention.....	20
4.	Construction, Operation and Maintenance Specifications .....	21
5.	Special Provisions for Municipal Facilities (POTWs Only) – Not Applicable.....	21
6.	Pretreatment Program– Not Applicable .....	21
7.	Compliance Schedules – Not Applicable.....	22
VII.	Compliance Determination.....	22

## List of Tables

Table 1.	Discharger/Facility Information.....	1
Table 2.	Discharge Locations.....	2
Table 3.	Administrative Information.....	2
Table 4.	Discharger/Facility Information.....	6
Table 5.	Effluent Limitations at DP-001 (Without 20:1 Dilution).....	8
Table 6.	Effluent Limitations at DP-001 with 20:1 Dilution.....	11

### List of Attachments

Attachment A – Definitions .....	A-1
Attachment B – Location Map .....	B-1
Attachment C – Flow Schematics .....	C-1
Attachment D – Standard Provisions .....	D-1
Attachment E – Monitoring and Reporting Program.....	E-1
Attachment F – Fact Sheet.....	F-1
Attachment G – EPA Priority Pollutant List.....	G-1
Attachment H – Minimum Levels.....	H-1
Attachment I – Triggers for Monitoring Priority Pollutants .....	I-1
Attachment J – Stormwater Pollution Prevention Plan .....	J-1
Attachment K – Stormwater Monitoring and Reporting Requirements .....	K-1

## I. DISCHARGER/FACILITY INFORMATION

Information regarding the Eastern Municipal Water District's Recycled Water System – Temescal Creek Outfall is summarized in Table 4, below, and in sections I and II of the Fact Sheet (Attachment F). Section I of the Fact Sheet also includes information regarding the Discharger's permit application.

**Table 4. Discharger/Facility Information**

<b>Discharger/ Operator</b>	Eastern Municipal Water District					Rancho California Water District
<b>Discharger Contacts</b>	Jayne Joy, Director of Environmental & Regulatory Compliance, (951) 928-3777 ext. 6241 Paul D. Jones II, General Manager, (951) 928-3777 ext. 6109					
<b>Mailing Address</b>	2270 Trumble Road, Perris, CA 92570					
<b>Facility</b>	Recycled Water System - Temescal Creek Discharge					
	San Jacinto Valley RWRf <sup>1</sup>	Moreno Valley RWRf	Perris Valley RWRf	Sun City RWRf	Temecula Valley <sup>2</sup> RWRf	Santa Rosa Water Reclamation Facility <sup>2</sup>
<b>Facility Address</b>	770 North Sanderson Avenue	17140 Kitching Street	1301 Case Road	29285 Valley Blvd.	42565 Avenida Alvarado	26266 Washington Avenue
	San Jacinto, CA 92582	Moreno Valley, CA 92553	Perris, CA 92570	Sun City, CA 92586	Temecula, CA 92590	Murrieta, CA 92562
	Riverside County					
<b>Type of Facility</b>	POTW					
<b>Pretreatment Program</b>	No <sup>3</sup>					
<b>Reclamation Requirements</b>	No <sup>3</sup>					
<b>Facility Permitted Flow</b>	52.5 million gallons per day (mgd)					

## II. FINDINGS

The California Regional Water Quality Control Board, Santa Ana Region (hereinafter Regional Water Board), finds:

**A. Legal Authorities.** This Order serves as Waste Discharge Requirements (WDRs) pursuant to Article 4, Chapter 4 of the California Water Code (CWC) commencing with Section 13260. This Order shall also serve as an NPDES Permit pursuant to Section

<sup>1</sup> RWRf means Regional Water Reclamation Facility

<sup>2</sup> Wastewater discharges from the Temecula Valley RWRf and Santa Rosa WRF are regulated by the San Diego Regional Water Quality Control Board.

<sup>3</sup> Waste Discharge Requirements Order No. R8-2008-0008 issued to the Discharger for discharges to land from its five regional water reclamation facilities include reclamation and pretreatment requirements. For the Temecula Valley RWRf and Santa Rosa WRF, discharges to land, including reclamation and pretreatment requirements, are regulated by Orders No. R9-2000-165 and R9-94-92, respectively.

402 of the federal Clean Water Act (CWA) and implementing regulations adopted by the U.S. Environmental Protection Agency (USEPA), and Chapter 5.5, Division 7 of the CWC for point source discharges from this Facility to surface waters.

- B. Background and Rationale for Requirements.** The Regional Water Board developed the requirements in this Order based on information submitted as part of the application, through monitoring and reporting programs, and other available information. The Fact Sheet (Attachment F), which contains background information and rationale for Order requirements, is hereby incorporated into this Order and constitutes part of the Findings for this Order. Attachments A through E and G through K are also incorporated into this Order.
- C. California Environmental Quality Act (CEQA).** Under CWC section 13389, the action to adopt an NPDES permit is exempt from the provisions of CEQA, Public Resources Code section 21000 et seq. (*County of Los Angeles v. California State Water Resources Control Board* (2006) 143 Cal.App.4th 985, mod. (Nov. 6, 2006, B184034) 50 Cal.Rptr.3d 619, 632-636).
- D. Notification of Interested Parties.** The Regional Water Board has notified the Discharger and interested agencies and persons of its intent to prescribe Waste Discharge Requirements for the discharge and has provided them with an opportunity to submit their written comments and recommendations. Details of notification are provided in the Fact Sheet of this Order.
- E. Consideration of Public Comment.** The Regional Water Board, in a public meeting, heard and considered all comments pertaining to the discharge. Details of the Public Hearing are provided in the Fact Sheet of this Order.

### III. DISCHARGE PROHIBITIONS

- A.** Wastewater discharged at DP-001 shall be limited to treated and disinfected effluent that meets the conditions in Section IV.A.1., except for discharges of treated wastewater that meets the conditions specified in Section IV.A.2. when the flow<sup>4</sup> in Temescal Creek results in a dilution of 20:1 or more at the point of discharge.
- B.** The direct discharge of secondary treated wastewater to Temescal Creek other than when the flow in the Creek results in a dilution of 20:1 or more at the point of discharge is prohibited.
- C.** The discharge of wastewater at a location or in a manner different from those described in this Order is prohibited.
- D.** The bypass or overflow of untreated wastewater or wastes to surface waters or surface water drainage courses is prohibited, except as allowed in Standard Provision I.G. of Attachment D, Federal Standard Provisions.

---

<sup>4</sup> Exclusive of discharge to surface waters from upstream publicly owned treatment works.

E. The discharge of any substances in concentrations toxic to animal or plant life is prohibited.

F. The discharge of any radiological, chemical, or biological warfare agent or high level radiological waste is prohibited.

#### IV. EFFLUENT LIMITATIONS AND DISCHARGE SPECIFICATIONS

##### A. Effluent Limitations – Discharge Point 001

Unless otherwise specified hereinafter, compliance with the following effluent limitations, except IV.A.1.e., shall be measured at monitoring location M-001 as described in the attached Monitoring and Reporting Program (Attachment E).

##### 1. Effluent Limitations (Without 20:1 Dilution in the Receiving Water)

a. The Discharger shall comply with the following effluent limitations at Discharge Point 001:

**Table 5. Effluent Limitations at DP-001 (Without 20:1 Dilution)**

Parameter	Units	Effluent Limitations				
		Average Monthly	Average Weekly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum
Biochemical Oxygen Demand 5-day @ 20°C	mg/L (lbs/day)	20 (8,757)	30 (13,136)	--	--	--
Total Suspended Solids	mg/L (lbs/day)	20 (8,757)	30 (13,136)	--	--	--
Ammonia-Nitrogen	mg/L	4.5	--	--	--	--
Free Cyanide	µg/L	4.2		8.4		
Total Recoverable Copper <sup>5</sup>	µg/L	12.1		18.3		
Total Recoverable Lead <sup>5</sup>	µg/L	3.6		6.7		
Total Recoverable Mercury	µg/L	0.051		0.103		
Dichlorobromomethane	µg/L	46		75		

Note: Mass loadings for BOD & TSS = concentration (mg/L) x 52.5 mgd x 8.34

b. Percent Removal:

The average monthly percent removal of BOD 5-day 20°C and total suspended solids shall not be less than 85 percent.

<sup>5</sup> Effluent limitations for copper and lead have been added to this Order because the Facility discharges treated wastewater from DP-001 to Reach 5 of Temescal Creek, a tributary of Reach 3 of the Santa Ana River that is listed on the Clean Water Act 303(d) list as being impaired for copper and lead.

c. Total Dissolved Solids (TDS):

- 1) The 12-month flow weighted running average TDS concentration shall not exceed 650 mg/L, unless the Discharger demonstrates to the satisfaction of the Regional Board's Executive Officer that:
  - a) Discharges in excess of the TDS limit are due to the quality of water supply sources utilized in the Discharger's service area, and that all reasonable steps, as agreed upon by the Executive Officer, have been taken to ensure that the best quality supplies are obtained and utilized in the Discharger's service area; and/or
  - b) Discharges in excess of the TDS limits are due to chemical additions in the treatment process needed to meet waste discharge requirements, and the Discharger has taken all steps to optimize chemical additions so as to minimize the increases; and
  - c) The Discharger implements a plan, approved by the Executive Officer, to offset discharges in excess of the TDS limit.
- 2) The 12-month flow weighted running average TDS concentration of the discharge shall not exceed the 12-month flow weighted average TDS concentration in the water supply by more than 250 mg/L, unless the Discharger demonstrates to the satisfaction of the Regional Board's Executive Officer that TDS discharges in excess of the 250 mg/L mineral increment are due solely to chemical additions in the treatment process needed to meet waste discharge requirements, and the Discharger has taken all steps to optimize chemical additions so as to minimize the TDS increases.

d. Total Inorganic Nitrogen (TIN):

The 12-month flow weighted running average TIN concentration of the discharge shall not exceed 10 mg/L, unless the Discharger implements a plan, with the approval of the Executive Officer, to offset TIN discharges in excess of the TIN limits.

e. Tertiary Treated Wastewater:

The discharge shall at all times be adequately oxidized, filtered, and disinfected tertiary treated wastewater and shall meet the following limitations measured at monitoring locations M-002 to M-007 as described in Attachment E.

1) Turbidity:

When filtration is through natural undisturbed soils or a bed of filter media, the turbidity of the filtered wastewater shall not exceed any of the following:

- a) An average of 2 NTU within a 24-hour period;

- b) 5 NTU more than 5 percent of the time within a 24-hour period; and
- c) 10 NTU at any time.

2) Disinfection:

The discharge shall meet the following:

- a) When chlorine disinfection process is utilized following filtration, a CT (the product of total chlorine residual and modal contact time measured at the same point) value of not less than 450 milligram-minutes per liter shall be provided at all times, with a modal contact time<sup>6</sup> of at least 90 minutes<sup>7</sup>, based on peak dry weather design flow<sup>8</sup>.
- b) When a disinfection process combined with the filtration process is utilized, the combined process shall demonstrate inactivation and/or removal of 99.999 percent of the plaque-forming units of F-specific bacteriophage MS-2, or polio virus in the wastewater. A virus that is at least as resistant to disinfection as polio virus may be used for purposes of the demonstration.

3) Coliform:

The disinfected wastewater shall meet the following:

- a) The weekly median concentration of total coliform bacteria shall not exceed a Most Probable Number (MPN) of 2.2 total coliform bacteria per 100 milliliters (ml). To comply with the limit, the 7-day median MPN must not exceed 2.2 per 100 milliliters on any day during the week. However, only one violation is recorded for each calendar week, even if the 7-day median MPN value is greater than 2.2 for more than one day in the week,
- b) The number of total coliform bacteria shall not exceed an MPN of 23 total coliform bacteria per 100 ml in more than one sample in any 30-day period, and
- c) No total coliform bacteria sample shall exceed an MPN of 240 total coliform bacteria per 100 ml.

---

<sup>6</sup> Modal contact time and CT shall be calculated based on the minimum one-hour average value in a 24-hr period.

<sup>7</sup> The modal contact time requirement is applicable only to the use of recycled water and not to surface water discharges, provided the receiving water provides a 1:1 dilution. The receiving water considered here shall exclude upstream POTW effluent flow.

<sup>8</sup> "Peak Dry Weather Flow" means the arithmetic mean of the maximum peak flow rates sustained over some period of time (for example three hours) during the maximum 24-hour dry weather period. Dry weather period is defined as period of little or no rainfall.

f. Total Chlorine Residual:

The discharge shall not exceed the following:

- 1) The total time during which the total chlorine residual values are above 0.1 mg/L (instantaneous maximum value) shall not exceed 7 hours and 26 minutes in any calendar month;
- 2) No individual excursion from 0.1 mg/L value shall exceed 30 minutes; and
- 3) No individual excursion shall exceed 5.0 mg/L.

g. pH:

The pH of the discharge shall be maintained between 6.5 to 8.5 pH units. Compliance with pH limits shall be determined as follows:

- 1) The total time during which the pH is outside the range of 6.5-8.5 pH units shall not exceed 7 hours and 26 minutes in any calendar month; and
- 2) No individual excursion from the above range shall exceed 60 minutes.

**2. Effluent Limitations Under Conditions of 20:1 or More Dilution in the Receiving Water**

- a. Whenever the flow<sup>9</sup> in Temescal Creek, as measured at monitoring location R-001U, results in a dilution of 20:1 (receiving water flow : wastewater flow) or more, the Discharger shall comply with the following effluent limitations in lieu of those specified in Effluent Limitation IV.A.1., above:

**Table 6. Effluent Limitations at DP-001 with 20:1 Dilution**

Parameter	Units	Effluent Limitations				
		Average Monthly	Average Weekly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum
Biochemical Oxygen Demand 5-day @ 20°C	mg/L (lbs/day)	30 (13,136)	45 (19,703)	--	--	--
Total Suspended Solids	mg/L (lbs/day)	30 (13,136)	45 (19,703)	--	--	--
Ammonia-Nitrogen	mg/L	4.5	--	--	--	--
Free Cyanide	µg/L	4.2		8.4		

<sup>9</sup> Exclusive of discharges to surface waters from upstream publicly owned treatment works.

Parameter	Units	Effluent Limitations				
		Average Monthly	Average Weekly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum
Total Recoverable Copper <sup>10</sup>	µg/L	12.1		18.3		
Total Recoverable Lead <sup>10</sup>	µg/L	3.6		6.7		
Total Recoverable Mercury	µg/L	0.051		0.103		
Dichlorobromomethane	µg/L	46		75		

b. Percent Removal:

The average monthly percent removal of BOD 5-day 20°C and total suspended solids shall not be less than 85 percent.

c. Coliform:

The coliform shall be measured at monitoring locations M-002 to M-007 as described in Attachment E:

The weekly median number of coliform bacteria shall not exceed a median of 23 per 100 milliliters as determined from the daily coliform bacteria values for the last seven (7) days. To comply with this limit, the 7-day median MPN must not exceed 23 per 100 milliliters on any day during the week. However, only one violation is recorded for each calendar week, even if the 7-day median MPN value is greater than 23 for more than one day in the week.

d. pH:

The pH of the discharge shall be maintained between 6.0 to 9.0 pH units. Compliance with pH limits shall be determined as follows:

- 1) The total time during which the pH is outside the range of 6.0-9.0 pH units shall not exceed 7 hours and 26 minutes in any calendar month; and
- 2) No individual excursion from the above range shall exceed 60 minutes.

**3. Toxicity Requirements**

- a. There shall be no acute or chronic toxicity in the discharge nor shall the discharge cause any acute or chronic toxicity in the receiving water. All waters shall be maintained free of toxic substances in concentrations which are toxic to, or which produce detrimental physiological responses in human, plant, animal, or

<sup>10</sup> Effluent limitations for copper and lead have been added to this Order because the Facility discharges treated wastewater from DP-001 to Reach 5 of Temescal Creek, a tributary of Reach 3 of the Santa Ana River that is listed on the Clean Water Act 303(d) list as being impaired for copper and lead.

indigenous aquatic life. This Order contains no numeric limitation for toxicity. However, the Discharger shall conduct chronic toxicity monitoring.

- b. The Discharger shall implement the accelerated monitoring as specified in Attachment E when the result of any single chronic toxicity test of the effluent exceeds 1.0 TUc.

**B. Land Discharge Specifications – Not Applicable**

**C. Reclamation Specifications – Not Applicable**

**D. Stormwater Discharge Specifications**

1. Storm water discharges (meaning storm water runoff, surface runoff, and drainage) shall not:
  - a. Cause or contribute to a violation of any applicable water quality standards contained in the Basin Plan, or in the State or Federal regulations.
  - b. Cause or threaten to cause pollution, contamination, or nuisance.
  - c. Contain a hazardous substance equal to or in excess of a reportable quantity listed in 40 CFR Part 117 and/or 40 CFR Part 302.
  - d. Adversely impact human health or the environment.
  - e. Result in noncompliance with the lawful requirements of municipalities, counties, drainage districts, and other local agencies on storm water discharges into storm drain systems or other courses under their jurisdiction.
2. The Discharger shall update and implement its Storm Water Pollution Prevention Plan for the Facility in accordance with Attachment J of this Order by January 1, 2016, and shall comply with the Stormwater Monitoring and Reporting requirements in accordance with Attachment K of this Order. .
3. Storm water discharges from the facility shall be in compliance with the provisions of State Water Board's Order No. 2014-0057-DWQ except that the Discharger need not file Permit Registration Documents for coverage under the State Water Board's Order and need not pay a separate fee for it.

**V. RECEIVING WATER LIMITATIONS**

**A. Surface Water Limitations**

1. Receiving water limitations are based upon water quality objectives contained in the Basin Plan. As such, they are a required part of this Order. The discharge shall not cause the following in receiving waters:

- a. Coloration of the receiving waters, which causes a nuisance or adversely affects beneficial uses.
  - b. Deposition of oil, grease, wax or other materials in the receiving waters in concentrations which result in a visible film or in coating objects in the water, or which cause a nuisance or affect beneficial uses.
  - c. An increase in the amounts of suspended or settleable solids in the receiving waters, which will cause a nuisance or adversely affect beneficial uses as a result of controllable water quality factors.
  - d. Taste or odor-producing substances in the receiving waters at concentrations, which cause a nuisance or adversely affect beneficial uses.
  - e. The presence of radioactive materials in the receiving waters in concentrations, which are deleterious to human, plant or animal life.
  - f. The depletion of the dissolved oxygen concentration below 5.0 mg/l.
  - g. The temperature of the receiving waters to be raised above 90°F (32°C) during the period of June through October, or above 78°F (26°C) during the rest of the year.
  - h. The concentration of pollutants in the water column, sediments, or biota to adversely affect the beneficial uses of the receiving water. The discharge shall not result in the degradation of inland surface water communities and populations, including vertebrate, invertebrate, and plant species.
2. The discharge of wastes shall not cause a violation of any applicable water quality standards for receiving waters adopted by the Regional Water Board or State Water Board, as required by the Clean Water Act and regulations adopted thereunder.
  3. Pollutants not specifically mentioned and limited in this Order shall not be discharged at levels that will bioaccumulate in aquatic resources to levels, which are harmful to human health.
  4. The discharge shall not contain constituent concentrations of mercury that will result in the bioaccumulation of methylmercury in fish flesh tissue greater than 0.3 milligram methylmercury/kilogram. (See also Section VI.C.1.e. and VI.C.2.a, below).

## **B. Groundwater Limitations**

The discharge of waste shall not cause the underlying groundwater to be degraded, to exceed water quality objectives, unreasonably affect beneficial uses, or cause a condition of pollution or nuisance.

## VI. PROVISIONS

### A. Standard Provisions

1. The Discharger shall comply with all Federal Standard Provisions included in Attachment D of this Order.
2. Failure to comply with provisions or requirements of this Order, or violation of other applicable laws or regulations governing discharges from this facility, may subject the Discharger to administrative or civil liabilities, criminal penalties, and/or other enforcement remedies to ensure compliance. Additionally, certain violations may subject the Discharger to civil or criminal enforcement from appropriate local, state, or federal law enforcement entities.
3. In the event the Discharger does not comply or will be unable to comply for any reason, with any prohibition, discharge limitations (e.g., maximum daily effluent limitation), or receiving water limitation of this Order, the Discharger shall notify the Regional Water Board by telephone (951) 782-4130 within 24 hours of having knowledge of such noncompliance, and shall confirm this notification in writing within five (5) days, and/or email to [RB8-SantaAna@waterboards.ca.gov](mailto:RB8-SantaAna@waterboards.ca.gov) within 24 hours. The email notifications allow for proper documentation and can help to outline the issue that has occurred, unless the Regional Water Board waives confirmation. The written notification shall state the nature, time, duration, and cause of noncompliance, and shall describe the measures being taken to remedy the current noncompliance and, prevent recurrence including, where applicable, a schedule of implementation. Other noncompliance requires written notification as above at the time of the normal monitoring report.
4. Neither the treatment nor the discharge of waste shall create a pollution, contamination, or nuisance as defined by Section 13050 of the CWC.
5. The Discharger shall take all reasonable steps to minimize or correct any adverse impact on the environment resulting from noncompliance with this Order, including such accelerated or additional monitoring as may be necessary to determine the nature and impact of the noncomplying discharge.
6. This Order may be modified, revoked and reissued, or terminated for cause including, but not limited to, the following:
  - a. Violation of any terms or conditions of this Order;
  - b. Obtaining this Order by misrepresentation or failure to disclose fully all relevant facts, or;
  - c. In addition to any other grounds specified herein, this Order may be modified or revoked at any time if, on the basis of any data, the Regional Water Board determines that continued discharges may cause unreasonable degradation of water quality.

7. If an effluent standard or discharge prohibition (including any schedule of compliance specified in such effluent standard or prohibition) is established under Section 307 (a) of the Clean Water Act for a toxic pollutant which is present in the discharge, and such standard or prohibition is more stringent than any limitation for that pollutant in this Order, this Order may be modified or revoked and reissued to conform to the effluent standard or discharge prohibition.
8. The Discharger shall file with the Regional Water Board a Report of Waste Discharge at least 180 days before making any material change in the character, location, or volume of the discharge. A material change includes, but is not limited to, the following:
  - a. Adding a major industrial waste discharge to a discharge of essentially domestic sewage, or adding a new process or product by an industrial facility resulting in a change in the character of the waste.
  - b. Significantly changing the disposal method or location, such as changing the disposal to another drainage area or water body.
  - c. Significantly changing the method of treatment.
  - d. Increasing the treatment plant design capacity beyond that specified in this Order.
9. The provisions of this Order are severable, and if any provision of this Order, or the application of any provision of this Order to any circumstance, is held invalid, the application of such provision to other circumstances, and the remainder of this Order, shall not be affected thereby.
10. The Discharger shall maintain a copy of this Order at the site so that it is available to site operating personnel at all times. Key operating personnel shall be familiar with its content.
11. The Discharger shall optimize chemical additions needed in the treatment process to meet waste discharge requirements so as to minimize total dissolved solid increases in the treated wastewater.
12. The Discharger has demonstrated a correlation between the biological oxygen demand (BOD<sub>5</sub>) and total organic carbon (TOC) concentrations in the effluent to the satisfaction of the Executive Officer. Therefore, compliance with the BOD<sub>5</sub> limits contained in this Order may be determined based on analyses of the TOC of the effluent.
13. In the event of any change in control or ownership of land or waste discharge facility presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be forwarded to the Regional Water Board.

14. The treatment facilities shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.
15. The Discharger shall file a written report with the Regional Board within ninety (90) days after the average dry-weather waste flow for any month equals or exceeds 75 percent of the design capacity of the waste treatment and/or disposal facilities. The Discharger's senior administrative officer shall sign a letter which transmits that report and certifies that the policy making body is adequately informed about it. The report shall include:
  - a. Average daily flow for the month, the date on which instantaneous peak flow occurred, the rate of that peak flow, and the total flow for the day.
  - b. The Discharger's best estimate of when the average daily dry-weather flow rate will equal or exceed the design capacity of the treatment and/or disposal facilities.
  - c. The Discharger's intended schedule for studies, design, and/or other steps needed to provide additional capacity for the waste treatment and/or disposal facilities before the waste flow rate equals the capacity of present units.

## **B. Monitoring and Reporting Program (MRP) Requirements**

The Discharger shall comply with the Monitoring and Reporting Program, and future revisions thereto, in Attachment E of this Order. This monitoring and reporting program may be modified by the Executive Officer at any time during the term of this Order, and may include an increase in the number of parameters to be monitored, the frequency of the monitoring or the number and size of samples to be collected. Any increase in the number of parameters to be monitored, the frequency of the monitoring or the number and size of samples to be collected may be reduced back to the levels specified in the original monitoring and reporting program at the discretion of the Executive Officer.

## **C. Special Provisions**

### **1. Reopener Provisions**

- a. This Order will be reopened to address any changes in State or federal statutes, plans, policies or regulations that would affect the quality requirements for the discharges.
- b. This Order may be reopened to include effluent limitations for pollutants determined to be present in the discharge in concentrations that pose a reasonable potential to cause or contribute to violations of water quality objectives.
- c. This Order may be reopened and modified in accordance with the requirements set forth at 40 CFR 122 and 124, to include the appropriate conditions or limits to address demonstrated effluent toxicity based on newly available information, or

to implement any EPA-approved new State water quality standards applicable to effluent toxicity.

- d. This Order may be reopened for modification, or revocation and reissuance, as a result of the detection of a reportable priority pollutant generated by special conditions included in this Order. These special conditions may be, but are not limited to, fish tissue sampling, whole effluent toxicity, monitoring requirements on internal waste stream(s), and monitoring for surrogate parameters. Additional requirements may be included in this Order as a result of the special condition monitoring data.
- e. This Order may be reopened to include an appropriate bioaccumulation-based effluent limit for mercury if test results (as required in Attachment E of this Order) show that the concentration levels of methylmercury in the fish tissue are at or above 0.3 milligrams per kilogram.
- f. This Order may be reopened to incorporate appropriate biosolids requirements if the State Water Resources Control Board and the Regional Water Board are given the authority to implement regulations contained in 40 CFR 503.

## **2. Special Studies, Technical Reports and Additional Monitoring Requirements**

- a. Within 60 days of the effective date of this Order, the Discharger shall notify the Executive Officer of its continued involvement with the comprehensive mercury investigation program currently being conducted by the Santa Ana River Dischargers Association (SARDA). If the Discharger discontinues its involvement with this comprehensive program, the Discharger shall, within 60 days of that date, submit for the approval of the Executive Officer its plan for the annual testing of mercury levels in fish flesh samples collected from the Santa Ana River, upstream of, at, and downstream of the point of the discharge point. Upon approval the Discharger shall implement the plan.
- b. Toxicity Reduction Requirements.
  - 1) Within 60 days of the effective date of this Order, the Discharger shall develop an Initial Investigation Toxicity Reduction Evaluation (IITRE) work plan that describes the steps the Discharger intends to follow if required by Toxicity Requirements b.2), below. The work plan shall include at a minimum:
    - a) A description of the investigation and evaluation techniques that will be used to identify potential causes/sources of the exceedance, effluent variability, and/or efficiency of the treatment system in removing toxic substances. This shall include a description of an accelerated chronic toxicity testing program.
    - b) A description of the methods to be used for investigating and maximizing in-house treatment efficiency and good housekeeping practices.

- c) A description of the evaluation process to be used to determine if implementation of a more detailed Toxicity Reduction Evaluation and Toxicity Identification Evaluation (TRE/TIE) is necessary.
  - 2) The Discharger shall implement the IITRE work plan whenever the results of chronic toxicity tests of the effluent exceed:
    - a) A two month median value of 1.0 TUc for survival or reproduction endpoint or,
    - b) Any single test value of 1.7 TUc for survival endpoint.
  - 3) The Discharger shall develop a detailed TRE/TIE work plan that shall describe the steps the Discharger intends to follow if the implemented IITRE fails to identify the cause of, or to rectify, the toxicity.
  - 4) The Discharger shall use as guidance, at a minimum, EPA manuals EPA/600/2-88/070 (industrial), EPA/600/4-89-001A (municipal), EPA/600/6-91/005F (Phase I), EPA/600/R-92/080 (Phase II), and EPA-600/R-92/081 (Phase III) to identify the cause(s) of toxicity. If during the life of this Order the aforementioned EPA manuals are revised or updated, the revised/updated manuals may also be used as guidance. The detailed TRE/TIE work plan shall include:
    - a) Further actions to investigate and identify the cause of toxicity;
    - b) Actions the Discharger will take to mitigate the impact of the discharge and to prevent the recurrence of toxicity; and
    - c) A schedule for these actions.
  - 5) The Discharger shall implement the TRE/TIE workplan if the IITRE fails to identify the cause of, or rectify, the toxicity, or if in the opinion of the Executive Officer, the IITRE does not adequately address an identified toxicity problem.
  - 6) The Discharger shall assure that adequate resources are available to implement the required TRE/TIE.
- c. TDS/TIN

As the drought continues, the TDS quality of the water supply within EMWD's service area has risen. This has caused the effluent TDS concentrations to rise simultaneously, which has caused the effluent concentrations to be in excess of limits specified in EMWD's waste discharge requirements.

As noted in Table 4 of the Fact Sheet (Attachment F), Temescal Creek recharges the underlying groundwater basins in the Upper Temescal Valley. EMWD has been participating in a study with Elsinore Valley Municipal Water District to determine appropriate groundwater quality objectives and ambient water quality for the Upper Temescal Valley Groundwater Management Zones. The culmination of this study will include an overall salt management plan for the management zones. Until groundwater quality objectives and ambient water

quality are determined, it is not known how EMWD's discharge affects those management zones. It may be shown that EMWD's current discharge quality does not adversely affect these basins. However, if it is shown that the discharge does adversely affect water quality, the management plan will include an action plan to mitigate those impacts. At the conclusion of the study, this Order may be reopened to include a time schedule for the Discharger to submit a salt and nutrient management plan to the Regional Board's Executive Officer for approval.

### **3. Best Management Practices and Pollution Prevention**

#### **a. Pollutant Minimization Program**

- 1) The Discharger shall develop and conduct a Pollutant Minimization Program (PMP) as further described below when there is evidence (e.g., sample results reported as DNQ when the effluent limitation is less than the MDL, sample results from analytical methods more sensitive than those methods required by this Order, presence of whole effluent toxicity, health advisories for fish consumption, results of benthic or aquatic organism tissue sampling) that a priority pollutant is present in the effluent above an effluent limitation and either:
  - a) A sample result is reported as DNQ and the effluent limitation is less than the RL; or
  - b) A sample result is reported as ND and the effluent limitation is less than the MDL.
- 2) The PMP shall include, but not be limited to, the following actions and submittals acceptable to the Regional Water Board:
  - a) An annual review and annual monitoring of potential sources of the reportable priority pollutant(s), which may include fish tissue monitoring and other bio-uptake sampling;
  - b) Annual monitoring for the reportable priority pollutant(s) in the influent to the wastewater treatment system;
  - c) Submittal of a control strategy designed to proceed toward the goal of maintaining concentrations of the reportable priority pollutant(s) in the effluent at or below the effluent limitation;
  - d) Implementation of appropriate cost-effective control measures for the reportable priority pollutant(s), consistent with the control strategy; and
  - e) An annual status report to be sent to the Regional Water Board that includes:
    - (1) All PMP monitoring results for the previous year;
    - (2) A list of potential sources of the reportable priority pollutant(s);
    - (3) A summary of all actions undertaken pursuant to the control strategy; and
    - (4) A description of actions to be taken in the following year.

#### **4. Construction, Operation and Maintenance Specifications**

- a. The Discharger's wastewater treatment facilities, including Rancho California Water District's Santa Rosa Water Reclamation Facility, shall be supervised and operated by persons possessing certificates of appropriate grade pursuant to Title 23, Division 3, Chapter 14, California Code of Regulations.
- b. The Discharger shall provide safeguards to assure that should there be reduction, loss, or failure of electric power, the Discharger will comply with the requirements of this Order.
- c. The Discharger shall update as necessary, the "Operation and Maintenance Manual (O&M Manual)" which it has developed for the treatment facility to conform to latest plant changes and requirements. The O&M Manual shall be readily available to operating personnel onsite. The O&M Manual shall include the following:
  - 1) Description of the treatment plant table of organization showing the number of employees, their duties and qualifications, and plant attendance schedules (daily, weekends and holidays, part-time, etc.). The description should include documentation that the personnel are knowledgeable and qualified to operate the treatment facility so as to achieve the required level of treatment at all times.
  - 2) Detailed description of safe and effective operation and maintenance of treatment processes, process control instrumentation and equipment.
  - 3) Description of laboratory and quality assurance procedures.
  - 4) Process and equipment inspection and maintenance schedules.
  - 5) Description of safeguards to assure that, should there be reduction, loss, or failure of electric power, the Discharger will be able to comply with requirements of this Order.
  - 6) Description of preventive (fail-safe) and contingency (response and cleanup) plans for controlling accidental discharges, and for minimizing the effect of such events. These plans shall identify the possible sources (such as loading and storage areas, power outage, waste treatment unit failure, process equipment failure, tank and piping failure) of accidental discharges, untreated or partially treated waste bypass, and polluted drainage.

#### **5. Special Provisions for Municipal Facilities (POTWs Only) – Not Applicable**

#### **6. Pretreatment Program– Not Applicable**

This Order does not include any pretreatment requirements. Pretreatment requirements and monitoring and reporting requirements are specified in Order No. R8-2008-0008 (for facilities located in the Santa Ana Region), Order No. R9-2000-165 (for Temecula Valley RWRf), and Order No. R9-94-92 (for Santa Rosa Water Reclamation Facility).

## 7. Compliance Schedules – Not Applicable

### VII. COMPLIANCE DETERMINATION

Compliance with the effluent limitations contained in section IV of this Order will be determined as specified below:

#### A. General.

Compliance with effluent limitations for priority pollutants shall be determined using sample reporting protocols defined in the MRP and Attachment A of this Order. For purposes of reporting and administrative enforcement by the Regional and State Water Boards, the Discharger shall be deemed out of compliance with effluent limitations if the concentration of the priority pollutant in the monitoring sample is greater than the effluent limitation and greater than or equal to the minimum level (ML).

#### B. Average Monthly Effluent Limitation (AMEL).

If the average, or when applicable, the median for multiple sample data (see subsection G, below), of daily discharges over a calendar month exceeds the AMEL for a given parameter, this will represent a single violation, though the Discharger may be considered out of compliance for each day of that month for that parameter (e.g., resulting in 31 days of non-compliance in a 31-day month). If only a single sample is taken during the calendar month and the analytical result for that sample exceeds the AMEL, the Discharger may be considered out of compliance for that calendar month. The Discharger will only be considered out of compliance for days when the discharge occurs. For any one calendar month during which no sample (daily discharge) is taken, no compliance determination can be made for that calendar month.

#### C. Average Weekly Effluent Limitation (AWEL).

If the average, or when applicable, the median for multiple sample data (see subsection G, below), of daily discharges over a calendar week exceeds the AWEL for a given parameter, this will represent a single violation, though the Discharger may be considered out of compliance for each day of that week for that parameter, resulting in 7 days of non-compliance. If only a single sample is taken during the calendar week and the analytical result for that sample exceeds the AWEL, the Discharger may be considered out of compliance for that calendar week. The Discharger will only be considered out of compliance for days when the discharge occurs. For any one calendar week during which no sample (daily discharge) is taken, no compliance determination can be made for that calendar week.

#### D. Maximum Daily Effluent Limitation (MDEL).

If a daily discharge exceeds the MDEL for a given parameter, the Discharger will be considered out of compliance for that parameter for that 1 day only within the reporting period. For any 1 day during which no sample is taken, no compliance determination can be made for that day.

#### E. Instantaneous Minimum Effluent Limitation.

If the analytical result of a single grab sample is lower than the instantaneous minimum effluent limitation for a parameter, the Discharger will be considered out of compliance for that parameter for that single sample. Non-compliance for each sample will be

considered separately (e.g., the results of two grab samples taken within a calendar day that both are lower than the instantaneous minimum effluent limitation would result in two instances of non-compliance with the instantaneous minimum effluent limitation).

**F. Instantaneous Maximum Effluent Limitation.**

If the analytical result of a single grab sample is higher than the instantaneous maximum effluent limitation for a parameter, the Discharger may be considered out of compliance for that parameter for that single sample. Non-compliance for each sample may be considered separately (e.g., the results of two grab samples taken within a calendar day that both exceed the instantaneous maximum effluent limitation would result in two instances of non-compliance with the instantaneous maximum effluent limitation).

**G. Multiple Sample Data.**

When determining compliance with an AMEL for priority pollutants and more than one sample result is available, the Discharger shall compute the arithmetic mean unless the data set contains one or more reported determinations of "Detected, but Not Quantified" (DNQ) or "Not Detected" (ND). In those cases, the Discharger shall compute the median in place of the arithmetic mean in accordance with the following procedure:

1. The data set shall be ranked from low to high, ranking the reported ND determinations lowest, DNQ determinations next, followed by quantified values (if any). The order of the individual ND or DNQ determinations is unimportant.
2. The median value of the data set shall be determined. If the data set has an odd number of data points, then the median is the middle value. If the data set has an even number of data points, then the median is the average of the two values around the middle unless one or both of the points are ND or DNQ, in which case the median value shall be the lower of the two data points where DNQ is lower than a value and ND is lower than DNQ.

**H. 12-Month Running Average Effluent Limitation.**

Compliance with the 12-month running average limits under Effluent Limitations and Discharge Specification IV.A.1.c. and IV.A.1.d. shall be determined by the arithmetic mean of the last twelve monthly averages.

**I. Turbidity Limitations.**

The Discharger shall be considered in compliance with Discharge Specifications IV.A.1.e.1) if the following conditions are met. If the Discharger is using a properly operating backup turbidimeter, the reading of the backup turbidimeter shall be considered in determining whether there has been an actual noncompliance:

1. There are no excursions above the limits specified in Discharge Specifications IV.A.1.e.(1)(a) and (b).
2. Exceedances of the "10 NTU at any time" turbidity requirement do not exceed a duration of one minute.
3. The apparent exceedance was caused by interference with, or malfunction of, the monitoring instrument.

## J. Priority Pollutants.

The Discharger shall be deemed out of compliance with an effluent limitation if the concentration of the priority pollutant in the monitoring sample is greater than the effluent limitation.

1. Compliance determination shall be based on the reporting level selected from minimum level (ML)<sup>11</sup> specified in Attachment H of this Order, unless an alternative reporting level is approved by the Regional Water Board's Executive Officer. When there is more than one ML value for a given substance, the Discharger shall select the ML value that is below the calculated effluent limitation, and use its associated analytical method, listed in Attachment H of this Order. If no ML value is below the effluent limitation, then the Regional Water Board will select as the reporting level the lowest ML value and its associated analytical method.
2. When determining compliance with an average monthly limit and more than one sample result is available in a month, the Discharger shall compute the arithmetic mean unless the data set contains one or more reported determinations of detected but not quantified (DNQ) or not detected (ND). In those cases, the Discharger shall compute the median in place of the arithmetic mean in accordance with the following procedure:
  - a. The data set shall be ranked from low to high, reported ND determinations lowest, DNQ determinations next, followed by quantified values (if any). The order of the individual ND or DNQ determinations is unimportant.
  - b. The median value of the data set shall be determined. If the data set has an odd number of data points, then the median is the middle value. If the data set has an even number of data points, then the median is the average of the two values around the middle unless one or both of the points are ND or DNQ, in which case the median value shall be the lower of the two data points where DNQ is lower than a value and ND is lower than DNQ. If a sample result, or the arithmetic mean or median of multiple sample results, is below the reporting level, and there is evidence that the priority pollutant is present in the effluent above an effluent limitation and the Discharger conducts a pollutant minimization program (PMP)<sup>12</sup> the Discharger shall not be deemed out of compliance.

## K. Compliance Determination

Compliance determinations shall be based on available analyses for the time interval associated with the effluent limitation. Where only one sample analysis is available in a specified time interval (e. g., monthly or weekly average), that sample shall serve to characterize the discharge for the entire interval. If quarterly sample results show

---

<sup>11</sup> Minimum level is the concentration at which the entire analytical system must give a recognizable signal and acceptable point. The ML is the concentration in a sample that is equivalent to the concentration of the lowest calibration standard analyzed by a specific analytical procedure, assuming that all the method specified sample weights, volumes, and processing steps have been followed.

<sup>12</sup> The goal of the PMP shall be to reduce all potential sources of a priority pollutant(s) through pollutant minimization (control) strategies, including pollution prevention measures as appropriate, to maintain the effluent concentration at or below the water quality-based effluent limitation.

noncompliance with the average monthly limit and that sample result is used for compliance determinations for each month of the quarter, then three separate violations of the average monthly limit shall be deemed to have occurred.

Compliance with a single effluent limitation which applies to a group of chemicals (e.g., PCBs), based on a single sample shall be determined by considering the concentrations of individual members of the group to be zero if the analytical response for the individual chemical falls below the method detection limit (MDL) for that chemical.

## ATTACHMENT A – DEFINITIONS

**Arithmetic Mean ( $\mu$ )**, also called the average, is the sum of measured values divided by the number of samples. For ambient water concentrations, the arithmetic mean is calculated as follows:

$$\text{Arithmetic mean} = \mu = \Sigma x / n$$

where:  $\Sigma x$  is the sum of the measured ambient water concentrations, and  
 $n$  is the number of samples.

**Average Monthly Effluent Limitation (AMEL)**: the highest allowable average of daily discharges over a calendar month, calculated as the sum of all daily discharges measured during a calendar month divided by the number of daily discharges measured during that month.

**Average Weekly Effluent Limitation (AWEL)**: the highest allowable average of daily discharges over a calendar week (Sunday through Saturday), calculated as the sum of all daily discharges measured during a calendar week divided by the number of daily discharges measured during that week.

**Best Management Practices (BMPs)** are methods, measures, or practices designed and selected to reduce or eliminate the discharge of pollutants to surface waters from point and nonpoint source discharges including storm water. BMPs include structural and non-structural controls, and operation and maintenance procedures, which can be applied before, during, and/or after pollution producing activities.

**Bioaccumulative pollutants** are those substances taken up by an organism from its surrounding medium through gill membranes, epithelial tissue, or from food and subsequently concentrated and retained in the body of the organism.

**Carcinogenic pollutants** are substances that are known to cause cancer in living organisms.

**Daily Discharge**: Daily Discharge is defined as either: (1) the total mass of the constituent discharged over the calendar day (12:00 am through 11:59 pm) or any 24-hour period that reasonably represents a calendar day for purposes of sampling (as specified in the permit), for a constituent with limitations expressed in units of mass or; (2) the unweighted arithmetic mean measurement of the constituent over the day for a constituent with limitations expressed in other units of measurement (e.g., concentration).

The daily discharge may be determined by the analytical results of a composite sample taken over the course of one day (a calendar day or other 24-hour period defined as a day) or by the arithmetic mean of analytical results from one or more grab samples taken over the course of the day.

**Detected, but Not Quantified (DNQ)** are those sample results less than the RL, but greater than or equal to the laboratory's MDL.

**Estimated Chemical Concentration** is the estimated chemical concentration that results from the confirmed detection of the substance by the analytical method below the ML value.

**Existing Discharger** means any discharger that is not a new discharger. An existing discharger includes an "increasing discharger" (i.e., an existing facility with treatment systems in place for its current discharge that is or will be expanding, upgrading, or modifying its existing permitted discharge after the effective date of this Policy).

**Infeasible** means not capable of being accomplished in a successful manner within a reasonable period of time, taking into account economic, environmental, legal, social, and technological factors.

**Inland Surface Waters** are all surface waters of the State that do not include the ocean, enclosed bays, or estuaries.

**Instantaneous Maximum Effluent Limitation:** the highest allowable value for any single grab sample or aliquot (i.e., each grab sample or aliquot is independently compared to the instantaneous maximum limitation).

**Instantaneous Minimum Effluent Limitation:** the lowest allowable value for any single grab sample or aliquot (i.e., each grab sample or aliquot is independently compared to the instantaneous minimum limitation).

**Maximum Daily Flow** is the maximum flow sample of all samples collected in a calendar day.

**Maximum Daily Effluent Limitation (MDEL)** means the highest allowable daily discharge of a pollutant, over a calendar day (or 24-hour period). For pollutants with limitations expressed in units of mass, the daily discharge is calculated as the total mass of the pollutant discharged over the day. For pollutants with limitations expressed in other units of measurement, the daily discharge is calculated as the arithmetic mean measurement of the pollutant over the day.

**MEC:** Maximum Effluent Concentration.

**Median** is the middle measurement in a set of data. The median of a set of data is found by first arranging the measurements in order of magnitude (either increasing or decreasing order). If the number of measurements ( $n$ ) is odd, then the median =  $X_{(n+1)/2}$ . If  $n$  is even, then the median =  $(X_{n/2} + X_{(n/2)+1})/2$  (i.e., the midpoint between the  $n/2$  and  $n/2+1$ ).

**Method Detection Limit (MDL)** is the minimum concentration of a substance that can be measured and reported with 99 percent confidence that the analyte concentration is greater than zero, as defined in 40 CFR 136, Appendix B, revised as of May 14, 1999.

**Monthly Averages** is the highest allowable average of daily discharges over a calendar month, calculated as the sum of all daily discharges measured during a calendar month divided by the number of daily discharges measured during that month. For TDS and TIN determination, the monthly averages shall be flow weighted.

**Minimum Level (ML)** is the concentration at which the entire analytical system must give a recognizable signal and acceptable calibration point. The ML is the concentration in a sample that is equivalent to the concentration of the lowest calibration standard analyzed by a specific analytical procedure, assuming that all the method specified sample weights, volumes, and processing steps have been followed.

**Not Detected (ND)** are those sample results less than the laboratory's MDL.

**Persistent pollutants** are substances for which degradation or decomposition in the environment is nonexistent or very slow.

**Pollutant Minimization Program (PMP)** means waste minimization and pollution prevention actions that include, but are not limited to, product substitution, waste stream recycling, alternative waste management methods, and education of the public and businesses. The goal of the PMP shall be to reduce all potential sources of a priority pollutant(s) through pollutant minimization (control) strategies, including pollution prevention measures as appropriate, to maintain the effluent concentration at or below the water quality-based effluent limitation. Pollution prevention measures may be particularly appropriate for persistent bioaccumulative priority pollutants where there is evidence that beneficial uses are being impacted. The Regional Water Board may consider cost-effectiveness when establishing the requirements of a PMP. The completion and implementation of a Pollution Prevention Plan, if required pursuant to CWC Section 13263.3(d), shall be considered to fulfill the PMP requirements. The following reporting protocols and definitions are used in determining the need to conduct a Pollution Minimization Program (PMP). Reporting protocols in the Monitoring and Reporting Program, Attachment E, Section X.B.4 describe sample results that are to be reported as Detected but Not Quantified (DNQ) or Not Detected (ND). Definitions for a Minimum Level (ML) and Method Detection Limit (MDL) are provided in Attachment A. A Reporting Level (RL) is the ML associated with an analytical method selected by the Discharger that is authorized for monitoring effluent limitations under this Order.

**Pollution Prevention** means any action that causes a net reduction in the use or generation of a hazardous substance or other pollutant that is discharged into water and includes, but is not limited to, input change, operational improvement, production process change, and product reformulation (as defined in Water Code Section 13263.3). Pollution prevention does not include actions that merely shift a pollutant in wastewater from one environmental medium to another environmental medium, unless clear environmental benefits of such an approach are identified to the satisfaction of the SWRCB or RWQCB.


**Process Optimization** means minor changes to the existing facility and treatment plant operations that optimize the effectiveness of the existing treatment processes.

**Public Entity** includes the federal government or a state, county, city and county, city, district, public authority, or public agency.


**Reporting Level (RL)** is the ML corresponding to an approved analytical method for reporting a sample result that is selected either from Appendix 4 of the SIP by the Regional Water Board in accordance with Section 2.4.2 of the SIP or established in accordance with Section 2.4.3 of the SIP. The ML is based on the proper application of method-based analytical procedures for sample preparation and the absence of any matrix interferences. Other factors may be applied to the ML depending on the specific sample preparation steps employed. For example, the treatment typically applied in cases where there are matrix-effects is to dilute the sample or sample aliquot by a factor of ten. In such cases, this additional factor must be applied to the ML in the computation of the RL.

**Source of Drinking Water** is any water designated as municipal or domestic supply (MUN) in a RWQCB basin plan.

**ATTACHMENT B – RECYCLED WATER SYSTEM LOCATION MAP**

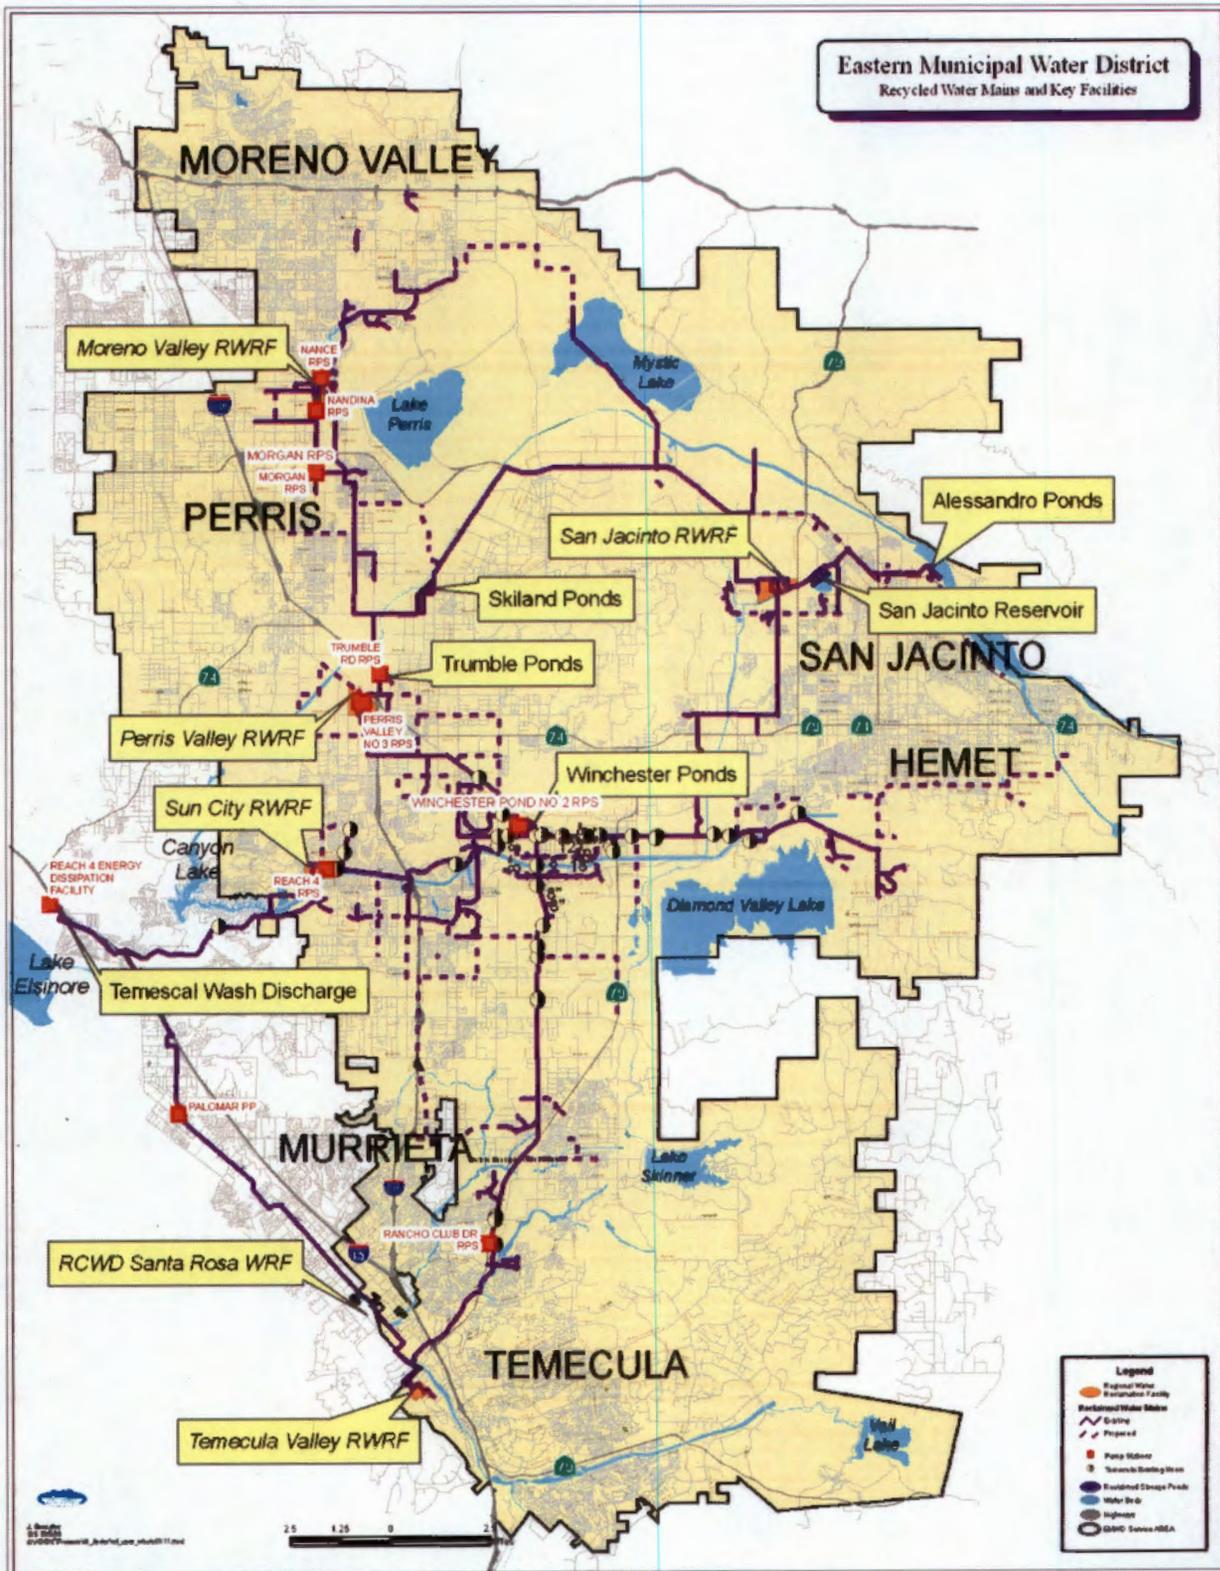


### SAN JACINTO RWRF LAYOUT

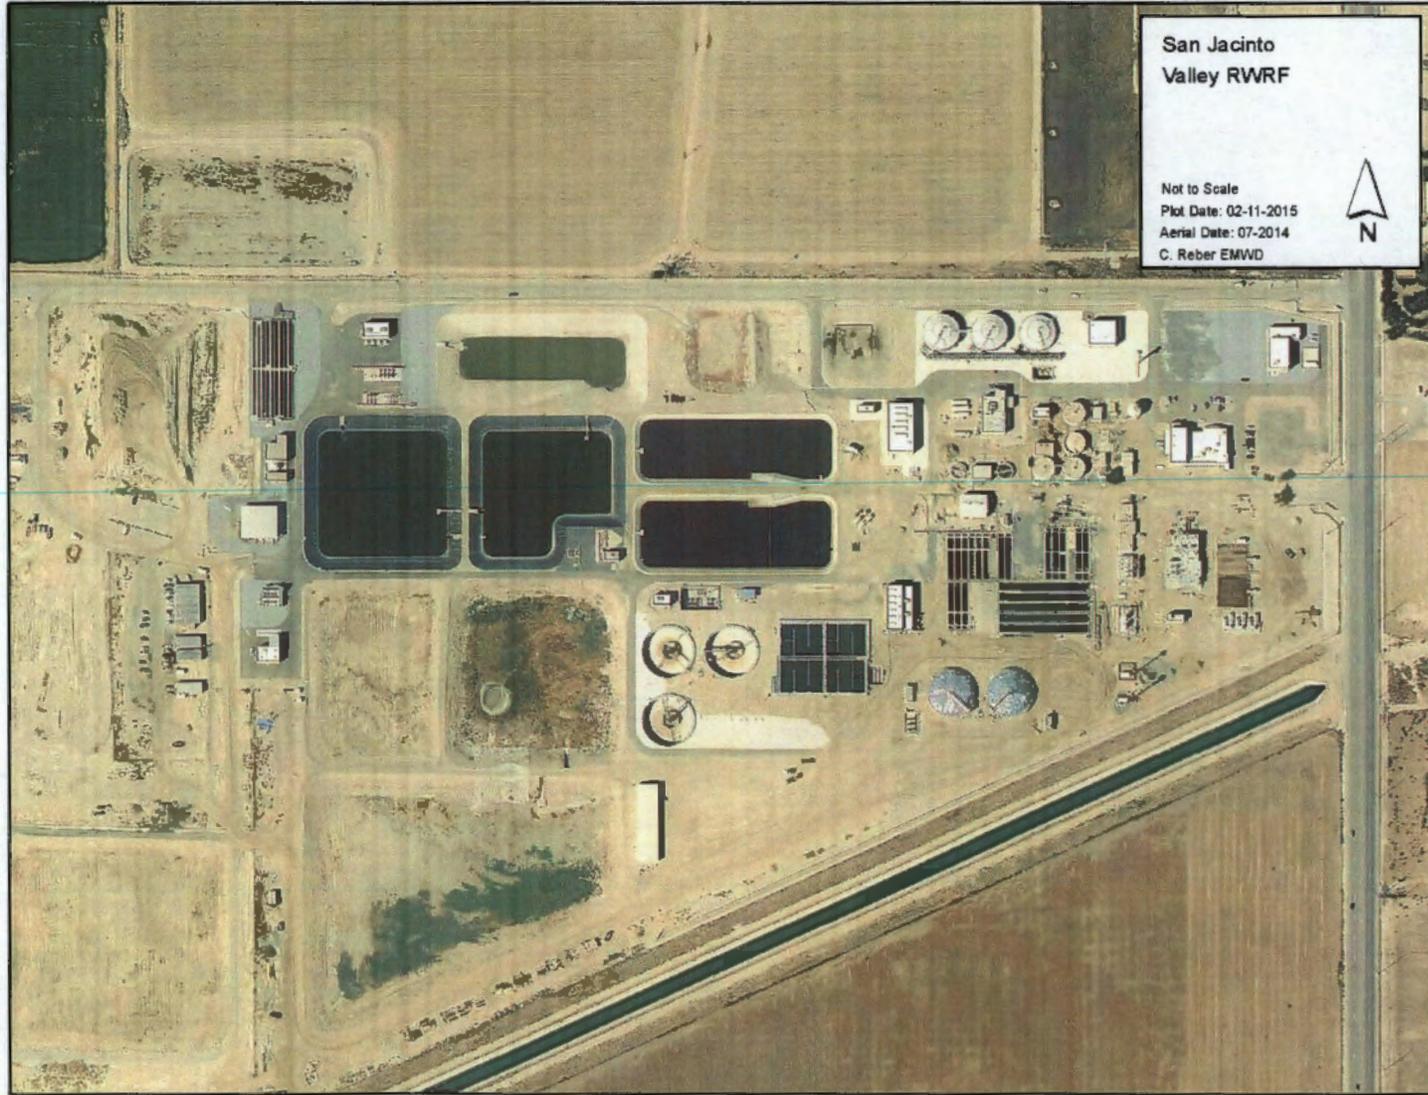

### MORENO VALLEY RWRFLAYOUT



### PERRIS VALLEY RWRP LAYOUT

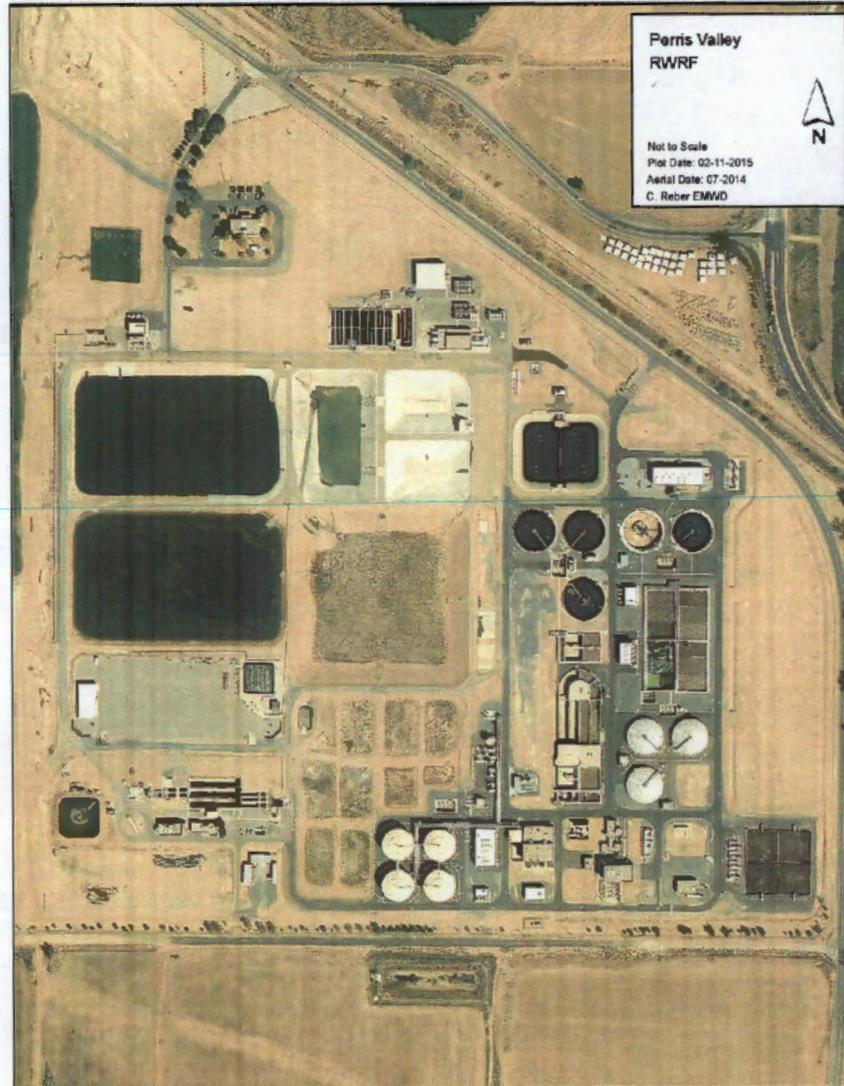

### SUN CITY RWRf LAYOUT




### TEMECULA VALLEY RWRf LAYOUT






## SANTA ROSA WATER RECLAMATION FACILITY LOCATION MAP


# RANCHO CALIFORNIA WATER DISTRICT CONSTRUCTION OF SANTA ROSA WATER RECLAMATION FACILITY INTERIM FACILITY IMPROVEMENTS (PROJECT No. 20103)

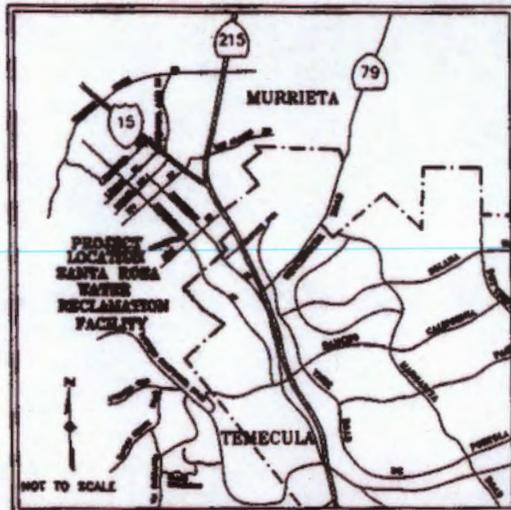

LOCATION MAP

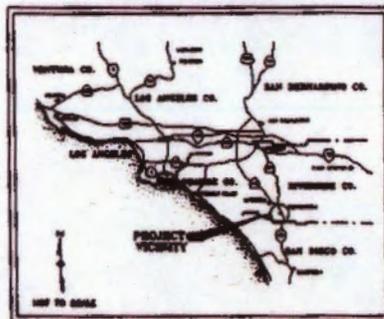


VICINITY MAP

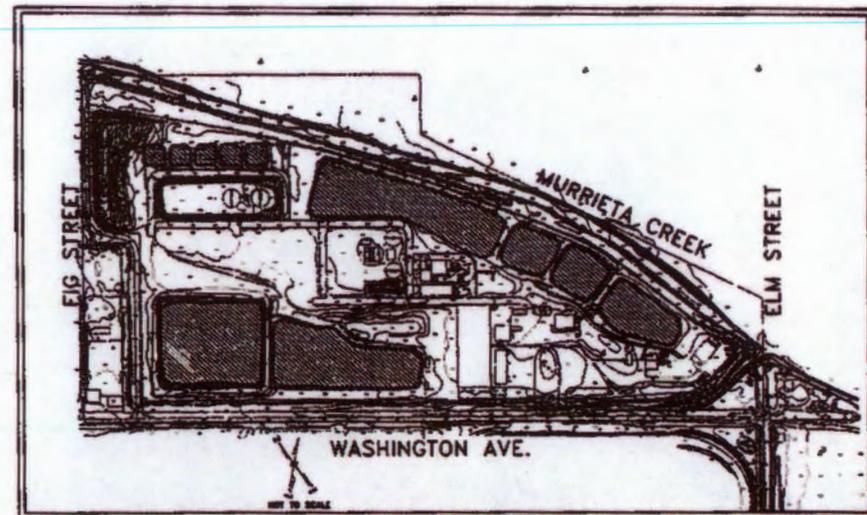


DETAILED LOCATION MAP




ATTACHMENT C – EWMD RECYCLED WATER SYSTEM SCHEMATIC

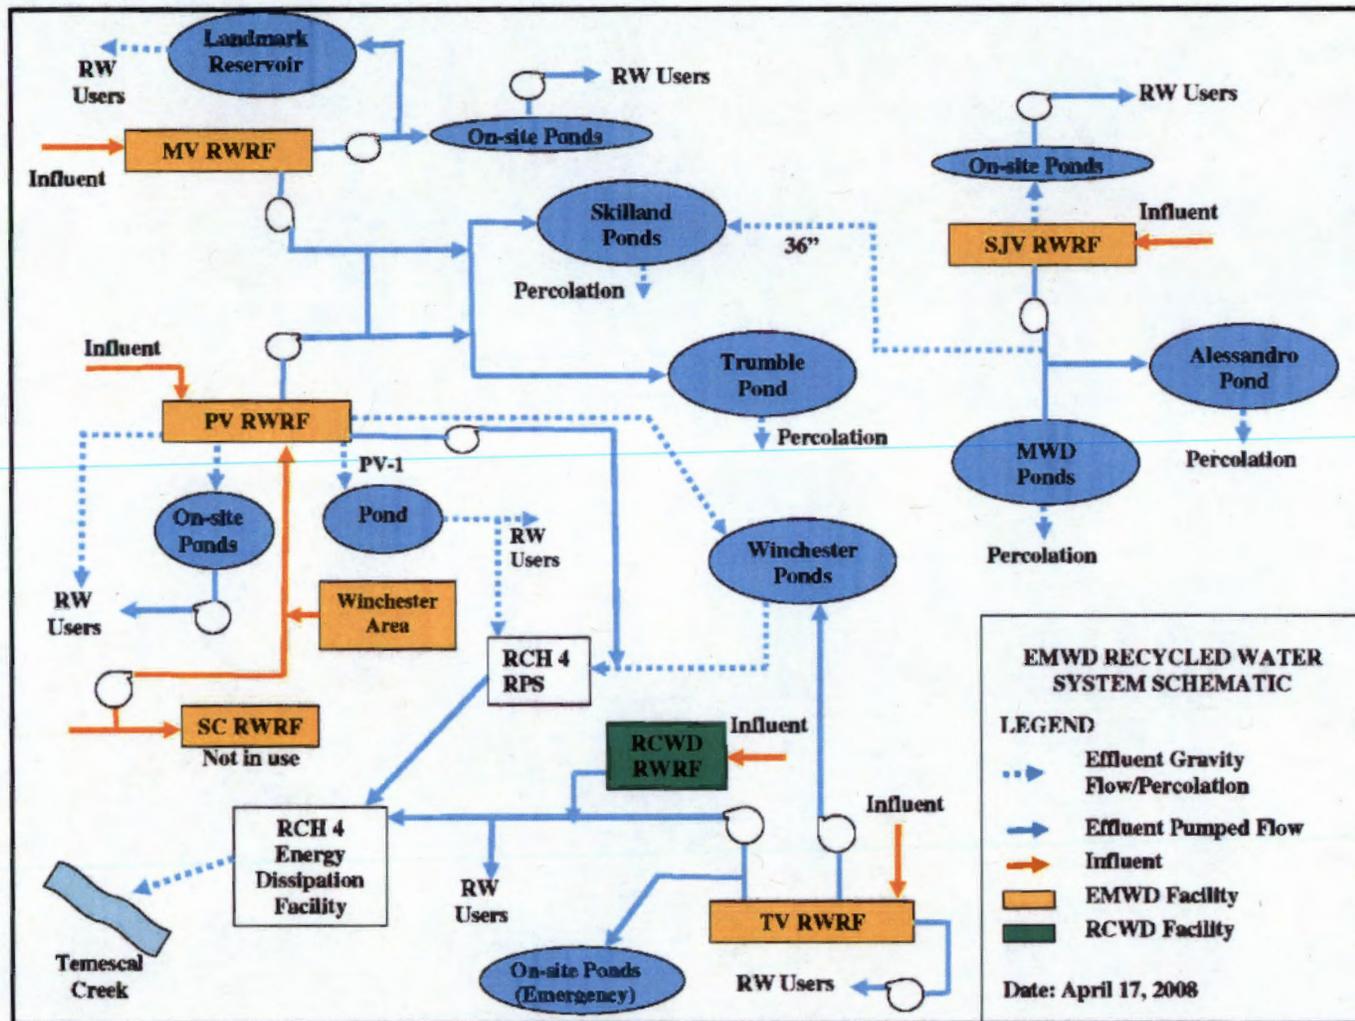


### SAN JACINTO VALLEY RWRf FLOW SCHEMATIC

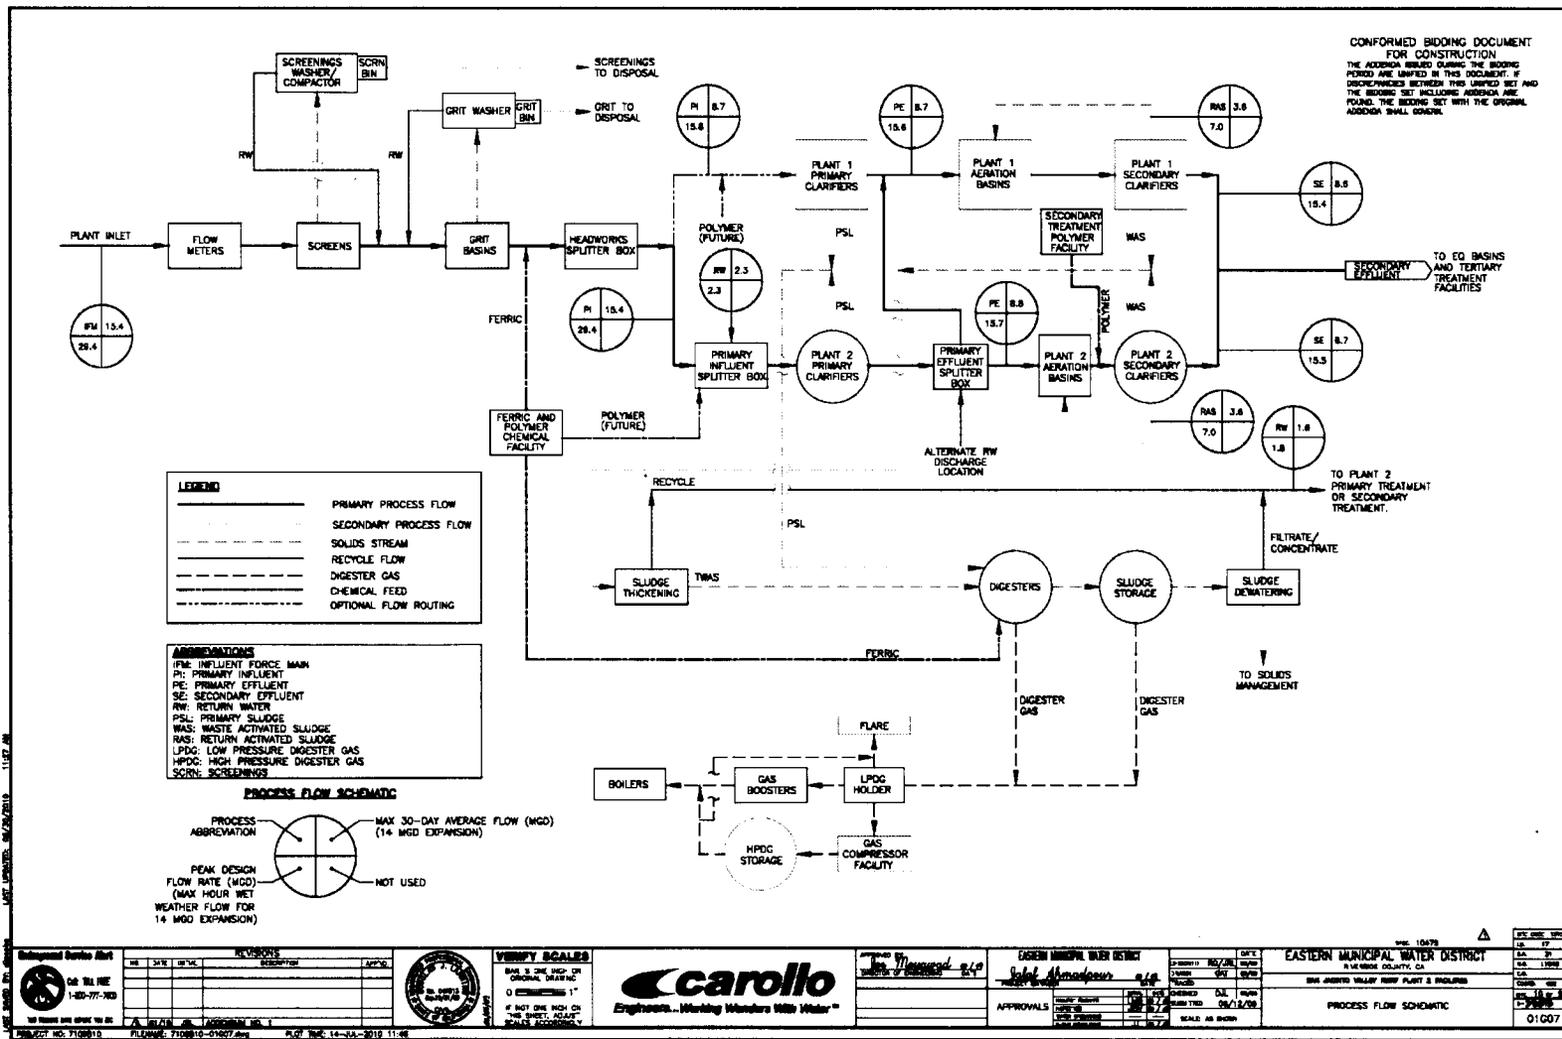

### MORENO VALLEY RWRf FLOW SCHEMATIC

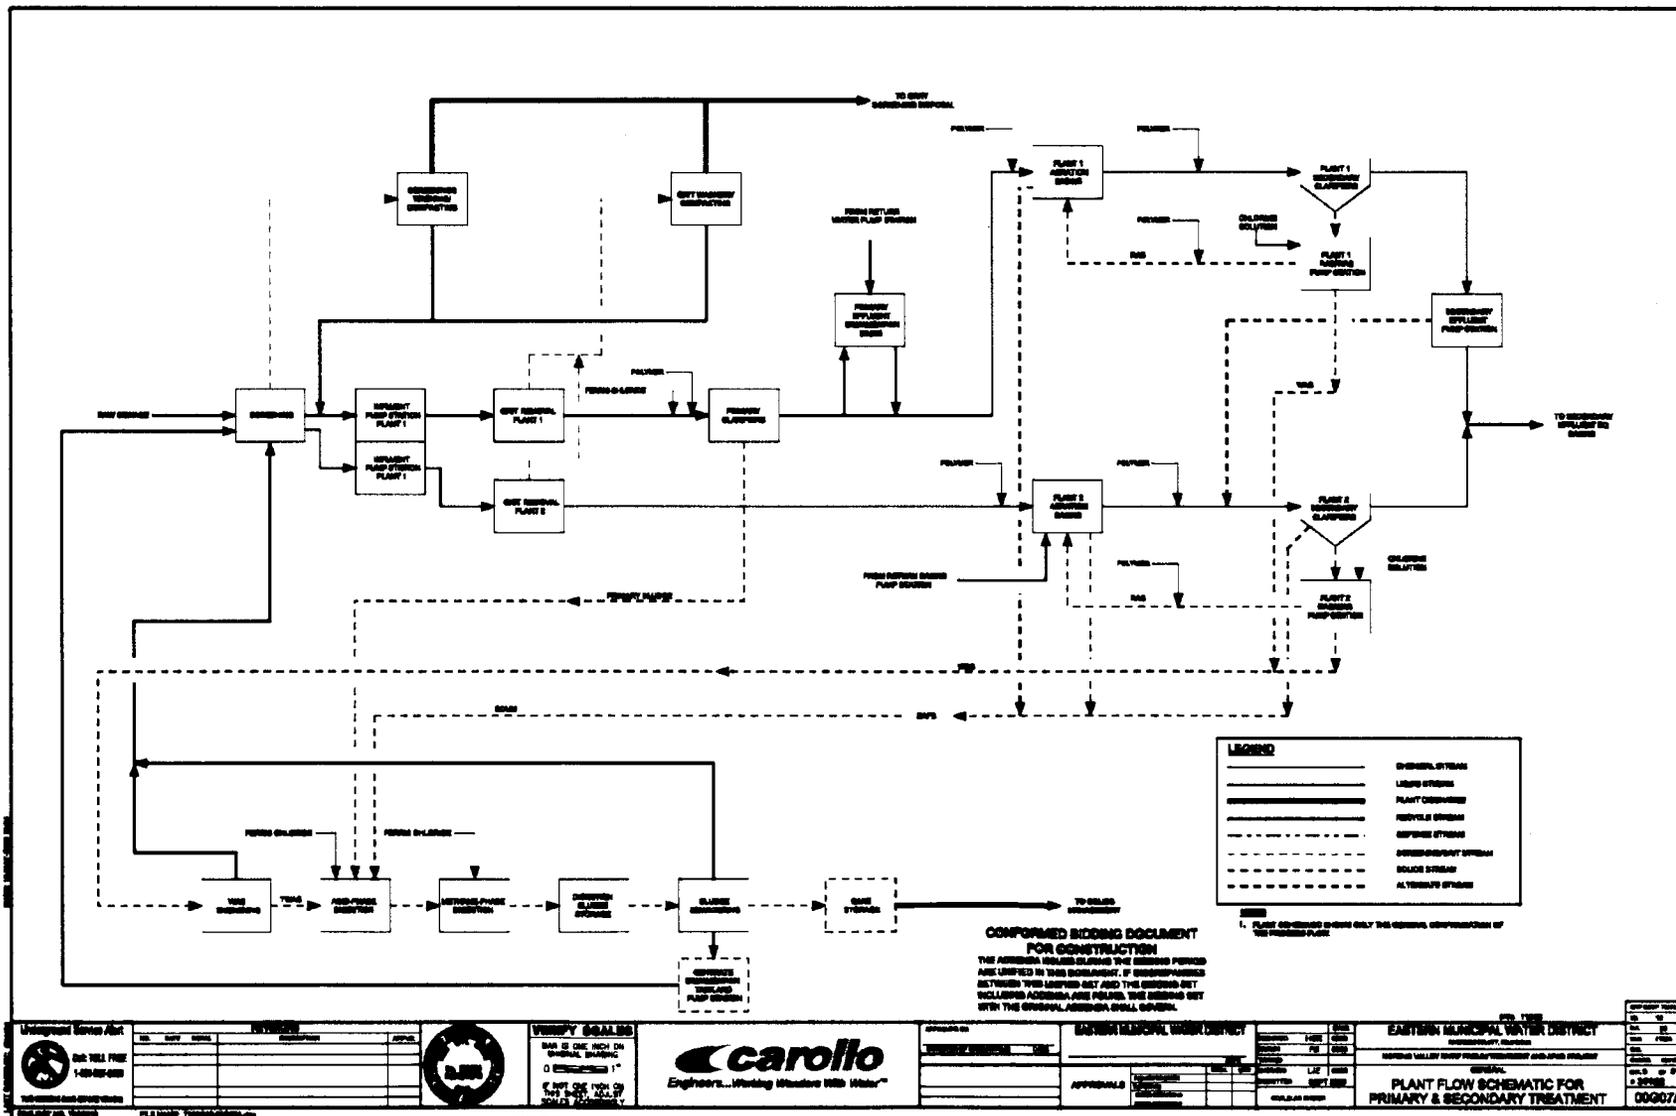


**MORENO VALLEY RWRW FLOW SCHEMATIC (CONT'D)**

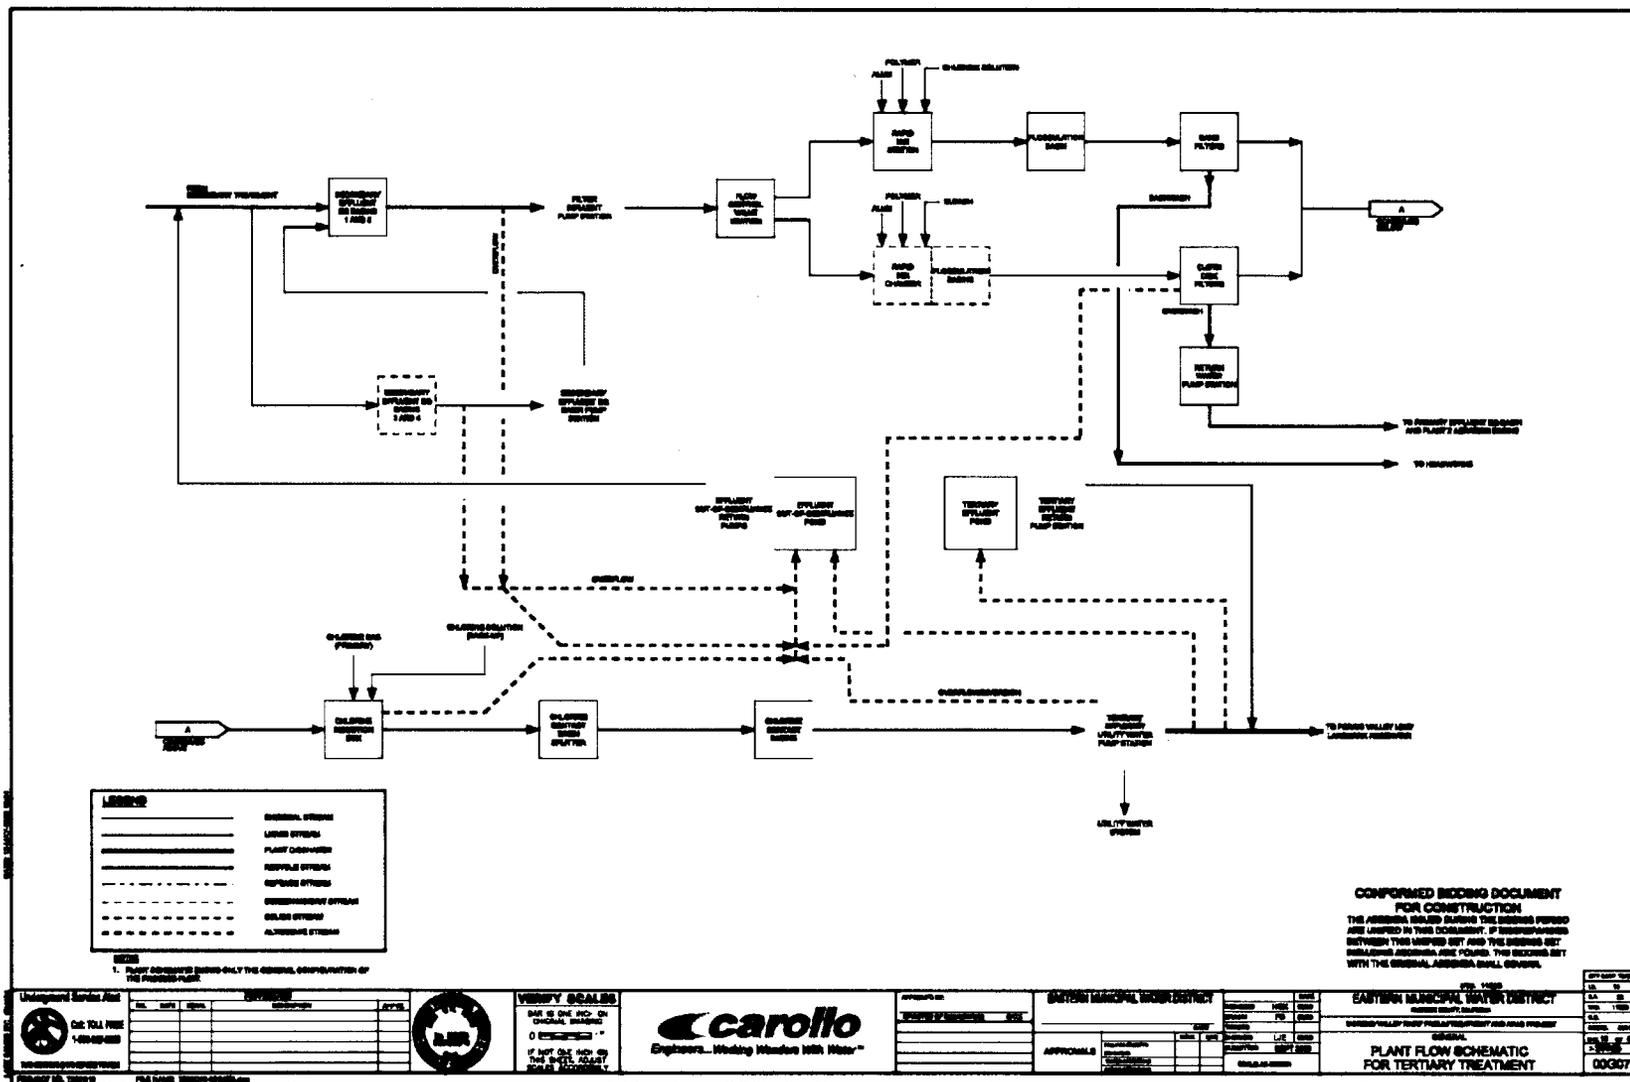




### TEMECULA VALLEY RWRWF FLOW SCHEMATIC

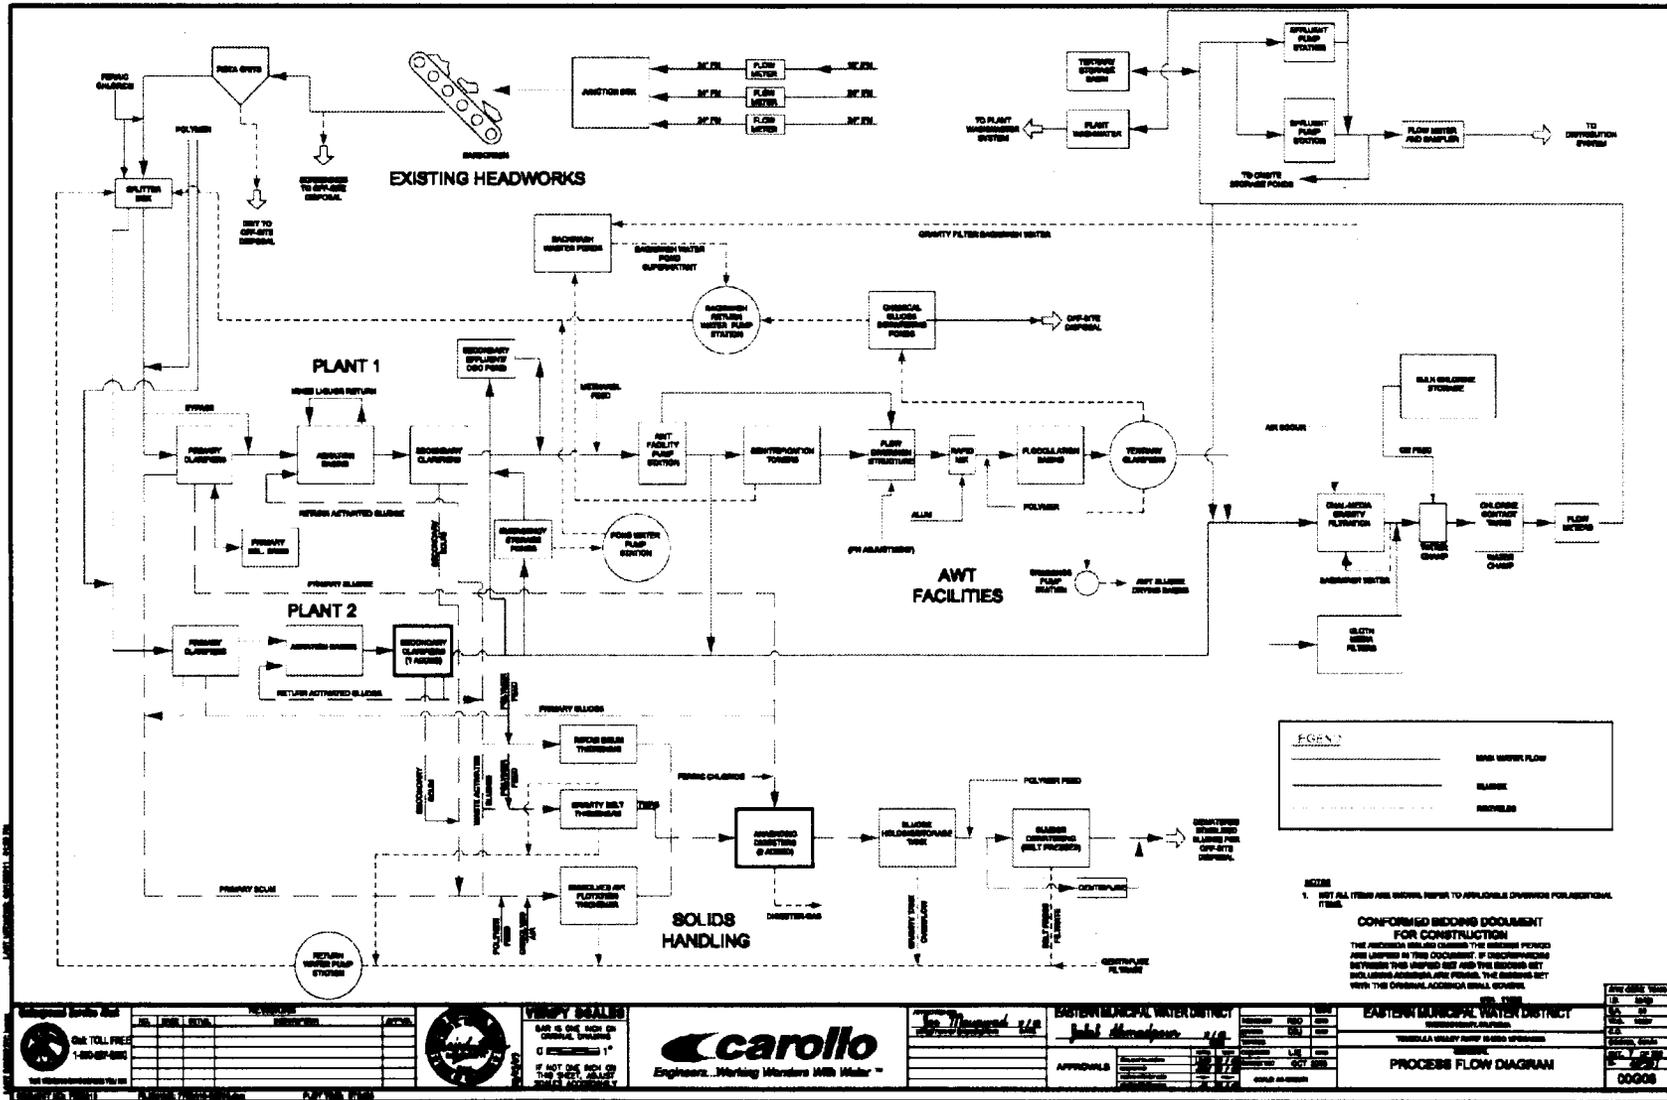

### SANTA ROSA RWRf FLOW SCHEMATIC

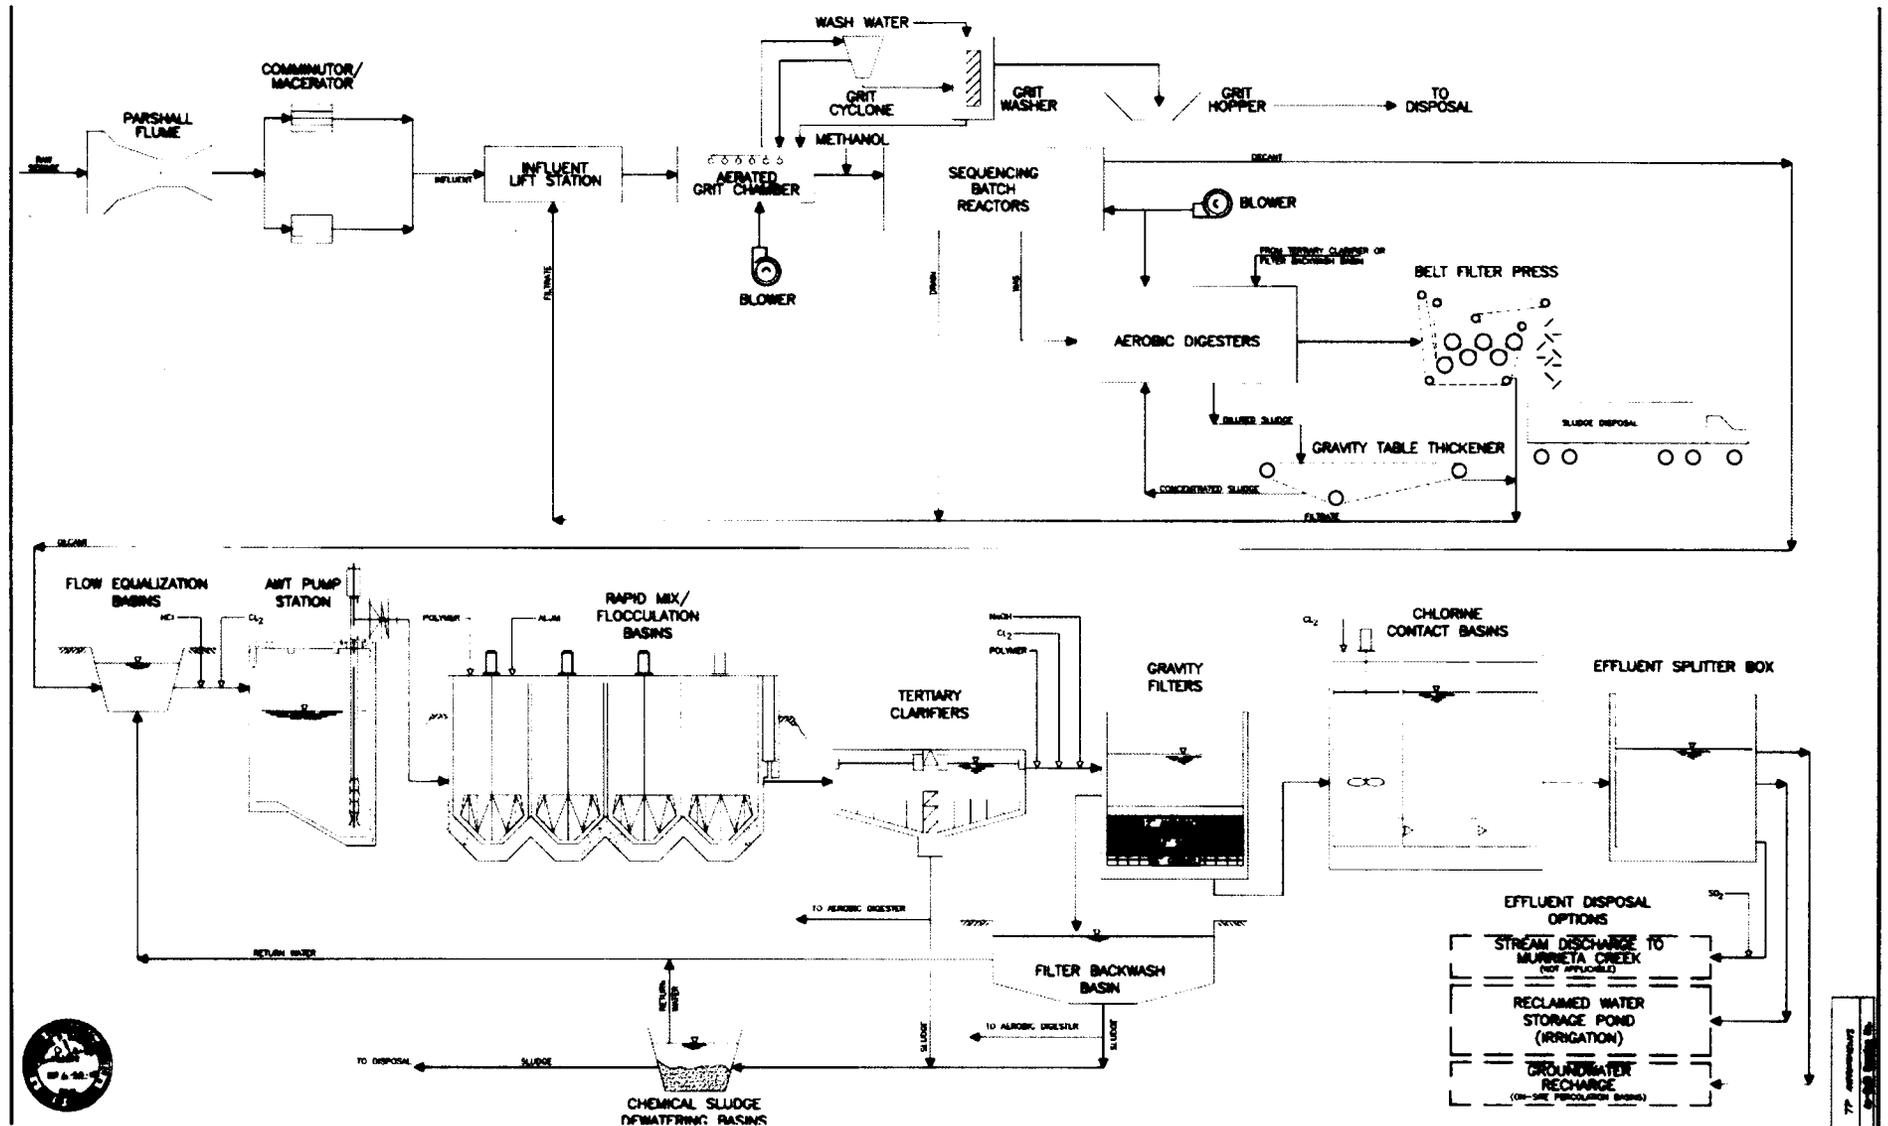

## **ATTACHMENT D – FEDERAL STANDARD PROVISIONS**

### **I. STANDARD PROVISIONS – PERMIT COMPLIANCE**

#### **A. Duty to Comply**

1. The Discharger must comply with all of the conditions of this Order. Any noncompliance constitutes a violation of the Clean Water Act (CWA) and the California Water Code (CWC) and is grounds for enforcement action, for permit termination, revocation and reissuance, or modification; or denial of a permit renewal application [40 CFR §122.41(a)].
2. The Discharger shall comply with effluent standards or prohibitions established under Section 307(a) of the CWA for toxic pollutants and with standards for sewage sludge use or disposal established under Section 405(d) of the CWA within the time provided in the regulations that establish these standards or prohibitions, even if this Order has not yet been modified to incorporate the requirement [40 CFR §122.41(a)(1)].

#### **B. Need to Halt or Reduce Activity Not a Defense**

It shall not be a defense for a Discharger in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this Order [40 CFR §122.41(c)].

#### **C. Duty to Mitigate**

The Discharger shall take all reasonable steps to minimize or prevent any discharge or sludge use or disposal in violation of this Order that has a reasonable likelihood of adversely affecting human health or the environment [40 CFR §122.41(d)].

#### **D. Proper Operation and Maintenance**

The Discharger shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed or used by the Discharger to achieve compliance with the conditions of this Order. Proper operation and maintenance also includes adequate laboratory controls and appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities or similar systems that are installed by a Discharger only when necessary to achieve compliance with the conditions of this Order [40 CFR §122.41(e)].

## E. Property Rights

1. This Order does not convey any property rights of any sort or any exclusive privileges [40 CFR §122.41(g)].
2. The issuance of this Order does not authorize any injury to persons or property or invasion of other private rights, or any infringement of State or local law or regulations [40 CFR §122.5(c)].

## F. Inspection and Entry

The Discharger shall allow the Regional Water Quality Control Board (RWQCB), State Water Resources Control Board (SWRCB), United States Environmental Protection Agency (USEPA), and/or their authorized representatives (including an authorized contractor acting as their representative), upon the presentation of credentials and other documents, as may be required by law, to [40 CFR §122.41(i)] [CWC 13383(c)]:

1. Enter upon the Discharger's premises where a regulated facility or activity is located or conducted, or where records are kept under the conditions of this Order [40 CFR §122.41(i)(1)];
2. Have access to and copy, at reasonable times, any records that must be kept under the conditions of this Order [40 CFR §122.41(i)(2)];
3. Inspect and photograph, at reasonable times, any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under this Order [40 CFR §122.41(i)(3)];
4. Sample or monitor, at reasonable times, for the purposes of assuring Order compliance or as otherwise authorized by the CWA or the CWC, any substances or parameters at any location [40 CFR §122.41(i)(4)].

## G. Bypass

1. Definitions
  - a. "Bypass" means the intentional diversion of waste streams from any portion of a treatment facility [40 CFR §122.41(m)(1)(i)].
  - b. "Severe property damage" means substantial physical damage to property, damage to the treatment facilities, which causes them to become inoperable, or substantial and permanent loss of natural resources that can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production [40 CFR §122.41(m)(1)(ii)].

2. Bypass not exceeding limitations – The Discharger may allow any bypass to occur which does not cause exceedances of effluent limitations, but only if it is for essential maintenance to assure efficient operation. These bypasses are not subject to the provisions listed in Standard Provisions – Permit Compliance I.G.3, I.G.4, and I.G.5 below [40 CFR §122.41(m)(2)].
3. Prohibition of bypass – Bypass is prohibited, and the Regional Water Board may take enforcement action against a Discharger for bypass, unless [40 CFR §122.41(m)(4)(i)]:
  - a. Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage [40 CFR §122.41(m)(4)(A)];
  - b. There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass that occurred during normal periods of equipment downtime or preventive maintenance [40 CFR §122.41(m)(4)(B)]; and
  - c. The Discharger submitted notice to the Regional Water Board as required under Standard Provisions – Permit Compliance I.G.5 below [40 CFR §122.41(m)(4)(C)].
4. The Regional Water Board may approve an anticipated bypass, after considering its adverse effects, if the Regional Water Board determines that it will meet the three conditions listed in Standard Provisions – Permit Compliance I.G.3 above [40 CFR §122.41(m)(4)(ii)].
5. Notice
  - a. Anticipated bypass. If the Discharger knows in advance of the need for a bypass, it shall submit a notice, if possible at least 10 days before the date of the bypass [40 CFR §122.41(m)(3)(i)].
  - b. Unanticipated bypass. The Discharger shall submit notice of an unanticipated bypass as required in Standard Provisions - Reporting V.E below (24-hour notice) [40 CFR Section 122.41(m)(3)(ii)].

## H. Upset

Upset means an exceptional incident in which there is unintentional and temporary noncompliance with technology based permit effluent limitations because of factors beyond the reasonable control of the permittee. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation [40 CFR §122.41(n)(1)].

1. Effect of an upset. An upset constitutes an affirmative defense to an action brought for noncompliance with such technology based permit effluent limitations if the requirements of Standard Provisions – Permit Compliance I.H.2 below are met. No determination made during administrative review of claims that noncompliance was caused by upset, and before an action for noncompliance, is final administrative action subject to judicial review [40 CFR Section 122.41(n)(2)].
2. Conditions necessary for a demonstration of upset. A Discharger who wishes to establish the affirmative defense of upset shall demonstrate, through properly signed, contemporaneous operating logs or other relevant evidence that [40 CFR §122.41(n)(3)]:
  - a. An upset occurred and that the Discharger can identify the cause(s) of the upset [40 CFR §122.41(n)(3)(i)];
  - b. The permitted facility was, at the time, being properly operated [40 CFR §122.41(n)(3)(i)];
  - c. The Discharger submitted notice of the upset as required in Standard Provisions – Reporting V.E.2.b below (24-hour notice) [40 CFR Section 122.41(n)(3)(iii)]; and
  - d. The Discharger complied with any remedial measures required under Standard Provisions – Permit Compliance I.C above [40 CFR §122.41(n)(3)(iv)].
3. Burden of proof. In any enforcement proceeding, the Discharger seeking to establish the occurrence of an upset has the burden of proof [40 CFR §122.41(n)(4)].

## II. STANDARD PROVISIONS – PERMIT ACTION

### A. General

This Order may be modified, revoked and reissued, or terminated for cause. The filing of a request by the Discharger for modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance does not stay any Order condition [40 CFR §122.41(f)].

## **B. Duty to Reapply**

If the Discharger wishes to continue an activity regulated by this Order after the expiration date of this Order, the Discharger must apply for and obtain a new permit [40 CFR §122.41(b)].

## **C. Transfers**

This Order is not transferable to any person except after notice to the Regional Water Board. The Regional Water Board may require modification or revocation and reissuance of the Order to change the name of the Discharger and incorporate such other requirements as may be necessary under the CWA and the CWC [40 CFR §122.41(l)(3)] [40 CFR §122.61].

## **III. STANDARD PROVISIONS – MONITORING**

- A.** Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity [40 CFR §122.41(j)(1)].
  
- B.** Monitoring results must be conducted according to test procedures under 40 CFR Part 136 or, in the case of sludge use or disposal, approved under 40 CFR Part 136 unless otherwise specified in 40 CFR Part 503 unless other test procedures have been specified in this Order [40 CFR §122.41(j)(4)] [40 CFR §122.44(i)(1)(iv)].

## **IV. STANDARD PROVISIONS – RECORDS**

- A.** Except for records of monitoring information required by this Order related to the Discharger's sewage sludge use and disposal activities, which shall be retained for a period of at least five years (or longer as required by 40 CFR Part 503), the Discharger shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by this Order, and records of all data used to complete the application for this Order, for a period of at least three (3) years from the date of the sample, measurement, report or application. This period may be extended by request of the Regional Water Board Executive Officer at any time [40 CFR §122.41(j)(2)].

**B. Records of monitoring information shall include:**

1. The date, exact place, and time of sampling or measurements [40 CFR §122.41(j)(3)(i)];
2. The individual(s) who performed the sampling or measurements [40 CFR §122.41(j)(3)(ii)];
3. The date(s) analyses were performed [40 CFR §122.41(j)(3)(iii)];
4. The individual(s) who performed the analyses [40 CFR §122.41(j)(3)(iv)];
5. The analytical techniques or methods used [40 CFR §122.41(j)(3)(v)]; and
6. The results of such analyses [40 CFR §122.41(j)(3)(vi)].

**C. Claims of confidentiality for the following information will be denied [40 CFR §122.7(b)]:**

1. The name and address of any permit applicant or Discharger [40 CFR §122.7(b)(1)]; and
2. Permit applications and attachments, permits and effluent data [40 CFR §122.7(b)(2)].

**V. STANDARD PROVISIONS – REPORTING**

**A. Duty to Provide Information**

The Discharger shall furnish to the Regional Water Board, SWRCB, or USEPA within a reasonable time, any information which the Regional Water Board, SWRCB, or USEPA may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this Order or to determine compliance with this Order. Upon request, the Discharger shall also furnish to the Regional Water Board, SWRCB, or USEPA copies of records required to be kept by this Order [40 CFR §122.41(h)] [CWC 13267].

**B. Signatory and Certification Requirements**

1. All applications, reports, or information submitted to the Regional Water Board, State Water Board, and/or USEPA shall be signed and certified in accordance with Standard Provisions – Reporting V.B.2, V.B.3, V.B.4, and V.B.5 below [40 CFR Section 122.41(k)].

2. All permit applications shall be signed by either a principal executive officer or ranking elected official. For purposes of this provision, a principal executive officer of a federal agency includes: (i) the chief executive officer of the agency, or (ii) a senior executive officer having responsibility for the overall operations of a principal geographic unit of the agency (e.g., Regional Administrators of USEPA) [40 CFR Section 122.22(a)(3)].
3. All reports required by this Order and other information requested by the Regional Water Board, State Water Board, or USEPA shall be signed by a person described in Standard Provisions – Reporting V.B.2 above, or by a duly authorized representative of that person. A person is a duly authorized representative only if:
  - a. The authorization is made in writing by a person described in Standard Provisions – Reporting V.B.2 above [40 CFR Section 122.22(b)(1)];
  - b. The authorization specified either an individual or a position having responsibility for the overall operation of the regulated facility or activity such as the position of plant manager, operator of a well or a well field, superintendent, position of equivalent responsibility, or an individual or position having overall responsibility for environmental matters for the company (A duly authorized representative may thus be either a named individual or any individual occupying a named position.) [40 CFR Section 122.22(b)(2)]; and
  - c. The written authorization is submitted to the Regional Water Board and State Water Board [40 CFR Section 122.22(b)(3)].
4. If an authorization under Standard Provisions – Reporting V.B.3 above is no longer accurate because a different individual or position has responsibility for the overall operation of the facility, a new authorization satisfying the requirements of Standard Provisions – Reporting V.B.3 above must be submitted to the Regional Water Board, State Water Board or USEPA prior to or together with any reports, information, or applications, to be signed by an authorized representative [40 CFR Section 122.22(c)].
5. Any person signing a document under Standard Provisions – Reporting V.B.2 or V.B.3 above shall make the following certification:

“I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations” [40 CFR Section 122.22(d)].

### **C. Monitoring Reports**

1. Monitoring results shall be reported at the intervals specified in the Monitoring and Reporting Program (Attachment E) in this Order [40 CFR §122.41(l)(4)].
2. Monitoring results must be reported on a Discharge Monitoring Report (DMR) form or forms provided or specified by the Regional Water Board or SWRCB for reporting results of monitoring of sludge use or disposal practices [40 CFR §122.41(l)(4)(i)].
3. If the Discharger monitors any pollutant more frequently than required by this Order using test procedures approved under 40 CFR Part 136 or, in the case of sludge use or disposal, approved under 40 CFR Part 136 unless otherwise specified in 40 CFR Part 503, or as specified in this Order, the results of this monitoring shall be included in the calculation and reporting of the data submitted in the DMR or sludge reporting form specified by the Regional Water Board [40 CFR §122.41(l)(4)(ii)].
4. Calculations for all limitations, which require averaging of measurements, shall utilize an arithmetic mean unless otherwise specified in this Order [40 CFR §122.41(l)(4)(iii)].

### **D. Compliance Schedules**

Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of this Order, shall be submitted no later than 14 days following each schedule date [40 CFR §122.41(l)(5)].

### **E. Twenty-Four Hour Reporting**

1. The Discharger shall report any noncompliance that may endanger health or the environment. Any information shall be provided orally within 24 hours from the time the Discharger becomes aware of the circumstances. A written submission shall also be provided within five (5) days of the time the Discharger becomes aware of the circumstances. The written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance [40 CFR §122.41(l)(6)(i)].
2. The following shall be included as information that must be reported within 24 hours under this paragraph [40 CFR §122.41(l)(6)(ii)]:
  - a. Any unanticipated bypass that exceeds any effluent limitation in this Order [40 CFR §122.41(l)(6)(ii)(A)].
  - b. Any upset that exceeds any effluent limitation in this Order [40 CFR §122.41(l)(6)(ii)(B)].

3. The Regional Water Board may waive the above-required written report under this provision on a case-by-case basis if an oral report has been received within 24 hours [40 CFR §122.41(l)(6)(iii)].

#### **F. Planned Changes**

The Discharger shall give notice to the Regional Water Board as soon as possible of any planned physical alterations or additions to the permitted facility. Notice is required under this provision only when [40 CFR §122.41(l)(1)]:

1. The alteration or addition to a permitted facility may meet one of the criteria for determining whether a facility is a new source in 40 CFR §122.29(b) [40 CFR §122.41(l)(1)(i)]; or
2. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants which are subject neither to effluent limitations in this Order nor to notification requirements under 40 CFR Part 122.42(a)(1) (see Additional Provisions—Notification Levels VII.A.1) [40 CFR §122.41(l)(1)(ii)].
3. The alteration or addition results in a significant change in the Discharger's sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use or disposal sites not reported during the permit application process or not reported pursuant to an approved land application plan [40 CFR §122.41(l)(1)(iii)].

#### **G. Anticipated Noncompliance**

The Discharger shall give advance notice to the Regional Water Board or SWRCB of any planned changes in the permitted facility or activity that may result in noncompliance with General Order requirements [40 CFR §122.41(l)(2)].

#### **H. Other Noncompliance**

The Discharger shall report all instances of noncompliance not reported under Standard Provisions – Reporting V.C, V.D, and V.E above at the time monitoring reports are submitted. The reports shall contain the information listed in Standard Provision – Reporting V.E above [40 CFR Section 122.41(l)(7)].

#### **I. Other Information**

When the Discharger becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to the Regional Water Board, SWRCB, or USEPA, the Discharger shall promptly submit such facts or information [40 CFR §122.41(l)(8)].

## **VI. STANDARD PROVISIONS – ENFORCEMENT**

- A. The Regional Water Board is authorized to enforce the terms of this permit under several provisions of the CWC, including, but not limited to, sections 13385, 13386, and 13387.

## **VII. ADDITIONAL PROVISIONS – NOTIFICATION LEVELS**

### **A. Publicly-Owned Treatment Works (POTWs)**

Since this Order only regulates the discharge of recycled water from a regional pipeline (the Facility) that contains water from six different POTWs, the additional provisions that are applicable to POTWs are not applicable to this Facility. The applicable provisions from this section are contained in the Waste Discharge Requirements issued to the POTWs.

## ATTACHMENT E – MONITORING AND REPORTING PROGRAM

### Table of Contents

I.	General Monitoring Provisions .....	E-2
II.	Monitoring Locations .....	E-6
III.	Influent Monitoring Requirements – Not Applicable .....	E-7
IV.	Effluent Monitoring Requirements to Surface Water .....	E-7
	A. Effluent Monitoring Location M-001 .....	E-7
	B. Secondary Effluent Monitoring Location at M-001 with 20:1 Dilution.....	E-9
V.	Whole Effluent Toxicity Testing Requirements.....	E-9
	A. Toxicity Monitoring Requirements at M-001 .....	E-9
VI.	Land Discharge Monitoring Requirements – Not Applicable .....	E-11
VII.	Reclamation Monitoring Requirements – Not Applicable .....	E-11
VIII.	Receiving Water Monitoring Requirements – Surface Water and Groundwater .....	E-11
	A. Monitoring During 20:1 Dilution .....	E-11
	B. Monitoring Location R-001U for Surface Water Base Flow .....	E-12
	C. Monitoring Location R-001D for Surface Water Base Flow .....	E-12
	D. Regional Monitoring for Fish Flesh Testing .....	E-13
	E. Monitoring Requirements for Groundwater – Not Applicable.....	E-13
IX.	Other Monitoring Requirements .....	E-13
	A. Biosolids Monitoring – Not Applicable .....	E-13
	B. Stormwater Monitoring .....	E-13
	C. Water Supply Monitoring .....	E-13
	D. Pretreatment Monitoring and Reporting – Not Applicable.....	E-13
X.	Reporting Requirements .....	E-13
	A. General Monitoring and Reporting Requirements .....	E-13
	B. Self Monitoring Reports (SMRs).....	E-15
	C. Discharge Monitoring Reports (DMRs).....	E-17
	D. Other Reports.....	E-17

### List of Tables

Table 1	Monitoring Station Locations .....	E-6
Table 2	Effluent Monitoring at M-001 .....	E-7
Table 3	Effluent Monitoring at M-002 to M-007 .....	E-8
Table 4	Receiving Water Monitoring at R-001U.....	E-12
Table 5	Receiving Water Monitoring at R-001D.....	E-12
Table 6	Reporting Requirements .....	E-15
Table 7	Monitoring Periods and Reporting Schedule.....	E-15

## **ATTACHMENT E – MONITORING AND REPORTING PROGRAM (MRP)**

The Code of Federal Regulations at 40 CFR 122.48 requires that all NPDES permits specify monitoring and reporting requirements. Water Code Sections 13267 and 13383 also authorize the Regional Water Quality Control Board (Regional Water Board) to require technical and monitoring reports. This MRP establishes monitoring and reporting requirements, which implement the federal and California regulations.

### **I. GENERAL MONITORING PROVISIONS**

1. All sampling and sample preservation shall be in accordance with the current edition of "Standard Methods for the Examination of Water and Wastewater" (American Public Health Association) or 40 CFR 136 "Guidelines Establishing Test Procedures for the Analysis of Pollutants," promulgated by the United States Environmental Protection Agency (EPA), unless otherwise specified by the Executive Officer of the Regional Water Board.
2. All laboratory analyses shall be performed in accordance with test procedures under 40 CFR 136 "Guidelines Establishing Test Procedures for the Analysis of Pollutants," promulgated by the USEPA, unless otherwise specified in this MRP. In addition, the Regional Water Board and/or EPA, at their discretion, may specify test methods that are more sensitive than those specified in 40 CFR 136 (see also I.7., below).
3. Chemical, bacteriological, and bioassay analyses shall be conducted at a laboratory certified for such analyses by the California State Water Resources Control Board, Division of Drinking Water in accordance with Water Code Section 13176, and must include quality assurance/quality control data with the reports, or at laboratories approved by the Regional Water Board's Executive Officer or the USEPA.
4. Whenever the Discharger monitors any pollutant more frequently than is required by this Order, the results of this monitoring shall be included in the calculation and reporting of the data submitted in the discharge monitoring report specified by the Executive Officer.
5. In conformance with federal regulations 40 CFR 122.45(c), analyses to determine compliance with the effluent limitations for metals shall be conducted using the total recoverable method. For Chromium (VI), the dissolved method in conformance with 40 CFR 136 may be used to measure compliance with the Chromium (VI) limitation.
6. The Discharger shall have, and implement an acceptable written quality assurance plan (QAP) for laboratory analyses. Duplicate chemical analyses must be conducted on a minimum of ten percent (10%) of the samples, or at least one sample per month, whichever is greater. A similar frequency shall be maintained for analyzing spiked samples. When requested by the Regional Board or USEPA, the Discharger shall participate in the NPDES discharge monitoring report Quality Assurance performance study.

7. For effluent monitoring:

- a. The Discharger shall require its testing laboratory to calibrate the analytical system down to the minimum level (ML)<sup>1</sup> specified in Attachment “H” for priority pollutants, unless an alternative minimum level is approved by the Regional Water Board’s Executive Officer. When there is more than one ML value for a given substance, the discharger shall use the ML values, and their associated analytical methods listed in Attachment “H” that are below the calculated effluent limitation. For analysis of priority pollutants without effluent limitations, the Discharger shall use an ML value that is below the trigger values listed in Attachment “I”. If no ML value is below the effluent limitation, or the trigger value listed in Attachment “I”, then the lowest ML and associated analytical method shall be used. Any internal quality control data associated with the sample must be reported when requested by the Executive Officer. The Regional Water Board will reject the quantified laboratory data if quality control data is unavailable or unacceptable.
- b. The discharger shall report the results of analytical determinations for the presence of chemical constituents in a sample using the following reporting protocols:
  - 1) Sample results greater than or equal to the reported ML shall be reported as measured by the laboratory (i.e., the measured chemical concentration in the sample).
  - 2) Sample results less than the reported ML, but greater than or equal to the laboratory’s current Method Detection Limit (MDL)<sup>2</sup>, shall be reported as “Detected, but Not Quantified,” or “DNQ.” The estimated chemical concentration of the sample shall also be reported.
  - 3) Sample results not detected above the laboratory’s MDL shall be reported as “not detected” or “ND.”
- c. The Discharger shall submit to the Regional Water Board reports necessary to determine compliance with effluent limitations in this Order and shall follow the chemical nomenclature and sequential order of priority pollutant constituents shown in Attachment “G” – Priority Pollutant Lists. The Discharger shall report with each sample result:
  - 1) The minimum level achieved by the testing laboratory; and

---

<sup>1</sup> Minimum level is the concentration at which the entire analytical system must give a recognizable signal and acceptable point. The ML is the concentration in a sample that is equivalent to the concentration of the lowest calibration standard analyzed by a specific analytical procedure, assuming that all the method specified sample weights, volumes, and processing steps have been followed.

<sup>2</sup> MDL is the minimum concentration of a substance that can be measured and reported with 99 percent confidence that the analytical concentration is greater than zero, as defined in 40 CFR 136, Appendix B.

- 2) The laboratory's current MDL, as determined by the procedure found in 40 CFR 136.
  - d. For receiving water monitoring and for those priority pollutants without effluent limitations, the Discharger shall require its testing laboratory to quantify constituent concentrations to the lowest achievable MDL as determined by the procedure found in 40 CFR 136. In situations where the most stringent applicable receiving water objective (freshwater or human health - consumption of organisms only), as specified for that pollutant in 40 CFR 131.38<sup>3</sup>, is below the minimum level value specified in Attachment "G" and the Discharger cannot achieve an MDL value for that pollutant below the ML value, the Discharger shall submit justification why a lower MDL value cannot be achieved. Justification shall be submitted together with monthly monitoring reports.
8. For non-priority pollutants monitoring, all analytical data shall be reported with identification of practical quantitation levels and with method detection limits, as determined by the procedure found in 40 CFR 136.
9. For every item of monitoring data where the requirements are not met, the monitoring report shall include a statement discussing the reasons for noncompliance, the actions undertaken or proposed that will bring the discharge into full compliance with requirements at the earliest time, and an estimate of the date when the Discharger will be in compliance. The Discharger shall notify the Regional Water Board by letter when compliance with the time schedule has been achieved.
10. The Discharger shall assure that records of all monitoring information are maintained and accessible for a period of at least five years (this retention period supersedes the retention period specified in Section IV.A. of Attachment D) from the date of the sample, report, or application. This period of retention shall be extended during the course of any unresolved litigation regarding this discharge or by the request of the Regional Water Board at any time. Records of monitoring information shall include:
  - a. The information listed in Attachment D- IV Standard Provisions – Records, subparagraph B. of this Order;
  - b. The laboratory which performed the analyses;
  - c. The date(s) analyses were performed;
  - d. The individual(s) who performed the analyses;
  - e. The modification(s) to analytical techniques or methods used;
  - f. All sampling and analytical results, including
    - 1) Units of measurement used;
    - 2) Minimum reporting level for the analysis (minimum level, practical quantitation level (PQL)<sup>4</sup>);

<sup>3</sup> See Federal Register/ Vol. 65, No. 97 / Thursday, May 18, 2000 / Rules and Regulations.

<sup>4</sup> Practical quantitation level is the lowest concentration that can be reliably measured within specified limits of precision, accuracy, representativeness, completeness, and comparability during routine laboratory operating condition using USEPA or the Water Board approved methods.

- 3) Results less than the reporting level but above the method detection limit (MDL);
  - 4) Data qualifiers and a description of the qualifiers;
  - 5) Quality control test results (and a written copy of the laboratory quality assurance plan);
  - 6) Dilution factors, if used; and
  - 7) Sample matrix type.
  - g. All monitoring equipment calibration and maintenance records;
  - h. All original strip charts from continuous monitoring devices;
  - i. All data used to complete the application for this Order; Copies of all reports required by this Order, and
  - j. Electronic data and information generated by the Supervisory Control and Data Acquisition (SCADA) System.
11. The flow measurement system shall be calibrated at least once per year or more frequently, to ensure continued accuracy.
12. All monitoring instruments and devices used by the Discharger to fulfill the prescribed monitoring program shall be properly maintained and calibrated as necessary to ensure their continued accuracy. In the event that continuous monitoring equipment is out of service for greater than a 24-hour period, the Discharger shall obtain a representative grab sample each day the equipment is out of service. The Discharger shall correct the cause(s) of failure of the continuous monitoring equipment as soon as practicable. In its monitoring report, the Discharger shall specify the period(s) during which the equipment was out of service and if the problem has not been corrected, shall identify the steps which the Discharger is taking or proposes to take to bring the equipment back into service and the schedule for these actions.
13. Monitoring and reporting shall be in accordance with the following:
- a. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity.
  - b. The monitoring and reporting of influent, effluent, and sludge shall be done more frequently as necessary to maintain compliance with this Order and/or as specified in this Order.
  - c. A "grab" sample is defined as any individual sample collected in less than 15 minutes.
  - d. A composite sample is defined as a combination of no fewer than eight individual grab samples obtained over the specified sampling period. The volume of each individual grab sample shall be proportional to the discharge flow rate at the time of sampling. The compositing period shall equal the specific sampling period, or 24 hours, if no period is specified.
  - e. Daily samples shall be collected on each day of the week.

- f. Monthly samples shall be collected on any representative day of each month.
- g. Quarterly samples shall be taken on the earliest representative day between January 1 to March 31, April 1 to June 30, July 1 to September 30, and October 1 to December 31 and test results shall be reported in either micrograms/liter (ug/L) or milligrams/liter (mg/L), as appropriate, by the first day of the second month following the reporting period.
- h. Annual samples shall be collected in wet weather during discharging.

## II. MONITORING LOCATIONS

The Discharger shall establish the following monitoring locations to demonstrate compliance with the effluent limitations, discharge specifications, and other requirements in this Order:

**Table 1 Monitoring Station Locations**

Discharge Point Name	Monitoring Location Name	Monitoring Location Description	Latitude and Longitude
001	M-001	Effluent flow to Reach 5 of Temescal Creek at Dissipation Station	33° 40' 52" N, 117° 19' 54" W
	M-002	Effluent monitoring at San Jacinto Valley RWRf	33° 47' 59" N, 117° 00' 55" W
	M-003	Effluent monitoring at Moreno Valley RWRf	33° 52' 19" N, 117° 12' 51" W
	M-004A	Effluent monitoring at Perris Valley RWRf plant 1	33° 45' 07" N, 117° 11' 44" W
	M-004B	Effluent monitoring at Perris Valley RWRf plants 2 & 3	33° 45' 19" N, 117° 11' 39" W
	M-005	Effluent monitoring at Sun City RWRf	33° 41' 45" N, 117° 12' 38" W
	M-006	Effluent monitoring at Temecula Valley RWRf	33° 30' 19" N, 117° 10' 05" W
	M-007	Effluent monitoring at Santa Rosa WRF	33° 31' 54" N, 117° 11' 18" W
--	R-001UA	Receiving surface water – within 100 feet Upstream of DP-001 in Temescal Creek, when there is water overflowing from Lake Elsinore.	33° 40' 50" N, 117° 19' 53" W
--	R-001UB	Receiving surface water – within 100 feet upstream of DP-001 in Temescal Creek, when there is flowing water in Wasson Canyon stormwater channel.	33° 40' 54" N, 117° 19' 53" W
--	R-001D	Receiving surface water - within 500 feet downstream of DP-001 in Temescal Creek.	33° 40' 50" N, 117° 20' 00" W

### III. INFLUENT MONITORING REQUIREMENTS – NOT APPLICABLE

Attachment E of Order No. R8-2008-0008 specifies influent monitoring requirements for EMWD's five plants, while Order No. R9-94-92, issued by the San Diego Regional Water Board (Region 9), specifies influent monitoring requirements for the Santa Rosa plant in Region 9.

### IV. EFFLUENT MONITORING REQUIREMENTS TO SURFACE WATER

The Discharger shall monitor the effluent at monitoring location M-001 as follows. If more than one analytical test method is listed for a given parameter, the Discharger must select from the listed methods and corresponding Minimum Level.

#### A. Effluent Monitoring Location M-001

1. The Discharger shall monitor the effluent at discharge point DP-001 at Monitoring Location M-001 as follows:

**Table 2 Effluent Monitoring at M-001**

Parameter	Units	Sample Type	Minimum Sampling Frequency When Discharging	Required Analytical Test Method and Minimum Level, units, respectively
Flow	mgd	Recorder/ Totalizer	Continuous	--
Specific Conductance	µmhos/cm	Recorder	"	See Section I.2, above, of this MRP
pH	Std. unit	Recorder	"	"
Total Chlorine Residual	mg/L	Recorder	"	--
BOD <sub>5</sub> <sup>5</sup>	"	Composite	Daily	See Section I.2, above, of this MRP
Total Suspended Solids	"	Composite	"	"
Ammonia-Nitrogen	"	Grab	Weekly	"
Temperature	°C	Grab	"	"
Total Dissolved Solids	mg/L	Composite	Monthly	"
Total Inorganic Nitrogen	"	Composite	"	"
Total Nitrogen	"	Composite	"	"
Total Hardness	"	Composite	"	"
Cyanide, free	µg/L	Grab	"	See Sections I.2. and I.7., above, of this MRP
Total Recoverable	"	Composite	"	"

<sup>5</sup> The Discharger has demonstrated a correlation between the biological oxygen demand (BOD<sub>5</sub>) and total organic carbon (TOC) concentrations in the effluent to the satisfaction of the Executive Officer. Therefore, compliance with the BOD<sub>5</sub> limits contained in this Order may be determined based on analyses of the TOC of the effluent.

**Table 2 Effluent Monitoring at M-001**

Parameter	Units	Sample Type	Minimum Sampling Frequency When Discharging	Required Analytical Test Method and Minimum Level, units, respectively
Copper				
Total Recoverable Lead	"	Composite	"	"
Total Recoverable Mercury	"	Composite	"	"
Toxicity	TUc	See Section V.A, Below	"	See Section V, below, of this MRP
Bis (2-Ethylhexyl) Phthalate	µg/L	Grab	"	See Sections I.2. and I.7., above, of this MRP
Dichlorobromomethane	"	Grab	"	"
Volatile organic portion of remaining EPA Priority Pollutants (See Attachment G)	"	Grab	Annually during wet Season(See IV.A.3., below)	"
Remaining EPA Priority Pollutants (See Attachment G)	µg/L	Composite	Annually during wet season (See IV.A.3., below)	"

2. The Discharger shall monitor treated effluent for DP-001 at Monitoring Locations M-002 to M-007 as follows.

**Table 3 Effluent Monitoring at M-002 to M-007**

Parameter	Units	Sample Type	Minimum Sampling Frequency When Discharging	Required Analytical Test Method and Minimum Level, units, respectively
Turbidity <sup>6</sup>	NTU	Recorder	Continuous	--
Coliform Organisms <sup>7</sup>	MPN per 100 ml <sup>8</sup>	Grab	Daily	See Section I.2., above, of this MRP
CT	mg-minutes/L	Recorder	Continuous <sup>9</sup>	--

3. The monitoring frequency for those priority pollutants that are detected during the required quarterly monitoring at a concentration greater than the concentration

<sup>6</sup> Turbidity analysis shall be continuous, performed by a continuous recording turbidimeter. Compliance with the daily average operating filter effluent turbidity shall be determined by averaging the levels of recorded turbidity taken at a minimum of four-hour intervals over a 24-hour period. The results of the daily average turbidity determinations shall be reported monthly.

<sup>7</sup> Samples for total coliform bacteria shall be collected daily. Samples shall be taken from the disinfected effluent.

<sup>8</sup> MPN/100mL = Most Probable Number per 100 milliliters.

<sup>9</sup> The CT and modal contact time shall be continuously calculated and recorded. The minimum daily value shall be reported monthly. Modal contact time and CT shall be calculated based on the minimum one-hour average value in a 24-hr period.

specified for that pollutant<sup>10</sup> in Attachment I - Triggers for Monitoring Priority Pollutants shall be accelerated to monthly. To return to the monitoring frequency specified, the Discharger shall request and receive approval from the Regional Water Board's Executive Officer or designee.

4. The monitoring frequency for those priority pollutants that are detected during the required annual monitoring at a concentration greater than the concentration specified for that pollutant in Attachment I shall be accelerated to quarterly for one year. To return to the specified monitoring frequency, the Discharger shall request and receive approval from the Regional Water Board's Executive Officer or designee.

#### **B. Secondary Effluent Monitoring Location at M-001 with 20:1 Dilution**

If the Discharger wants to take credit for the 20:1 dilution, the Discharger should record the start and end time of the secondary treated effluent discharge and the flow rate upstream of the discharge point. The effluent monitoring shall be the same as specified in Tables 2 and 3, above.

### **V. WHOLE EFFLUENT TOXICITY TESTING REQUIREMENTS**

#### **A. Toxicity Monitoring Requirements at M-001**

1. The Discharger shall conduct critical life stage chronic toxicity testing in accordance with Method 1002.0 - Survival and Reproduction test for water flea, *Ceriodaphnia dubia* as specified in "Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms", Fourth Edition, Environmental Monitoring Systems Laboratory, U.S. Environmental Protection Agency 2002, Cincinnati, Ohio (October 2002, EPA-821-R-02-013).
2. The Discharger shall establish procedures to ensure that the toxicity testing laboratory notifies the Discharger of the results of toxicity testing by the end of the next business day following the completion of such tests.
3. A minimum of one monthly chronic toxicity test shall be conducted on representative composite samples.
4. The Discharger shall increase the frequency of chronic toxicity testing to every two weeks whenever any test result exceeds 1.0 TUc. The first test under the accelerated schedule shall be conducted within two weeks of receiving notice of the test that exceeds 1.0 TUc, and every two weeks thereafter. The Discharger may resume the regular test schedule when two consecutive chronic toxicity tests result in 1.0 TUc, or when the results of the Initial Investigation Reduction Evaluation conducted by the Discharger have adequately addressed the identified toxicity problem.

---

<sup>10</sup> For those priority pollutants without specified criteria values, accelerated monitoring is not required.

5. The presence of chronic toxicity shall be estimated as specified in Short-Term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms. Fourth Edition. EPA-821-R-02-013.
6. Results for both survival and reproduction endpoints shall be reported in TUc, where  $TUc = 100/NOEC$  or  $100/ICp$  or  $ECp$  (p is the percent effluent). The no observed effect concentration (NOEC) is the highest concentration of toxicant to which organisms are exposed in a chronic test, that causes no observable adverse effect on the tests organisms (e.g., the highest concentration of toxicant to which the values for the observed responses are not statistically significant different from the controls). The inhibition concentration (IC) is a point estimate of the toxicant concentration that causes a given percent reduction in a non-quantal biological measurement (e.g., reproduction or growth) calculated from a continuous model (the EPA Interpolation Method). The effective concentration (EC) is a point estimate of the toxicant concentration that would cause a given percent reduction in quantal biological measurement (e.g., larval development, survival) calculated from a continuous model (e.g., probit).
7. Additional Testing Requirements
  - a. A series of at least five dilutions and a control will be tested. Five dilutions of the series shall be within 60% to 100% effluent concentration.
  - b. If organisms are not cultured in-house, concurrent testing with reference toxicants shall be conducted. Where organisms are cultured in-house, monthly reference toxicant testing is sufficient. Reference toxicants shall also be conducted using the same test conditions as the effluent toxicity test (e.g., same test duration, etc).
  - c. If either of the reference toxicant test or the effluent tests do not meet all test acceptability criteria as specified in the manual<sup>11</sup>, then the Discharger must re-sample and re-test within 14 days or as soon as the Discharger receives notification of failed tests.
  - d. Control and dilution water should be receiving water or lab water, as appropriate, as described in the manual. If the dilution water used is different from the culture water, a second control, using culture water shall also be used.
8. Quality Assurance/Control:
  - a. A quality assurance/quality control (QA/QC) program shall be instituted to verify the results of the effluent toxicity monitoring program. The QA/QC program shall include but shall not be limited to the following: (1) Selection of an independent testing laboratory; (2) Approval by the Regional Board's Executive Officer or Executive Officer's designee of the independent testing laboratory; (3) Once

---

<sup>11</sup> Refers to USEPA Manual "Short-Term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms. - 4th Ed., October 2002, EPA-821-R-02-013.

during the year, the Discharger shall split samples with the independent laboratory for conducting chronic toxicity testing; (4) Results from the independent laboratory shall be submitted to the Regional Board and the Discharger for evaluation; (5) The discharger shall review the test acceptability criteria in accordance with the EPA test protocols, EPA/600/4-91/002.

- b. Results from the independent laboratory of the annual QA/QC split samples are to be used for Quality Assurance/Quality Control (QA/QC) purposes only and not for purposes of determining compliance with other requirements of this Order.
9. The use of alternative methods for measuring chronic toxicity may be considered by the Executive Officer on a case-by-case basis. The use of a different test species, in lieu of conducting the required test species may be considered and approved by the Executive Officer on a case-by-case basis upon submittal of the documentation supporting Discharger's determination that a different species is more sensitive and appropriate.
10. Reporting: Results of all toxicity testing shall be submitted by the first day of the second month following sampling. The report shall include a determination of the median value of all chronic toxicity testing results conducted during the two previous months.
11. Whenever an Initial Investigation Reduction Evaluation is conducted, the results of the evaluation shall be submitted upon completion. In addition, monthly status reports shall be submitted as part of the Discharger's monitoring report for the previous month.

**VI. LAND DISCHARGE MONITORING REQUIREMENTS – NOT APPLICABLE**

**VII. RECLAMATION MONITORING REQUIREMENTS – NOT APPLICABLE**

**VIII. RECEIVING WATER MONITORING REQUIREMENTS – SURFACE WATER AND GROUNDWATER**

**A. Monitoring During 20:1 Dilution**

The Discharger shall make provisions for the measurement of the receiving water flow at a suitable location in Temescal Creek and determine whether a 20:1 dilution exists at the point of discharge before discharging secondary treated effluent. A dilution of 20:1 or more, exclusive of discharges to surface waters from upstream publicly owned treatment works, is required at the point of discharge for the discharge of secondary effluent. Flow measurements shall be made prior to any direct discharge to Temescal Creek and shall continue on a daily basis until the discharge is terminated.

**B. Monitoring Location R-001U for Surface Water Base Flow**

The Discharger shall monitor upstream of the discharge at R-001U for the following parameters/constituents when there is flowing water:

**Table 4 Receiving Water Monitoring at R-001U**

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Flow	mgd	estimate	Weekly	--
Dissolved Oxygen	mg/L	Grab	Weekly	"
Temperature	°C	"	Weekly	"
pH	Std. unit	Grab	Weekly	"
Total Dissolved Solids	mg/L	Grab	Monthly	"
Total Inorganic Nitrogen	mg/L	Grab	Monthly	"
Total Hardness	mg/L	Grab	Quarterly	"

**C. Monitoring Location R-001D for Surface Water Base Flow**

1. The Discharger shall monitor the receiving water at R-001D when there is flowing water upstream of the discharge point for the following constituents:

**Table 5 Receiving Water Monitoring at R-001D**

Parameter	Units	Sample Type	Minimum Sampling & Testing Frequency	Required Analytical Test Method
Dissolved Oxygen	mg/L	Grab	Weekly	--
Temperature	°C	Grab	Weekly	"
pH	Std. unit	Grab	Weekly	"
Color change, foam, deposition of material, odor	--	Observe	Weekly	"
Total Hardness	mg/L	Grab	Quarterly	"
Total Suspended Solids	mg/L	Grab	Quarterly	"
EPA Priority Pollutants (see VIII.C.2., below)	µg/L	Grab	Annually	See Sections I.2. and I.7., above, of this MRP

2. For the annual monitoring of the heavy metals in the EPA Priority Pollutants list, the total recoverable and total dissolved metal concentration shall also be determined.

#### **D. Regional Monitoring for Fish Flesh Testing**

The Discharger is an active participant in the comprehensive mercury investigation program currently being conducted by the Santa Ana River Dischargers Association (SARDA). If the Discharger discontinues its involvement with this comprehensive program, the Discharger shall, within 60 days of that date, submit for the approval of the Executive Officer its plan for the annual testing of mercury levels in fish flesh samples collected from the Santa Ana River, upstream of, at, and downstream of the point of the discharge point.

#### **E. Monitoring Requirements for Groundwater – Not Applicable**

### **IX. OTHER MONITORING REQUIREMENTS**

#### **A. Biosolids Monitoring – Not Applicable**

Biosolids monitoring requirements are established in Order No. R8-2008-0008.

#### **B. Stormwater Monitoring**

The Discharger shall comply with the monitoring and reporting requirements as outlined in Attachment K and other requirements specified in State Water Board's Order No. 2014-0057-DWQ for storm water discharges at Discharge Points S-01 through S-11 (as specified in Table 2 of the Order).

#### **C. Water Supply Monitoring**

The Discharger shall report monthly the RWRFs (and RCWD Santa Rosa WRF) facility-wide flow weighted TDS water supply quality. The Discharger shall provide the necessary calculations showing the facility-wide TDS water supply quality.

#### **D. Pretreatment Monitoring and Reporting – Not Applicable**

Pretreatment monitoring and reporting requirements are specified in Order No. R8-2008-0008 (for facilities located in the Santa Ana Region), Order No. R9-2000-165 (for Temecula Valley RWRf), and Order No. R9-94-92 (for Santa Rosa Water Reclamation Facility).

### **X. REPORTING REQUIREMENTS**

#### **A. General Monitoring and Reporting Requirements**

1. The Discharger shall comply with all Standard Provisions (Attachment D) related to monitoring, reporting, and recordkeeping.

2. All analytical data shall be reported with method detection limit<sup>12</sup> (MDLs) and with identification of either reporting level, practical quantitation levels (PQLs) or limits of quantitation (LOQs). Quality assurance/quality control data shall be submitted upon request. Test results shall be reported in either milligrams/liter (mg/L) or micrograms/liter ( $\mu\text{g/L}$ ), or nanograms/L (ng/L), as appropriate.
3. Any internal quality control data associated with the sample must be reported when requested by the Executive Officer. The Regional Water Board will reject the quantified laboratory data if quality control data is unavailable or unacceptable.
4. Discharge monitoring data shall be submitted in a format acceptable by the Regional Water Board. Specific reporting format may include preprinted forms and/or electronic media. The results of all monitoring required by this Order shall be reported to the Regional Water Board, and shall be submitted in such a format as to allow direct comparison with the limitations and requirements of this Order.
5. The Discharger shall tabulate the monitoring data to clearly illustrate compliance and/or noncompliance with the requirements of the Order.
6. The Discharger shall submit to the Regional Water Board reports necessary to determine compliance with effluent limitations in this Order and shall follow the chemical nomenclature and sequential order of priority pollutant constituents shown in Attachment G – Priority Pollutant Lists for reporting the required annual priority pollutant monitoring. The Discharger shall report with each sample result:
  - a. The minimum level achieved by the testing laboratory; and
  - b. The laboratory's current MDL, as determined by the procedure found in 40 CFR 136.
  - c. For those priority pollutants without effluent limitations, the Discharger shall require its testing laboratory to quantify constituent concentrations to the lowest achievable MDL as determined by the procedure found in 40 CFR 136. In situations where the trigger value listed in Attachment I is below the minimum level value specified in Attachment H and the Discharger cannot achieve an MDL value for that pollutant below or equal to the ML value, the Discharger shall submit justification why a lower MDL value cannot be achieved. Justification shall be submitted together with monthly monitoring reports.
7. For every item of monitoring data where the requirements are not met, the monitoring report shall include a statement discussing the reasons for noncompliance, the actions undertaken or proposed that will bring the discharge into full compliance with requirements at the earliest time, and an estimate of the date when the Discharger will be in compliance. The Discharger shall notify the Regional Water Board by letter when compliance with the time schedule has been achieved.

---

<sup>12</sup> The standardized test procedure to be used to determine the method detection limit (MDL) is given at Appendix B, 'Definition and Procedure for the Determination of the Method Detection Limit' of 40 CFR 136.

8. The reports for June and December shall include a roster of the recycled water system operators and plant personnel, including job titles, duties, and level of State certification for each individual.
9. The Discharger shall report monitoring results for specific parameters in accordance with the following table:

**Table 6 Reporting Requirements**

Parameter	Measurement
Flow	Daily total
pH	Daily High and Daily Low
Total Residual Chlorine	Daily Maximum
Electrical Conductivity	Daily Maximum
Turbidity	Daily maximum

**B. Self Monitoring Reports (SMRs)**

1. The Discharger shall submit Self-Monitoring Reports (SMRs) electronically using the State Water Board's California Integrated Water Quality System (CIWQS) Program Web site (<https://ciwqs.waterboards.ca.gov>). The CIWQS Web site will provide additional directions for SMR submittal in the event there will be service interruption for electronic submittal.
2. The Discharger shall report in the SMR the results for all monitoring specified in this Monitoring and Reporting Program. Additionally, the Discharger shall report in the SMR the results of any special studies, acute and chronic toxicity testing, TRE/TIE, PMP, and Pollution Prevention Plan required by Special Provisions – VI.C. of this Order. The Discharger shall submit monthly, quarterly, and annual SMRs including the results of all required monitoring using USEPA-approved test methods or other test methods specified in this Order. If the Discharger monitors any pollutant more frequently than required by this Order, the results of this monitoring shall be included in the calculations and reporting of the data submitted in the SMR.
3. Monitoring periods and reporting for all required monitoring shall be completed according to the following schedule during wet weather:

**Table 7 Monitoring Periods and Reporting Schedule**

Sampling Frequency	Monitoring Period Begins On	Monitoring Period	SMR Due Date
Continuous	The effective day of this Order	All	Submit with monthly SMR
Daily	The effective day of this Order	(Midnight through 11:59 PM) or any 24-hour period that reasonably represents a calendar day for purposes of sampling.	Submit with monthly SMR
Weekly	The effective day of this Order	Sunday through Saturday	Submit with monthly SMR
Monthly	First day of calendar	1 <sup>st</sup> day of calendar month through last	First day of the second

**Table 7 Monitoring Periods and Reporting Schedule**

Sampling Frequency	Monitoring Period Begins On	Monitoring Period	SMR Due Date
	month following permit effective date or on permit date if that date is first day of the month	day of calendar month	month following the reporting period, submit as monthly SMR
Quarterly <sup>13</sup>	Closest of January 1, April 1, July 1, or October 1 following permit effective date	January 1 through March 31; April 1 through June 30; July 1 through September 30; October 1 through December 31. Since EMWD's discharge is intermittent, the quarterly samples shall be collected on the earliest representative day during the quarter.	First day of the second month following the reporting period, submit with monthly SMR
Annually	The effective day of this Order	During discharge in wet seasons	First day of the second month following the reporting period, submit with monthly SMR

4. Reporting Protocols. The Discharger shall report with each sample result the applicable reported Minimum Level (ML) and the current Method Detection Limit (MDL), as determined by the procedure in Part 136.

The Discharger shall report the results of analytical determinations for the presence of chemical constituents in a sample using the following reporting protocols:

- a. Sample results greater than or equal to the reported ML shall be reported as measured by the laboratory (i.e., the measured chemical concentration in the sample).
- b. Sample results less than the RL, but greater than or equal to the laboratory's MDL, shall be reported as "Detected, but Not Quantified," or DNQ. The estimated chemical concentration of the sample shall also be reported.

For the purposes of data collection, the laboratory shall write the estimated chemical concentration next to DNQ as well as the words "Estimated Concentration" (may be shortened to "Est. Conc."). The laboratory may, if such information is available, include numerical estimates of the data quality for the reported result. Numerical estimates of data quality may be percent accuracy (+ a percentage of the reported value), numerical ranges (low to high), or any other means considered appropriate by the laboratory.

- c. Sample results less than the laboratory's MDL shall be reported as "Not Detected," or ND.
- d. Dischargers are to instruct laboratories to establish calibration standards so that the ML value (or its equivalent if there is differential treatment of samples relative

<sup>13</sup> Quarterly monitoring result for certain constituents may be used to satisfy the annual monitoring for the same constituents.

to calibration standards) is the lowest calibration standard. At no time is the Discharger to use analytical data derived from extrapolation beyond the lowest point of the calibration curve.

5. The Discharger shall attach a cover letter to the SMR. The information contained in the cover letter shall clearly identify violations of the WDRs; discuss corrective actions taken or planned; and the proposed time schedule for corrective actions. Identified violations must include a description of the requirement that was violated and a description of the violation.

### **C. Discharge Monitoring Reports (DMRs)**

The Discharger to electronically submit USEPA Discharge Monitoring Reports (DMRs) using the CIWQS Program.

### **D. Other Reports**

The Discharger shall report the results of any special studies, acute and chronic toxicity testing, TRE/TIE, PMP, and Pollution Prevention Plan required by Special Provisions – VI.C. of this Order. The Discharger shall submit reports with the first monthly SMR scheduled to be submitted on or immediately following the report due date in compliance with SMR reporting requirements described in subsection X.B.3 above.

## Attachment F – Fact Sheet

### TABLE OF CONTENTS

Attachment F – Fact Sheet .....	F-3
I. Discharge/Facility Information .....	F-4
II. Facility Description .....	F-7
A. Description of Wastewater and Biosolids Treatment and Controls .....	F-7
1. Facility Background .....	F-7
2. Design Characteristics and Biosolids Treatment .....	F-8
B. Discharge Points and Receiving Waters .....	F-10
1. Discharge Points .....	F-10
2. Receiving Waters .....	F-11
3. Stormwater .....	F-11
C. Compliance Summary .....	F-11
III. Applicable Plans, Policies, and Regulations .....	F-11
A. Legal Authorities .....	F-11
B. California Environmental Quality Act (CEQA) .....	F-12
C. State and Federal Regulations, Policies, and Plans .....	F-12
IV. Rationale For Effluent Limitations and Discharge Specifications .....	F-16
A. Discharge Prohibitions .....	F-17
B. Technology-Based Effluent Limitations .....	F-17
1. Scope and Authority .....	F-17
2. Applicable Technology-Based Effluent Limitations .....	F-17
C. Water Quality-Based Effluent Limitations (WQBELs) for DP-001 .....	F-18
1. Scope and Authority .....	F-18
2. Applicable Beneficial Uses and Water Quality Criteria and Objectives .....	F-19
3. Determining the Need for WQBELs for Priority Pollutants .....	F-21
4. WQBEL Calculations .....	F-24
5. Whole Effluent Toxicity (WET) .....	F-25
D. Best Professional Judgment-Based Effluent Specifications for DP-001 .....	F-25
E. Summary of Final Effluent Limitations for DP-001 .....	F-25
1. Satisfaction of Anti-Backsliding Requirements .....	F-25
2. Satisfaction of Antidegradation Policy .....	F-26
3. Stringency of Requirements for Individual Pollutants .....	F-26
4. Summary of Final Effluent Limitations for DP-001 .....	F-26
F. Land Discharge Specifications – Not Applicable .....	F-27
G. Reclamation Specifications – Not Applicable .....	F-27
H. Stormwater Discharge Requirements .....	F-27
V. Rationale for Receiving Water Limitations .....	F-28
A. Surface Water .....	F-28
B. Groundwater .....	F-28
VI. Rationale for Monitoring and Reporting Requirements .....	F-28
A. Influent Monitoring .....	F-28
B. Effluent Monitoring .....	F-28
C. Whole Effluent Toxicity Testing Requirements .....	F-28

D.	Receiving Water Monitoring .....	F-29
1.	Surface Water .....	F-29
2.	Groundwater - Not Applicable .....	F-29
E.	Other Monitoring Requirements .....	F-29
VII.	Rationale for Provisions .....	F-30
A.	Standard Provisions .....	F-30
B.	Special Provisions .....	F-30
1.	Reopener Provisions .....	F-30
2.	Special Studies and Additional Monitoring Requirements .....	F-30
3.	Best Management Practices and Pollution Prevention .....	F-31
4.	Construction, Operation, and Maintenance Specifications – Not Applicable .....	F-31
5.	Special Provisions for Municipal Facilities, POTWs Only – Not Applicable .....	F-31
6.	Other Special Provisions – Not Applicable .....	F-31
7.	Compliance Schedules – Not Applicable .....	F-31
VI.	Public Participation .....	F-31
A.	Notification of Interested Parties .....	F-31
B.	Written Comments .....	F-32
C.	Public Hearing .....	F-32
D.	Waste Discharge Requirements Petitions .....	F-32
E.	Information and Copying .....	F-33
F.	Register of Interested Persons .....	F-33
G.	Additional Information .....	F-33

**List of Tables**

Table 1.	Discharger/Facility Information .....	F-4
Table 2.	Treatment Processes and Treatment Trains .....	F-8
Table 3.	Discharge Points and Receiving Waters .....	F-10
Table 4.	Basin Plan Beneficial Uses .....	F-13
Table 5.	Summary of Technology-Based Effluent Limits for Secondary Treatment .....	F-18
Table 6.	Summary of Water Quality-Based Effluent Limits for Tertiary Treatment .....	F-18
Table 7.	Applicable Basin Plan Surface Water Quality Objectives .....	F-19
Table 8.	EMWD's Temescal Creek Discharge Monitoring Data Summary, µg/L .....	F-23
Table 9.	EMWD's Temescal Creek Discharge Monitoring Data Summary, µg/L .....	F-23
Table 10.	RPA Evaluation .....	F-24
Table 11.	Criteria calculation based on California Toxics Rule for freshwater discharges .....	F-24
Table 12.	Tertiary Effluent BOD <sub>5</sub> and TSS Limits .....	F-25
Table 13.	Summary of Water Quality-Based Effluent Limits at DP-001 .....	F-26

## **ATTACHMENT F – FACT SHEET**

As described in Section II of this Order, this Fact Sheet includes the legal requirements and technical rationale that serve as the basis for the requirements of this Order.

This Order has been prepared under a standardized format to accommodate a broad range of discharge requirements for Dischargers in California. Only those sections or subsections of this Order that are specifically identified as “not applicable” have been determined not to apply to this Discharger. Sections or subsections of this Order not specifically identified as “not applicable” are fully applicable to this Discharger.

**I. DISCHARGE/FACILITY INFORMATION**

The following table summarizes administrative information related to the Facility.

**Table 1. Discharger/Facility Information**

<b>WDID</b>	8 332303001					
<b>Discharger/Operator</b>	Eastern Municipal Water District (EMWD)					Rancho California Water District (RCWD)
<b>Name of Facility</b>	Regionwide Water Recycling System - Temescal Creek Discharge					
	San Jacinto Valley RWRf <sup>1</sup>	Moreno Valley RWRf	Perris Valley RWRf	Sun City RWRf	Temecula Valley <sup>2</sup> RWRf	Santa Rosa Water Reclamation Facility <sup>2</sup>
<b>Facility Address</b>	770 North Sanderson Avenue	17140 Kitching Street	1301 Case Road	29285 Valley Blvd.	42565 Avenida Alvarado	26266 Washington Avenue
	San Jacinto, CA 92582	Moreno Valley, CA 92553	Perris, CA 92570	Sun City, CA 92586	Temecula, CA 92590	Murrieta, CA 92562
	Riverside County					
<b>Discharger Legally Responsible Officer</b>	Jayne Joy, Director of Environmental & Regulatory Compliance, (951) 928-3777 ext. 6241					
<b>Facility Contacts</b>	Paul D. Jones II, General Manager, (951) 928-3777 ext. 6109 Al Javier, Environmental Services Manager, (951) 928-3777 ext. 6327					
<b>Mailing Address</b>	2270 Trumble Road, Perris, CA 92570					
<b>Billing Address</b>	EMWD, P.O. BOX 8300, Perris, CA 92572-8300					
<b>Type of Facility</b>	POTW					
<b>Major or Minor Facility</b>	Major					
<b>Threat to Water</b>	1					

<sup>1</sup> RWRf means Regional Water Reclamation Facility

<sup>2</sup> Temecula Valley RWRf and Santa Rosa WRF are regulated by the San Diego Regional Water Quality Control Board.

**Table 1. Discharger/Facility Information**

<b>Quality</b>	
<b>Complexity</b>	A
<b>Pretreatment Program</b>	No <sup>3</sup>
<b>Reclamation Requirements</b>	No <sup>3</sup>
<b>Facility Permitted Flow</b>	52.5 million gallons per day (mgd)
<b>Facility Design Flow</b>	77 mgd
<b>Receiving Water</b>	Reach 5 of Temescal Creek and Reach 3 of Santa Ana River
<b>Receiving Water Type</b>	Inland Surface Water
<b>Watershed</b>	Santa Ana

<sup>3</sup> Waste Discharge Requirements Order No. R8-2008-0008 issued to the Discharger for discharges to land from its five regional water reclamation facilities include reclamation and pretreatment requirements. For the Temecula Valley RWRP and Santa Rosa WRF, discharges to land, including reclamation and pretreatment requirements, are regulated by Orders No. R9-2000-165 and R9-94-92, respectively.

Eastern Municipal Water District (hereinafter Discharger, or EMWD) is the owner and operator of a pipeline (hereinafter the Facility) that links to a single regionwide water recycling system connecting the five Regional Water Reclamation Facilities (RWRFs) operated by EMWD and the one facility operated by Rancho California Water District (RCWD). The production and distribution of recycled water from these facilities are regulated under waste discharge requirements issued by the Santa Ana Regional Water Board (R8-2008-0008 for the San Jacinto Valley, Moreno Valley, Perris Valley and Sun City RWRFs) and the San Diego Regional Water Board (R9-2000-165 for the Temecula Valley RWRf and R9-94-92 for the Santa Rosa WRF). Under dry weather conditions, most of the recycled water from these six facilities is distributed to recycled water users. During storm events, the excess recycled water is discharged into Temescal Creek.

The Facility discharges treated wastewater to Reach 5 of Temescal Creek, a tributary to Reach 3 of Santa Ana River during wet weather conditions when recycled water supply exceeds the demand and the capacities of recycled water storage ponds located onsite at each RWRf and offsite seasonal storage ponds, which include Alessandro Ponds, Case Road Pond, San Jacinto Reservoir Ponds, Skiland Ponds, Trumble Pond(s)<sup>4</sup> and Winchester Ponds. At times when RCWD's recycled water system is at capacity, treated recycled water from RCWD's Santa Rosa Water Reclamation Facility (SRWRf) may be included with EMWD's discharge. Both Temescal Creek and the Santa Ana River are waters of the United States. Neither Temescal Creek nor the Santa Ana River is naturally perennial. During dry weather, the flow in these waterbodies is comprised predominantly of effluent discharges from municipal wastewater treatment facilities and there is very little natural flow. Stormwater runoff from the water reclamation facilities is discharged into the San Jacinto River or Salt Creek, both of which are waters of the United States. EMWD is currently discharging recycled water pursuant to Order No. R8-2009-0014, NPDES No. CA8000188, which was adopted on May 22, 2009 and expired on May 31, 2014.

The Discharger filed a report of waste discharge and submitted an application for renewal of its Waste Discharge Requirements (WDRs) and National Pollutant Discharge Elimination System (NPDES) permit on November 25, 2013. The Discharger is proposing to discharge up to 52.5 million gallons per day (mgd, monthly average flow) and up to a daily maximum of 58 mgd of treated recycled water from the Facility to Reach 5 of Temescal Creek. Because the Discharger submitted a timely application for renewal of the NPDES Permit, Order No. R8-2009-0014 has been administratively extended until the Regional Board adopts renewed requirements.

<sup>4</sup>

*An additional Trumble Pond is currently being constructed with another pond waiting for future funding.*

## II. FACILITY DESCRIPTION

The Facility essentially consists of the recycled water pipeline network that is utilized to collect treated recycled water from the six regional water reclamation facilities. The Facility is also used for distribution of recycled water to the recycled water users.

### A. Description of Wastewater and Biosolids Treatment and Controls

#### 1. Facility Background

EMWD's service area encompasses approximately 555 square miles of the western portion of Riverside County and serves a population of 785,000. In addition to the EMWD's sewer collection system, EMWD receives sewage from the cities of Perris, Hemet, San Jacinto, Lake Hemet Municipal Water District, Pechanga<sup>5</sup> and Western Municipal Water District and treats the wastewater at EMWD's four out of five RWRFs. These are the San Jacinto Valley RWRf, Moreno Valley RWRf, Perris Valley RWRf, and Temecula Valley RWRf. The Sun City RWRf is currently offline. Four of these RWRFs are within the Santa Ana Regional Water Board's jurisdiction and one facility (Temecula Valley RWRf) is within the San Diego Regional Water Board's jurisdiction. Order No. R8-2008-0008, which was adopted on September 5, 2008, regulates the discharges from the five facilities into percolation/storage ponds and the use of recycled water within that portion of EMWD's service area that is within the Santa Ana Regional Water Board's jurisdiction. Treated recycled water from these five plants is distributed through a single, regionwide water reclamation system that includes the option of discharging into Reach 5 of Temescal Creek.

RCWD's service area encompasses approximately 155 square miles located in the southern part of Riverside County. RCWD services the area known as Rancho California, which includes the City of Temecula, a portion of the City of Murrieta, and other contiguous land in the unincorporated areas of Riverside County. Sewage generated within RCWD's service areas is conveyed to and treated at the SRWRf, which is owned and operated by RCWD. The SRWRf is within the San Diego Regional Water Board's jurisdiction and is currently regulated by Order No. R9-94-92, with amendment Addendums No. 1, 2, and 3 for the storage and use of recycled water in areas overlying the Murrieta Hydrologic subunit, the downstream portions of the Pauba and Wolf Hydrologic subareas, Auld, Deluz and Walker Hydrologic areas. Order No. R8-2009-0014 authorizes intermittent discharges from the SRWRf to Temescal Creek via the Palomar pipeline, which is a part of EMWD's regionwide water recycling system.

---

<sup>5</sup> Pechanga is outside the Santa Ana Regional Water Board's jurisdiction, however wastewater from this service area goes to the Temecula Valley RWRf.

## 2. Design Characteristics and Biosolids Treatment

The treatment processes at each RWRf are tabulated as follows:

**Table 2. Treatment Processes and Treatment Trains**

RWRf	San Jacinto Valley	Moreno Valley	Perris Valley		Sun City <sup>6</sup>	Temecula Valley	Santa Rosa
Plant #	1 & 2	1 & 2	1 <sup>7</sup>	2 & 3	1	1 & 2	1
<b>Preliminary Treatment</b>	Screens and Grit removal	Screens and Grit removal (Plant 1 Influent EQ Basin)	Screens and Grit removal		Screens and Grit removal	Screens and Grit with Influent EQ Basin	Screens and Grit removal
<b>Primary Treatment</b>	Primary Clarifiers	Primary Clarifiers (Plant 2 Selectors)	Primary Clarifiers	Primary Clarifiers	Primary Clarifiers w/ Primary EQ Basin	Primary Clarifiers w/ Primary EQ Basin	None
<b>Secondary Treatment</b>	<b>Plant 1:</b> Diffused activated sludge modified for biological nitrification/denitrification (NDN)  <b>Plant 2:</b> Activated sludge, BNR, secondary clarifiers for both plants	Diffused activated sludge modified for biological NDN, secondary clarifiers	Diffused activated sludge, secondary clarifiers	<b>Plant 2:</b> Bardenpho conversion to diffused activated sludge w/ biological NDN, secondary clarifiers  <b>Plant 3:</b> Diffused activated sludge w/ biological NDN, secondary clarifiers	Diffused activated sludge, secondary clarifiers	Diffused activated sludge w/ biological NDN, secondary clarifiers	Jet aeration Sequencing Batch Reactors activated sludge w/ biological nitrification/denitrification (NDN)
<b>Secondary EQ Basin<sup>8</sup></b>	Yes	Yes	No	Yes	No	Yes	Yes
<b>Tertiary Train #</b>	1	1	N/A	1	N/A	1	2
<b>Tertiary Treatment</b>	Coagulant, Filtration (cloth), Chlorination	Coagulant, Filtration (sand & cloth), Chlorination	N/A	Coagulant (Aluminum sulfate), Filtration	N/A	Coagulant, Filtration (sand & cloth),	Coagulant, Tertiary Clarification,

<sup>6</sup> The Sun City RWRf is out of service but is used as a lift station.

<sup>7</sup> Plant 1 at Perris Valley RWRf is out of service.

<sup>8</sup> Secondary EQ Basin provides for Equalized Tertiary Flow.

**Table 2. Treatment Processes and Treatment Trains**

RWRF	San Jacinto Valley	Moreno Valley	Perris Valley		Sun City <sup>6</sup>	Temecula Valley	Santa Rosa
				(sand & cloth), Chlorination		Chlorination	Multi-Media Filtration, Chlorination, Dechlorination
<b>Treatment Capacity<sup>9</sup>, mgd</b>	14 Secondary 19.95 Tertiary	16 Secondary 22.5 Tertiary	N/A	24 Secondary 30 Tertiary	N/A	18 Secondary <sup>10</sup> 22.4 Tertiary	5.0 mgd
<b>Solids Handling</b>	Sludge thickening, anaerobic digestion, belt press & centrifuge, sludge drying beds and co- generation (future)	Sludge thickening, anaerobic digestion, belt press & centrifuge, sludge drying beds and fuel cell	Aqua belt thickener, aerobic digestion	Sludge thickener & anaerobic digestion	Aqua belt thickener, aerobic digestion, Belt Press	Sludge thickening, anaerobic digestion, belt press & centrifuge, sludge drying beds and co-generation (future)	Sludge thickening, aerobic digestion, belt press, sludge drying beds
			Belt Press & Centrifuge				

<sup>9</sup> Secondary denotes secondary design capacity while tertiary denotes the State Water Resources Control Board's Division of Drinking Water approved tertiary capacity.

<sup>10</sup> The secondary treatment capacity of the Temecula Valley RWRF will be expanded to 23 mgd in year 2019.

The total design flow rate of EMWD's five facilities and RCWD's SRWRF is 77 mgd. From 2010 to 2013, the maximum daily flows were reported as 50.3 mgd, 41.4 mgd, 37.4 mgd and 44.9 mgd, respectively. Order No. R8-2009-0014 authorized the Discharger to discharge up to a monthly average of 52.5 mgd of treated wastewater from its recycled water system to Reach 5 of Temescal Creek.

Since March 2013 to August 2015, there has been no discharge of recycled water to Temescal Creek. EMWD's goal is to limit all discharges to surface waters and to utilize 100% of the recycled water within the District.

Attachment B provides a map of the area around each Reclamation Facility.

Attachment C provides a treatment flow schematic for each Facility.

## B. Discharge Points and Receiving Waters

### 1. Discharge Points

The following Table shows the discharge points, longitude and latitude, affected receiving waters, and estimated volume of surface water discharge for treated wastewater (DP-001) and for stormwater discharges from EMWD's RWRFs:

**Table 3. Discharge Points and Receiving Waters**

Discharge Point No.	Latitude	Longitude	Description and Receiving Water	Flow (MGD) & Frequency
001	33° 40' 52.00" N	117° 19' 54.00" W	Primary discharge point is approximately 40 feet upstream of confluence of Wasson Canyon flood control channel and Reach 5 of Temescal Creek	Up to 52.5 mgd, intermittent, seasonal
S-01	33° 47' 53.14" N	117° 00' 26.18" W	Stormwater from San Jacinto Valley RWRF to storm drain tributary to San Jacinto River	varies
S-02	33° 52' 12.37" N	117° 13' 02.50" W	Stormwater from Moreno Valley RWRF to Perris Storm Channel tributary to San Jacinto River	varies
S-03	33° 52' 01.96" N	117° 13' 04.29" W		varies
S-04	33° 41' 40.80" N	117° 12' 34.01" W	Storm Water from Sun City RWRF to storm drain tributary to Salt Creek	varies
S-05	33° 41' 10.87 "N	117° 12' 36.43" W		varies
S-06	33° 41' 40.53" N	117° 12' 39.15" W		varies
S-07	33° 41' 42.30 "N	117° 12' 38.94" W		varies
S-08	33° 41' 45.60" N	117° 12' 34.40" W		varies
S-09	33° 41' 29.65" N	117° 29' 56.80" W		varies
S-10	33° 41' 25.27" N	117° 13' 01.22" W		varies

**Table 3. Discharge Points and Receiving Waters**

Discharge Point No.	Latitude	Longitude	Description and Receiving Water	Flow (MGD) & Frequency
S-11	33° 45' 40.63" N	117° 12' 06.99" W	Stormwater from Perris Valley RWRP to storm drain tributary to San Jacinto River	varies

## 2. Receiving Waters

Treated wastewater is discharged at Discharge Point (DP) 001, which is located near EMWD's Dissipation Station at 636 Minthorn Street, Lake Elsinore. DP-001 discharges into the Wasson Canyon flood control channel, which is approximately 40 feet upstream from the confluence of the channel and Reach 5 of Temescal Creek.

## 3. Stormwater

During heavy storm events, excess runoff at each of EMWD's RWRP overflows into nearby storm conveyances, as listed in Table 3, above.

## C. Compliance Summary

Based on a review of effluent monitoring data submitted by the Discharger for the period from January 2010 through February 2013 (there has been no discharge to Temescal Creek since March 2013), the wastewater discharged from the Facility was generally in compliance with the effluent limitations specified in the previous waste discharge requirements, Order No. R8-2009-0014, with the exception of 2 violations of Ammonia Nitrogen, 1 violation of Dichlorobromomethane and Total Inorganic Nitrogen (TIN), and 12 violations of Total Dissolved Solids (TDS).

## III. APPLICABLE PLANS, POLICIES, AND REGULATIONS

The requirements contained in the proposed Order are based on the requirements and authorities described in this section.

### A. Legal Authorities

This Order serves as Waste Discharge Requirements pursuant to Article 4, Chapter 4 of California Water Code (CWC) commencing with Section 13260. This Order shall also serve as an NPDES permit pursuant to Section 402 of the federal Clean Water Act (CWA) and implementing regulations adopted by the U.S. Environmental Protection Agency (USEPA) and Chapter 5.5, Division 7 of the CWC for point source discharges from this Facility to surface waters.

## **B. California Environmental Quality Act (CEQA)**

Under Water Code section 13389, this action to adopt waste discharge requirements that serve as a NPDES permit is exempt from the provisions of CEQA, Public Resources Code section 21000 et seq. (*County of Los Angeles v. California State Water Resources Control Board* (2006) 143 Cal.App.4th 985, mod. (Nov. 6, 2006, B184034) 50 Cal.Rptr.3d 619, 632-636.)

## **C. State and Federal Regulations, Policies, and Plans**

### **1. Water Quality Control Plans**

The Regional Water Board adopted an updated Water Quality Control Plan for the Santa Ana Basin (hereinafter Basin Plan) that became effective on January 24, 1995. The Basin Plan designates beneficial uses, establishes water quality objectives, and contains implementation programs and policies to achieve those objectives for all waters addressed through the plan. In addition, State Water Resources Control Board (State Water Board) Resolution No. 88-63 (Sources of Drinking Water Policy) requires that, with certain exceptions, the Regional Water Board assign the municipal and domestic water supply use to all water bodies. Based on the exception criteria specified in Resolution No. 88-63, the Regional Water Board excepted Temescal Creek and certain reaches of the Santa Ana River, including Reach 3 and downstream reaches from the municipal and domestic supply beneficial use.

On January 22, 2004, the Regional Water Board adopted Resolution No. R8-2004-0001, amending the Basin Plan to incorporate revised boundaries for groundwater subbasins, now termed "management zones", new nitrate-nitrogen and TDS objectives for the new management zones, and new nitrogen and TDS management strategies applicable to both surface and ground waters. The State Water Board and Office of Administrative Law (OAL) approved the N/TDS Amendment on September 30, 2004 and December 23, 2004, respectively. Accordingly, these waste discharge requirements implement relevant, groundwater-related components of the N/TDS Amendment. Specifically, the total dissolved solids (TDS) and total inorganic nitrogen (TIN) limitations established in this Order are based on the wasteload allocations in the Basin Plan.

The designated beneficial uses of receiving waters affected by the discharge from the Facility are as follows:

**Table 4. Basin Plan Beneficial Uses**

Discharge Point	Receiving Water	Beneficial Uses
001	Reach 5 of Temescal Creek	<u>Present or Potential:</u> Agricultural supply, groundwater recharge, water contact recreation, non-contact water recreation, warm freshwater habitat, wildlife habitat, and rare, threatened or endangered species. Excepted from Municipal and Domestic Supply.
	Reach 3 of Santa Ana River and downstream reaches	<u>Present or Potential:</u> Agricultural supply, groundwater recharge, water contact recreation, non-contact water recreation, warm freshwater habitat, wildlife habitat, and rare, threatened or endangered species. Excepted from Municipal and Domestic Supply.
	Prado Basin Management Zone	<u>Present or Potential:</u> Warm freshwater habitat; wildlife habitat, Water contact <sup>11</sup> recreation, non-contact water recreation, and rare, threatened or endangered species. Excepted from Municipal and Domestic Supply
	Elsinore and downstream groundwater management zones	<u>Present or Potential:</u> Municipal water supply, Agricultural supply, industrial process supply, Industrial service supply
S-01 to S-12	Ephemeral surface water drainages, such as Salt Creek, and San Jacinto River	<u>Present or Potential, intermittent beneficial uses:</u> Agricultural supply, groundwater recharge, water contact recreation, non-contact water recreation, warm freshwater habitat, wildlife habitat

Requirements of this Order implement the Basin Plan.

**2. National Toxics Rule (NTR) and California Toxics Rule (CTR)**

USEPA adopted the NTR on December 22, 1992, and later amended it on May 4, 1995 and November 9, 1999. About forty criteria in the NTR applied in California. On May 18, 2000, USEPA adopted the CTR. The CTR promulgated new toxics criteria for California and, in addition, incorporated the previously adopted NTR criteria that were applicable in the state. The CTR was amended on February 13, 2001. These rules contain numeric water quality criteria for priority pollutants.

<sup>11</sup> Access prohibited in some areas by Riverside County Flood Control.

### **3. State Implementation Policy**

On March 2, 2000, the State Water Board adopted the *Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California* (State Implementation Policy or SIP). The SIP became effective on April 28, 2000 with respect to the priority pollutant criteria promulgated for California by the USEPA through the NTR and to the priority pollutant objectives established by the regional water boards in the basin plans. The SIP became effective on May 18, 2000 with respect to the priority pollutant criteria promulgated by the USEPA through the CTR. The State Water Board adopted amendments to the SIP on February 24, 2005 that became effective on July 13, 2005. The SIP establishes implementation provisions for priority pollutant criteria and objectives and provisions for chronic toxicity control. Requirements of this Order implement the SIP.

### **4. Alaska Rule**

On March 30, 2000, USEPA revised its regulation that specifies when new and revised state and tribal water quality standards (WQS) become effective for CWA purposes (40 C.F.R. § 131.21, 65 Fed. Reg. 24641 (April 27, 2000)). Under the revised regulation (also known as the Alaska rule), new and revised standards submitted to USEPA after May 30, 2000, must be approved by USEPA before being used for CWA purposes. The final rule also provides that standards already in effect and submitted to USEPA by May 30, 2000, may be used for CWA purposes, whether or not approved by USEPA.

### **5. Antidegradation Policy**

40 CFR 131.12 requires that state water quality standards include an antidegradation policy consistent with the federal policy. The State Water Board established California's antidegradation policy in State Water Board Resolution No. 68-16. Resolution No. 68-16 incorporates the federal antidegradation policy where the federal policy applies under federal law. Resolution No. 68-16 requires that existing water quality be maintained unless degradation is justified based on specific findings. The Regional Water Board's Basin Plan implements, and incorporates by reference, both the State and federal antidegradation policies. The permitted discharge must be consistent with the antidegradation provision of section 131.12 and State Water Board Resolution No. 68-16.

The requirements specified in this Order are designed to protect and enhance existing water quality. Based on the data currently available, discharges in compliance with the terms and conditions of this Order should not result in a lowering of water quality and are therefore consistent with antidegradation provisions.

## **6. Anti-Backsliding Requirements.**

Sections 402(o)(2) and 303(d)(4) of the CWA and federal regulations at 40 CFR 122.44(l) prohibit backsliding in NPDES permits. These anti-backsliding provisions require that effluent limitations in a reissued permit must be as stringent as those in the previous permit, with some exceptions in which limitations may be relaxed or eliminated. Section 402(o) allows for backsliding when there is information available that was not available when the original effluent limits were set. Data collected since Order No. R8-2009-0014 was adopted show selenium no longer poses a reasonable potential to cause or create an exceedance of water quality standards. Therefore, pursuant to CWA Section 402(o)(2)(B)(i), a limit for selenium is no longer included in this Order. As noted above, with the exception of free cyanide, all effluent limitations in this Order are at least as stringent as the effluent limitations in the previous order (see section IV.E.1., below). Therefore, this Order conforms to the anti-backsliding requirements of the CWA and federal regulations.

## **7. Monitoring and Reporting Requirements**

Sections 13267 and 13383 of the CWC authorize the Regional Water Board to require technical and monitoring reports. 40 CFR 122.48 of 40 CFR requires that all NPDES permits specify requirements for recording and reporting monitoring results. The Monitoring and Reporting Program (MRP) establishes monitoring and reporting requirements to implement State and federal requirements. This MRP is provided in Attachment E.

## **8. Pretreatment – Not Applicable**

Pretreatment requirements and monitoring and reporting requirements are specified in Order No. R8-2008-0008 (for facilities located in the Santa Ana Region), Order No. R9-2000-165 (for Temecula Valley RWRf), and Order No. R9-94-92 (for Santa Rosa Water Reclamation Facility).

## **9. Biosolids – Not Applicable**

Biosolids monitoring requirements are specified in Order No. R8-2008-0008

## **10. Impaired Water Bodies on CWA 303(d) List**

Reach 3 of the Santa Ana River is included in the USEPA approved 2010 CWA 303(d) list due to pathogen indicators, resulting principally from dairy operations inputs during storm events. This Order requires that the wastewater discharged from the Facility be essentially free of pathogens/pathogen indicators for surface water discharges.

Reach 3 of the Santa Ana River is also included in the USEPA approved 2010 CWA 303(d) list for copper and lead. As noted below, discharges of copper and lead from the Facility do not pose a reasonable potential to cause or contribute the exceedance of water quality objectives.

#### **11. Total Dissolved Solids(TDS)**

As the drought continues, the TDS concentration levels of the water supply within EMWD's service area have risen. This has caused the effluent TDS concentrations to rise, thereby exceeding the effluent limits specified in EMWD's waste discharge requirements.

As noted earlier, Temescal Creek recharges the underlying groundwater basins in the Upper Temescal Valley. EMWD has been participating in a study with Elsinore Valley Municipal Water District to determine appropriate groundwater quality objectives and ambient water quality for the Upper Temescal Valley Groundwater Management Zones. The study should provide an overall salt management plan for the Upper Temescal Valley Groundwater Management Zones. Until groundwater quality objectives and ambient water quality are determined, it is not known how EMWD's discharge would affect those management zones. The study could indicate that EMWD's current discharge quality does not adversely affect these basins. However, if the study indicates that the discharge adversely affects water quality, the management plan will include an action plan to mitigate those impacts. The Executive Officer has determined that participation in this study and the requirement to mitigate any impacts are acceptable offsets for any short-term potential adverse impacts from discharges in excess of the TDS limits specified in this Order. In addition, recent model runs have indicated that discharges in excess of the effluent limits specified in this Order will not cause any measurable degradation of water quality in the Santa Ana River. As such, EMWD is proposing to pursue a Basin Plan amendment to modify their wasteload allocation for this discharge. This Order may be reopened to incorporate any new wasteload allocation, upon its approvals.

#### **IV. RATIONALE FOR EFFLUENT LIMITATIONS AND DISCHARGE SPECIFICATIONS**

The CWA requires point source Dischargers to control the amount of conventional, non-conventional, and toxic pollutants that are discharged into the waters of the United States. The control of pollutants discharged is established through effluent limitations and other requirements in NPDES permits. There are two principal bases for effluent limitations; 40 CFR 122.44(a) requires that permits include applicable technology-based limitations and standards; and section 122.44(d) requires that permits include water quality-based effluent limitations to attain and maintain applicable numeric and narrative water quality criteria to protect the beneficial uses of the receiving water

## **A. Discharge Prohibitions**

The discharge prohibitions are based on the Federal Clean Water Act, Basin Plan, State Water Board's plans and policies, U.S. Environmental Protection Agency guidance and regulations, and previous waste discharge requirements, Order No. R8-2009-0014, and are consistent with the discharge prohibitions set for other discharges regulated by waste discharge requirements adopted by the Regional Water Board.

## **B. Technology-Based Effluent Limitations**

### **1. Scope and Authority**

Section 301(b) of the CWA and implementing USEPA permit regulations at 40 CFR 122.44 require that permits include conditions meeting applicable technology-based requirements at a minimum, and any more stringent effluent limitations necessary to meet applicable water quality standards. The discharge authorized by this Order must meet minimum federal technology-based requirements based on Secondary Treatment Standards at 40 CFR 133 and/or Best Professional Judgment (BPJ) in accordance with 40 CFR 125.3.

Regulations promulgated in 40 CFR §125.3(a)(1) require technology-based effluent limitations for municipal dischargers to be placed in waste discharge requirements based on Secondary Treatment Standards or Equivalent to Secondary Treatment Standards.

The Federal Water Pollution Control Act Amendments of 1972 (PL 92-500) established the minimum performance requirements for POTWs [defined in Section 304(d)(1)]. Section 301(b)(1)(B) of that Act requires that such treatment works must, as a minimum, meet effluent limitations based on secondary treatment as defined by the USEPA Administrator. Based on this statutory requirement, USEPA developed secondary treatment regulations, which are specified in 40 CFR 133. These technology-based regulations apply to all municipal wastewater treatment plants and identify the minimum level of effluent quality attainable by secondary treatment in terms of biochemical oxygen demand (BOD<sub>5</sub>), total suspended solids (TSS), and pH.

### **2. Applicable Technology-Based Effluent Limitations**

This Facility meets the technology-based regulations for the minimum level of effluent quality attainable by secondary treatment in terms of BOD<sub>5</sub>, total suspended solids, percent removal rate, and pH as summarized in Table 5, below. These effluent limitations are applicable for discharges to Discharge Point 001 under conditions of 20:1 dilution provided by natural flow in Temescal Creek.

**Table 5. Summary of Technology-Based Effluent Limits for Secondary Treatment**

Constituent	Average Weekly (mg/L)	Average Monthly (mg/L)	Average Monthly Removal Rate %
Biochemical Oxygen Demand, 5-day 20°C	45	30	85
Total Suspended Solids	45	30	85
pH (std. unit)	6.0 (instantaneous minimum)	9.0 (instantaneous maximum)	

**C. Water Quality-Based Effluent Limitations (WQBELs) for DP-001**

**1. Scope and Authority**

Section 301(b) of the CWA and section 122.44(d) require that permits include limitations more stringent than applicable federal technology-based requirements where necessary to achieve applicable water quality standards.

As noted in section IV.C.2.c., below, tertiary treatment is required to protect beneficial uses of Temescal Creek and Santa Ana River when 20:1 dilution conditions are not present. During these conditions, the water quality-based limits, which are based on BPJ for levels achievable with tertiary treatment, summarized in Table 6, below, are applicable.

**Table 6. Summary of Water Quality-Based Effluent Limits for Tertiary Treatment**

Constituent	Average Weekly (mg/L)	Average Monthly (mg/L)	Average Monthly Removal Rate %
Biochemical Oxygen Demand, 5-day 20°C	30	20	85
Total Suspended Solids	30	20	85

Section 122.44(d)(1)(i) mandates that permits include effluent limitations for all pollutants that are or may be discharged at levels that have the reasonable potential to cause or contribute to an exceedance of a water quality standard, including numeric and narrative objectives within a standard. Where reasonable potential has been established for a pollutant, but there is no numeric criterion or objective for the pollutant, water quality-based effluent limitations (WQBELs) must be established

using: (1) USEPA criteria guidance under CWA section 304(a), supplemented where necessary by other relevant information; (2) an indicator parameter for the pollutant of concern; or (3) a calculated numeric water quality criterion, such as a proposed state criterion or policy interpreting the state's narrative criterion, supplemented with other relevant information, as provided in 40 CFR 122.44(d)(1)(vi).

The process for determining reasonable potential and calculating WQBELs when necessary is intended to protect the designated uses of the receiving water as specified in the Basin Plan, and achieve applicable water quality objectives and criteria that are contained in other state plans and policies, or any applicable water quality criteria contained in the CTR and NTR.

## 2. Applicable Beneficial Uses and Water Quality Criteria and Objectives

### a. Basin Plan:

The Basin Plan specifies narrative and numeric water quality objectives for all inland surface waters, including Temescal Creek and the Santa Ana River. Some of those applicable to these receiving waters are listed in the Table 7, below.

**Table 7. Applicable Basin Plan Surface Water Quality Objectives**

Constituents	Basis for Limitations
Ammonia Nitrogen	"Un-ionized ammonia (NH <sub>3</sub> or UIA) is toxic to Fish and other aquatic organisms. In water, UIA exists in equilibrium with ammonium (NH <sub>4</sub> <sup>+</sup> ) and hydroxide (OH <sup>-</sup> ) ions. The proportions of each change with temperature, pH and salinity of the water." Thus, ammonia discharges to surface water pose a threat to aquatic life and instream beneficial uses, as well as to the beneficial uses of affected groundwater. The Basin Plan specifies total ammonia and un-ionized ammonia objectives and an effluent limit of 4.5 mg/L for discharges to Temescal Creek, listed in Table 5-6.
Hydrogen Ion (pH)	Hydrogen Ion (pH) is a measure of the Hydrogen Ion concentration in the water. Extreme pH levels can have adverse effects on aquatic biota and can corrode pipes and concrete. The Basin Plan specifies that the pH in inland surface waters shall not be depressed below 6.5, nor raised above 8.5 as a result of controllable water quality factors.
Total Chlorine Residual	Chlorine and its reaction products are toxic to aquatic life. To protect aquatic life, the Basin Plan specifies that for wastewater discharged into inland surface waters, the chlorine residual should not exceed 0.1 mg/L.
Total Dissolved Solids	The Basin Plan specifies a wasteload allocation of 650 mg/L for Total Dissolved Solids for discharges from EMWD that may affect the Santa Ana River.
Total Inorganic Nitrogen	The Basin Plan specifies a wasteload allocation of 10 mg/L for Total Inorganic Nitrogen for discharges from EMWD that may affect the Santa Ana River.

- (1) TDS and TIN: TDS and TIN limitations are specified in the Order for discharges of tertiary treated effluent from DP-001 to Reach 5 of Temescal Creek, a tributary to Reach 3 of the Santa Ana River within the Prado Basin Management Zone. These TDS/TIN limits are based on the wasteload allocations specified in Table 5-5 of the Basin Plan. These allocations were developed to achieve the TDS and nitrogen objectives of affected receiving waters.

TDS: This Order includes a TDS limit based on the flow weighted running average quality of the water supplied to the service area plus a reasonable use increment of 250 mg/L. (The flow-weighted average is calculated based on data for the months (typically wet months) when discharges to Temescal Creek occur.) This reasonable use increment addition is discussed and authorized in the Basin Plan.

For surface water discharges, the more restrictive of the TDS limit based on the wasteload allocation or the TDS limit based on water supply quality plus a reasonable use increment applies to discharges from the Facility.

In accordance with 40 CFR 122.45(d), there may be instances in which the basis for a limit for a particular continuous discharge may be impracticable to be stated as a maximum daily, average weekly, or average monthly effluent limitation. The Regional Water Board has determined that it is not practicable to express TDS and TIN effluent limitations as average weekly and average monthly effluent limitations because the TDS and TIN objectives in the Basin Plan were established primarily to protect the underlying groundwater. Consequently, a 12-month average period is typically more appropriate. This Order specifies 12-month average limits for TDS and TIN. However, this Order also recognizes that discharges occur only during wet months. Accordingly, calculations to determine compliance with the 12-month average limits will be based solely on data collected during those months when discharges actually occur.

- (2) TDS offset program: The Basin Plan recognizes that strict compliance with TDS limits may be difficult to achieve and it describes the regulatory approach the Regional Board uses to address such situations. The Board incorporates offset provisions in waste discharge requirements whereby dischargers can implement an approved program to offset TDS discharges in excess of specified TDS limits, provided that the Discharger makes all reasonable efforts to improve the TDS quality of the water supply (and thereby, the wastewater).

**b. NTR, CTR and SIP**

The National Toxics Rule, California Toxics Rule and State Implementation Policy specify numeric objectives for toxic substances and the procedures

whereby these objectives are to be implemented. The procedures include those used to conduct reasonable potential analysis to determine the need for effluent limitations for priority and non-priority pollutants.

**c. Requirement to meet 2.2 total coliform bacteria limit in the effluent**

Article 3, Section 60305 of Title 22, Chapter 3, "Use of Recycled Water for Impoundments" of the California Code of Regulations specifies that recycled water used as a source of supply in a nonrestricted recreational impoundment shall be at all times an adequately disinfected, oxidized, coagulated, clarified, filtered wastewater (tertiary recycled water). The degree of treatment specified represents an approximately 5-log reduction in the virus content of the water. The State Water Resources Control Board, Division of Drinking Water (DDW), has determined that this degree of virus removal is necessary to protect the health of people using these impoundments for water contact recreation. The DDW has developed wastewater disinfection guidelines ("Wastewater Disinfection for Health Protection", Department of Health Services, Sanitary Engineering Branch, February 1987) for discharges of wastewater to surface waters where water contact recreation (REC-1) is a beneficial use. The disinfection guidelines recommend the same treatment requirements for wastewater discharges to REC-1 waters as those stipulated in Title 22 for supply of recycled water to nonrestricted recreational impoundments, since the public health risks under both scenarios are analogous. The disinfection guidelines are based on sound science and are widely used as guidance to assure public health and beneficial use protection.

Reach 3 of Santa Ana River and Reach 5 of Temescal Creek are not "non-restricted recreational impoundment", nor is "recycled water<sup>12</sup>" being used as a supply source for the River or Creek pursuant to the definitions in Title 22. However, to protect the water contact recreation beneficial use and to prevent nuisance and health risk, it is necessary and appropriate to require the same degree of treatment for wastewater discharges to the River and Creek as would be required for the use of recycled water in a non-restricted recreational impoundment. Thus, this Order specifies requirements based on tertiary or equivalent treatment.

**3. Determining the Need for WQBELs for Priority Pollutants**

In accordance with Section 1.3 of the SIP, the Regional Water Board conducted a reasonable potential analysis (RPA) for each priority pollutant with an applicable criterion or objective to determine if a WQBEL is required in the Order. The Regional Water Board analyzed effluent data submitted by the Discharger for the past several years to determine if a pollutant has the reasonable potential to cause or contribute to an excursion above a state water quality standard. For all

<sup>12</sup>

*As defined in the Reclamation Criteria, recycled water means water which, as a result of treatment of domestic wastewater, is suitable for a direct beneficial use or a controlled use that would not otherwise occur.*

parameters that have the reasonable potential to cause or contribute to an excursion above a water quality standard, numeric WQBELs are required. The RPA considered criteria from the CTR, and when applicable, water quality objectives specified in the Basin Plan.

Sufficient data are needed to conduct a complete RPA. If data are not sufficient, the Discharger will be required to gather the appropriate data for the Regional Water Board to conduct the RPA. Upon review of the data, and if the Regional Water Board determines that WQBELs are needed to protect the beneficial uses, the permit will be reopened for appropriate modification.

A RPA was conducted on effluent data supplied by the Discharger from January 2010 through February 2013 (there has been no discharge to Temescal Creek since March 2013) and found that dichlorobromomethane has a reasonable potential to exceed the human health criterion of the CTR. The RPA for both mercury and free cyanide were inconclusive as the detection limits used in determining the effluent concentration were higher than the average monthly effluent limitations of 0.051 µg/L and 4.7 µg/L, respectively that were specified in the previous waste discharge requirements, Order No. R8-2009-0014. Since permit compliance cannot be ascertained at this time, the effluent limits for mercury and free cyanide remain in this Order. Although selenium was regulated in the previous Order, the RPA found that selenium no longer presents a reasonable potential to cause an excursion above any applicable priority pollutant criteria or objective. Therefore, this Order does not include an effluent limitation for selenium.

Although the RPA demonstrates that copper and lead do not pose a reasonable potential to cause or create an exceedance of water quality standards, this Order still includes effluent limits for copper and lead, because the Santa Ana River Reach 3 is listed on the CWA 303(d) List as being impaired for these constituents.

Tables 8 and 9 summarize the monitoring data used in the RPA for the above-mentioned pollutants.

**Table 8. EMWD's Temescal Creek Discharge Monitoring Data Summary, µg/L**

Date	Se (monthly maximum value)	Cu (monthly maximum value)	Pb (monthly maximum value)	Hg (monthly maximum value)		Hardness, (monthly minimum value) mg/L
				Reported Value	Detection Level	
Jan 2010	1.1	4.7	ND	ND	0.2	220
Feb 2010	1.0	3.6	ND	ND	0.0917	250
Mar 2010	ND	3.9	ND	ND	0.2	280
Jan 2011	1.3	6.4	0.22	ND	0.0537	210
Feb 2011	1.3	5.2	0.13	ND	0.0537	210
Mar 2011	0.97	3.8	0.083	ND	0.0537	230
Apr 2011	1.3	2.8	ND	ND	0.0537	210
Dec 2011	0.78	4.1	0.097	ND	0.0537	160
Feb 2012	ND	4.0	ND	ND	0.08	210
Jan 2013	1.1	7.9	0.15	ND	0.12	180
Feb 2013	ND	5.6	0.11	ND	0.12	190

**Table 9. EMWD's Temescal Creek Discharge Monitoring Data Summary, µg/L**

Date	Dichlorobromomethane (monthly maximum value)	Free Cyanide (monthly maximum value)	
		Reported Value	Detection Level
Jan 2010	26	ND	5
Feb 2010	32	ND	5
Mar 2010	23	ND	5
Jan 2011	20	ND	2.7
Feb 2011	20	ND	2.7
Mar 2011	23	ND	2.7
Apr 2011	37	ND	2.7
Dec 2011	16	ND	2.7
Feb 2012	25	ND	2.7
Jan 2013	39	ND	5
Feb 2013	52	8*	5

\* The February 2013 effluent data provided by the Discharger shows a concentration of 8 µg/L being detected for free cyanide, which exceeds the average monthly effluent limitation of 4.7 µg/L specified in the previous Order. However, the Discharger indicates that the Batch Quality Control for Cyanide was J-flagged because the duplicate exceeded the Relative Percent Difference (RPD) limit. It was noted that the exceedance might be due to the sample being held for an extended period of time before analysis. There was no other effluent data available as the lab results were received after the discharge had already stopped. Since the data point may not be representative of the concentration of free cyanide in the effluent, it is not being used to evaluate the RPA in Table 10, below. Nonetheless, as shown in Table 9, above, some of the detection limits used in determining the concentration of free cyanide was higher than the effluent limit in the previous Order. Since permit compliance for free cyanide cannot be ascertained at this time, the effluent limits for the constituents remain in this Order.

Tables 10: Summary of the RPA evaluation for the above-mentioned pollutants using monitoring data submitted by the Discharger.

**Table 10. RPA Evaluation**

Parameter	Unit	Effluent	CTR			Is Effluent Limit Required?		
		MEC <sup>13</sup>	CMC <sup>14</sup>	CCC <sup>15</sup>	Human Health for consumption of organisms	CMC	CCC	Human Health
Selenium (Se)	µg/L	1.3		5			No	
Copper (Cu)	µg/L	7.9	20.9	13.4		Yes*	Yes*	
Lead (Pb)	µg/L	0.22	107	4.2		Yes*	Yes*	
Mercury (Hg)	µg/L	ND			0.051			Yes**
Dichlorobromomethane	µg/L	52			46			Yes
Free Cyanide	µg/L	ND	22	5.2		No	Yes**	

Note: Minimum value of hardness in the effluent was 160 mg/L based on the monitoring data collected in the past five years.

\* Effluent limits for copper and lead are included in this Order because the Santa Ana River Reach 3 is listed on the CWA 303(d) List as being impaired for these constituents.

\*\* Effluent limits for mercury and free cyanide remain in this Order because the detection limits used to determine the concentration was too high to ascertain permit compliance.

#### 4. WQBEL Calculations

For priority pollutants, water quality based effluent limits are based on monitoring results and the calculation processes outlined in Section 1.4 of the California Toxic Rule and the Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays and Estuaries of California and are summarized in Table 11. The criteria calculation is based on CTR criteria for freshwater.

**Table 11. Criteria calculation based on California Toxics Rule for freshwater discharges**

CTR Values							Aquatic Life Limits		Human Health Limits		Permit Limits	
Constituents	Freshwater		Human Health Organisms Only	Multipliers from SIP Tables 1 and 2			Cu-1.93 Pb-2.81 CN-3.11	Cu-1.27 Pb-1.48 CN-1.55	Hg-2.01 DCBM-1.62			
	CMC	CCC		Cu-0.518 Pb-0.356 CN-0.321	Cu-0.707 Pb-0.564 CN-0.527	Lowest LTA						
Copper (Cu)	20.9	13.4		10.8	9.5	9.5	18.3	12.1			18.3	12.1
Lead (Pb)	107	4.2		38.1	2.4	2.4	6.7	3.6			6.7	3.6
Mercury (Hg)			0.051						0.103	0.051	0.103	0.051

<sup>13</sup> MEC = observed maximum pollutant concentration for the effluent.

<sup>14</sup> CMC = Criteria Maximum Concentration.

<sup>15</sup> CCC = Criteria Continuous Concentration.

Dichlorobromo methane (DCBM)			46						75	46	75	46
Free Cyanide (CN)	22	5.2		7.1	2.7	2.7	8.4	4.2			8.4	4.2

Copper CV = 0.31, Lead CV = 0.53, Mercury CV = 0.6\*, Dichlorobromomethane CV = 0.37, Free Cyanide CV = 0.6\*

\* A default CV of 0.6 is used for calculating the permit limits for mercury and free cyanide since at least 80% of the effluent data are reported as non-detect.

## 5. Whole Effluent Toxicity (WET)

This Order does not specify WET limits but requires chronic toxicity monitoring. This Order, as in the previous Order, also requires the Discharger to conduct the accelerated monitoring as specified in Attachment E when the result of any single chronic toxicity test of the effluent exceeds 1.0 TUc. The monitoring data during the months when discharge occurs (Jan 2010 to Feb 2013) indicated that the monthly trigger of 1.0 TUc has not been exceeded.

### D. Best Professional Judgment-Based Effluent Specifications for DP-001

For tertiary treated wastewater, the BOD<sub>5</sub> and TSS concentration limits are based on Best Professional Judgment. The technology-based secondary treatment standards specify BOD<sub>5</sub> and TSS concentration limits that are less stringent.

**Table 12. Tertiary Effluent BOD<sub>5</sub> and TSS Limits**

Constituent	Average Weekly	Average Monthly
Biochemical Oxygen Demand	30 mg/L	20 mg/L
Suspended Solids	30 mg/L	20 mg/L

### E. Summary of Final Effluent Limitations for DP-001

#### 1. Satisfaction of Anti-Backsliding Requirements

With the exception of free cyanide, all effluent limitations in this Order are at least as stringent as the effluent limitations in the previous Order. The SIP specifies that the CV shall be set equal to 0.6 if (a) the number of effluent data points is less than ten, or (b) at least 80% of the data are reported as non-detect. Since at least 80% of the effluent monitoring data for free cyanide are reported as non-detect, a CV value of 0.6 is used to calculate the permit limits for these constituents. Table 13, below, shows a summary of the final effluent limitations in this Order. As shown in Table 13, while the maximum daily limit for free cyanide is less stringent than in the prior Order, the average monthly limit in this Order is more stringent than that in the prior Order.

## 2. Satisfaction of Antidegradation Policy

Discharges are expected to be limited in duration and frequency and, if conducted in conformance with the requirements of this Order, will not result in a lowering of water quality. The discharges therefore conform to antidegradation requirements specified in Resolution No. 68-16, which incorporates the federal antidegradation policy at 40 CFR 131.12.

## 3. Stringency of Requirements for Individual Pollutants

Water quality-based effluent limitations have been scientifically derived to implement water quality objectives that protect beneficial uses. Both the beneficial uses and the water quality objectives have been approved pursuant to federal law and are the applicable federal water quality standards. To the extent that toxic pollutant water quality-based effluent limitations were derived from the CTR, the CTR is the applicable standard pursuant to 40 CFR 131.38. The scientific procedures for calculating the individual water quality-based effluent limitations for priority pollutants are based on the CTR-SIP, which was approved by USEPA on May 18, 2000. Apart from certain surface water standards changes resulting from the N/TDS Basin Plan amendment that do not materially affect the quality requirements for the discharges regulated by this Order, all beneficial uses and water quality objectives contained in the Basin Plan were approved under state law and submitted to and approved by USEPA prior to May 30, 2000. Any water quality objectives and beneficial uses submitted to USEPA prior to May 30, 2000, but not approved by USEPA before that date, are nonetheless "applicable water quality standards for purposes of the CWA" pursuant to 40 CFR 131.21(c)(1). Collectively, this Order's restrictions on individual pollutants are no more stringent than required to implement the requirements of the CWA.

## 4. Summary of Final Effluent Limitations for DP-001

**Table 13. Summary of Water Quality-Based Effluent Limits at DP-001**

Parameter	Units	Effluent Limitations					Basis
		Average Monthly	Average Weekly	Max Daily	Instantaneous Maximum	Range	
BOD <sub>5</sub>	mg/L	20	30	--	--	--	PO, BPJ
Total Suspended Solids	mg/L	20	30	--	--	--	PO, BPJ
Ammonia Nitrogen	mg/L	4.5					PO, BP
Total Dissolved Solids	mg/L	650 (12-month average)					PO, BP

**Table 13. Summary of Water Quality-Based Effluent Limits at DP-001**

Parameter	Units	Effluent Limitations					Basis
		Average Monthly	Average Weekly	Max Daily	Instantaneous Maximum	Range	
Total Residual Chlorine	mg/L				0.1		PO, BP
pH	Std. unit	--	--	--		6.5 - 8.5	PO, BP
Coliform	MPN	--	2.2 Median of last 7 days	--	--	--	Title 22
Total Recoverable Copper	µg/L	12.1		18.3			CTR, SIP
Total Recoverable Lead	µg/L	3.6		6.7			CTR, SIP
Total Recoverable Mercury	µg/L	0.051		0.103			CTR, SIP
Dichlorobromomethane	µg/L	46		75			CTR, SIP
Free Cyanide	µg/L	4.2		8.4			CTR, SIP

PO = Previous Order, R8-2009-0014; BPJ = Best Professional Judgment; BP = Basin Plan; CTR = California Toxics Rule; SIP = State Implementation Policy

**F. Land Discharge Specifications – Not Applicable**

Land discharge specifications are regulated under Order R8-2008-0008.

**G. Reclamation Specifications – Not Applicable**

Recycled water reuse is regulated under Order R8-2008-0008.

**H. Stormwater Discharge Requirements**

On April 1, 2014, the State Board adopted a new General Permit for Storm Water Discharges Associated with Industrial Activities, Order No. 2014-0057-DWQ, NPDES No. CAS000001, (General Permit) which became effective on July 1, 2015. Industrial facilities, including POTW sites, are required to obtain NPDES Permits for storm water discharges. Accordingly, Attachments J and K of this Order have been updated to incorporate requirements for the discharge of storm water from the Facility in accordance with the new Industrial General Permit. This Order requires the Discharger to comply with the terms and conditions of the General Permit, except that there is no need to file Permit Registration Documents or submit a fee for coverage under the General Permit.

## **V. RATIONALE FOR RECEIVING WATER LIMITATIONS**

### **A. Surface Water**

The surface water receiving water limitations in this Order are based on the water quality objectives contained in the Basin Plan.

### **B. Groundwater**

Not applicable at this time. However, this Order may be reopened if it is found that the effluent limitations are not protective of underlying groundwater.

## **VI. RATIONALE FOR MONITORING AND REPORTING REQUIREMENTS**

Sections 13267 and 13383 of the CWC authorize the Regional Water Boards to require technical and monitoring reports. 40 CFR 122.48 also requires all NPDES permits to specify recording and reporting of monitoring results. The Monitoring and Reporting Program (MRP), Attachment E of this Order, establishes monitoring and reporting requirements to implement federal and State requirements. The following provides the rationale for the monitoring and reporting requirements contained in the MRP for this Facility.

### **A. Influent Monitoring**

Current Order R8-2009-0014 does not contain influent monitoring requirements, as influent quality to the RWRFs is already being required to be monitored and reported under the waste discharge and producer/user reclamation requirement Order No. R8-2008-0008 for the EMWD RWRFs and Order No. R9-94-92 with Addendums No. 1, 2, and 3 for the RCWD SRWRF.

### **B. Effluent Monitoring**

The Discharger is required to conduct monitoring of the permitted discharges in order to evaluate compliance with permit conditions. Pollutants to be monitored include all pollutants for which effluent limitations are specified. Further, in accordance with Section 1.3 of the SIP, periodic monitoring is required for all priority pollutants defined by the CTR, for which criteria apply and for which no effluent limitations have been established, to evaluate reasonable potential to cause or contribute to an excursion above a water quality standard. This Order also requires the Discharger to conduct accelerated monitoring for those constituents that are detected in the annual priority pollutant scan.

### **C. Whole Effluent Toxicity Testing Requirements**

Whole effluent toxicity (WET) test could be an indicator for potential adverse effects on the receiving water quality from the aggregate toxic effect of a mixture of pollutants in

the effluent. WET tests measure the degree of response of exposed aquatic test organisms to an effluent. The WET test implements the narrative "no toxics in toxic amounts" criterion contained in the Basin Plan. There are two types of WET tests: acute and chronic. An acute toxicity test is conducted over a shorter time period and measures mortality. A chronic toxicity test is conducted over a longer period of time and may measure mortality, reproduction, and growth.

The Basin Plan specifies a narrative objective for toxicity, requiring that all waters be maintained free of toxic substances in concentrations that are lethal to or produce other detrimental response on aquatic organisms. Detrimental response includes but is not limited to decreased growth rate, decreased reproductive success of resident or indicator species, and/or significant alterations in population, community ecology, or receiving water biota.

In addition to the Basin Plan requirements, Section 4 of the SIP states that a chronic toxicity effluent limitation is required in permits for all discharges that will cause, have the reasonable potential to cause, or contribute to chronic toxicity in receiving waters. Therefore, in accordance with the SIP, this Order requires the Discharger to conduct chronic toxicity testing. In addition, the Order establishes thresholds that when exceeded requires the Discharger to conduct accelerated toxicity testing and/or conduct toxicity identification evaluation (TIE) studies.

This Order requires the Discharger to conduct chronic toxicity testing of the effluent on a monthly basis for discharges to Temescal Creek. The Order also requires the Discharger to conduct an Initial Investigation Toxicity Reduction Evaluation (IITRE) program when either the two-month median of toxicity test results exceeds 1 TUc or any single test exceeds 1.7 TUc for survival endpoint. Based on the results of this investigation program and at the discretion of the Executive Officer, a more rigorous Toxicity Reduction Evaluation/Toxicity Identification Evaluation (TRE/TIE) may be required. A re-opener provision is included in the Order to incorporate a chronic toxicity effluent limitation if warranted by the toxicity test results.

#### **D. Receiving Water Monitoring**

##### **1. Surface Water**

Receiving water monitoring is required to determine compliance with receiving water limitations and to characterize the water quality of the receiving water. Requirements are based on the Basin Plan.

##### **2. Groundwater - Not Applicable**

#### **E. Other Monitoring Requirements**

##### **1. Water Supply Monitoring – Not Applicable**

Water supply monitoring requirements are specified in Order No. R8-2008-0008.

## **2. Biosolids Monitoring**

Biosolids monitoring requirements are specified in Order No. R8-2008-0008.

## **3. Pretreatment Monitoring – Not Applicable**

Pretreatment monitoring and reporting requirements are specified in Order No. R8-2008-0008 (for facilities located in the Santa Ana Region), Order No. R9-2000-165 (for Temecula Valley RWRf), and Order No. R9-94-92 (for Santa Rosa Water Reclamation Facility).

# **VII. RATIONALE FOR PROVISIONS**

## **A. Standard Provisions**

Standard Provisions, which apply to all NPDES permits in accordance with 40 CFR 122.41, and additional conditions applicable to specified categories of permits in accordance with 40 CFR 122.42, are provided in Attachment D. The Discharger must comply with all standard provisions and with those additional conditions that are applicable under 40 CFR 122.42.

40 CFR 122.41(a)(1) and (b) through (n) establish conditions that apply to all State-issued NPDES permits. These conditions must be incorporated into the permits either expressly or by reference. If incorporated by reference, a specific citation to the regulations must be included in the Order. 40 CFR 123.25(a)(12) allows the state to omit or modify conditions to impose more stringent requirements. In accordance with 40 CFR 123.25, this Order omits federal conditions that address enforcement authority specified in 40 CFR 122.41(j)(5) and (k)(2) because the enforcement authority under the Water Code is more stringent. In lieu of these conditions, this Order incorporates by reference Water Code section 13387(e).

## **B. Special Provisions**

### **1. Reopener Provisions**

The provisions are based on 40 CFR 122.44(c) and 123. The Regional Water Board may reopen the permit to modify permit conditions and requirements. Causes for modifications include the promulgation of new regulations, modification in sludge use or disposal practices, or adoption of new regulations by the State Water Board or Regional Water Board, including revisions to the Basin Plan.

### **2. Special Studies and Additional Monitoring Requirements**

This Order requires the Discharger to notify the Executive Officer of the its continued involvement with the comprehensive mercury investigation program currently being conducted by the Santa Ana River Dischargers Association (SARDA). If the

Discharger discontinues its involvement with this comprehensive program, the Discharger is required, within 60 days of that date, to submit for the approval of the Executive Officer its plan for the annual testing of mercury levels in fish flesh samples collected from the Santa Ana River, upstream of, at, and downstream of the point of discharge. Upon approval, the Discharger is required to implement the plan.

This Order also requires the Discharger to develop procedures to conduct Toxicity Identification and Reduction Evaluations. This provision is based on the SIP, Section 4, Toxicity Control Provisions.

### **3. Best Management Practices and Pollution Prevention**

The requirements are based on the Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California, Section 2.4.5.1.

### **4. Construction, Operation, and Maintenance Specifications – Not Applicable**

Construction, Operation, and Maintenance Specifications are already included in Order No. R8-2008-0008.

### **5. Special Provisions for Municipal Facilities, POTWs Only – Not Applicable**

This Section is already included in Order No. R8-2008-0008.

### **6. Other Special Provisions – Not Applicable**

### **7. Compliance Schedules – Not Applicable**

## **VI. PUBLIC PARTICIPATION**

The California Regional Water Board, Santa Ana Region is considering the issuance of waste discharge requirements (WDRs) that will serve as National Pollutant Discharge Elimination System (NPDES) permit for Eastern Municipal Water District's Temescal Creek Discharge. As a step in the WDR adoption process, the Regional Water Board staff has developed tentative WDRs. The Regional Water Board encourages public participation in the WDR adoption process.

### **A. Notification of Interested Parties**

The Regional Water Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for the discharges and has provided them with an opportunity to submit their written comments and recommendations. Notification was provided through the posting of Notice of Public Hearing in the area of the discharge, in the local newspaper, and at the Regional Water Board website.

## **B. Written Comments**

The staff determinations are tentative. Interested persons are invited to submit written comments concerning these tentative WDRs. Comments must be submitted either in person or by mail to the Executive Office at the Regional Water Board at the address above on the cover page of this Order.

To be fully responded to by staff and considered by the Regional Water Board, written comments should be received at the Regional Water Board offices by 5:00 p.m. on August 21, 2015.

California Regional Water Quality Control Board  
Santa Ana Region  
3737 Main Street, Suite 500  
Riverside, CA 92501-3348  
(Attention: Kathleen Fong)

## **C. Public Hearing**

The Regional Water Board will hold a public hearing on the tentative WDRs during its regular Board meeting on the following date and time and at the following location:

Date: September 18, 2015  
Time: 9:00 A.M.  
Location: Irvine Ranch Water District  
15600 Sand Canyon Ave.  
Irvine, CA 92618

Interested persons are invited to attend. At the public hearing, the Regional Water Board will hear testimony, if any, pertinent to the discharge and this Order. Oral testimony will be heard; however, for accuracy of the record, important testimony should be in writing.

Please be aware that dates and venues may change. Our web address <http://www.waterboards.ca.gov/santaana> where you can access the current agenda for changes in dates and locations.

## **D. Waste Discharge Requirements Petitions**

Any aggrieved person may petition the State Water Board to review the decision of the Regional Water Board regarding the final WDRs. The petition must be submitted within 30 days of the Regional Water Board's action to the following address:

State Water Resources Control Board  
Office of Chief Counsel  
P.O. Box 100, 1001 I Street  
Sacramento, CA 95812-0100

### **E. Information and Copying**

Documents related to this Order, including comments received, are on file and may be inspected at the Regional Water Board's office at any time between 9:00 a.m. and 3:00 p.m., Monday through Friday. Copying of documents may be arranged through the Regional Water Board by calling (951) 782-4130.

### **F. Register of Interested Persons**

Any person interested in being placed on the mailing list for information regarding this Order should contact Kathleen Fong at the Regional Water Board, reference this order, and provide a name, address, and phone number.

### **G. Additional Information**

Requests for additional information or questions regarding this Order should be directed to Kathleen Fong at (951) 774-0114 or at [kathleen.fong@waterboards.ca.gov](mailto:kathleen.fong@waterboards.ca.gov).

**ATTACHMENT G - EPA PRIORITY POLLUTANT LIST**

EPA PRIORITY POLLUTANT LIST		
Metals	Acid Extractibles	Base/Neutral Extractibles (continuation)
1. Antimony	45. 2-Chlorophenol	91. Hexachloroethane
2. Arsenic	46. 2,4-Dichlorophenol	92. Indeno (1,2,3-cd) Pyrene
3. Beryllium	47. 2,4-Dimethylphenol	93. Isophorone
4. Cadmium	48. 2-Methyl-4,6-Dinitrophenol	94. Naphthalene
5a. Chromium (III)	49. 2,4-Dinitrophenol	95. Nitrobenzene
5b. Chromium (VI)	50. 2-Nitrophenol	96. N-Nitrosodimethylamine
6. Copper	51. 4-Nitrophenol	97. N-Nitrosodi-N-Propylamine
7. Lead	52. 3-Methyl-4-Chlorophenol	98. N-Nitrosodiphenylamine
8. Mercury	53. Pentachlorophenol	99. Phenanthrene
9. Nickel	54. Phenol	100. Pyrene
10. Selenium	55. 2, 4, 6 – Trichlorophenol	101. 1,2,4-Trichlorobenzene
11. Silver	<b>Base/Neutral Extractibles</b>	<b>Pesticides</b>
12. Thallium	56. Acenaphthene	102. Aldrin
13. Zinc	57. Acenaphthylene	103. Alpha BHC
<b>Miscellaneous</b>	58. Anthracene	104. Beta BHC
14. Cyanide, Free	59. Benzidine	105. Delta BHC
15. Asbestos (not required unless requested)	60. Benzo (a) Anthracene	106. Gamma BHC
16. 2,3,7,8-Tetrachlorodibenzo-P-Dioxin (TCDD)	61. Benzo (a) Pyrene	107. Chlordane
<b>Volatile Organics</b>	62. Benzo (b) Fluoranthene	108. 4, 4' - DDT
17. Acrolein	63. Benzo (g,h,i) Perylene	109. 4, 4' - DDE
18. Acrylonitrile	64. Benzo (k) Fluoranthene	110. 4, 4' - DDD
19. Benzene	65. Bis (2-Chloroethoxy) Methane	111. Dieldrin
20. Bromoform	66. Bis (2-Chloroethyl) Ether	112. Alpha Endosulfan
21. Carbon Tetrachloride	67. Bis (2-Chloroisopropyl) Ether	113. Beta Endosulfan
22. Chlorobenzene	68. Bis (2-Ethylhexyl) Phthalate	114. Endosulfan Sulfate
23. Chlorodibromomethane	69. 4-Bromophenyl Phenyl Ether	115. Endrin
24. Chloroethane	70. Butylbenzyl Phthalate	116. Endrin Aldehyde
25. 2-Chloroethyl Vinyl Ether	71. 2-Chloronaphthalene	117. Heptachlor
26. Chloroform	72. 4-Chlorophenyl Phenyl Ether	118. Heptachlor Epoxide
27. Dichlorobromomethane	73. Chrysene	119. PCB 1016
28. 1,1-Dichloroethane	74. Dibenzo (a,h) Anthracene	120. PCB 1221
29. 1,2-Dichloroethane	75. 1,2-Dichlorobenzene	121. PCB 1232
30. 1,1-Dichloroethylene	76. 1,3-Dichlorobenzene	122. PCB 1242
31. 1,2-Dichloropropane	77. 1,4-Dichlorobenzene	123. PCB 1248
32. 1,3-Dichloropropylene	78. 3,3'-Dichlorobenzidine	124. PCB 1254
33. Ethylbenzene	79. Diethyl Phthalate	125. PCB 1260
34. Methyl Bromide	80. Dimethyl Phthalate	126. Toxaphene
35. Methyl Chloride	81. Di-n-Butyl Phthalate	
36. Methylene Chloride	82. 2,4-Dinitrotoluene	
37. 1,1,2,2-Tetrachloroethane	83. 2,6-Dinitrotoluene	
38. Tetrachloroethylene	84. Di-n-Octyl Phthalate	
39. Toluene	85. 1,2-Diphenylhydrazine	
40. 1,2-Trans-Dichloroethylene	86. Fluoranthene	
41. 1,1,1-Trichloroethane	87. Fluorene	
42. 1,1,2-Trichloroethane	88. Hexachlorobenzene	
43. Trichloroethylene	89. Hexachlorobutadiene	
44. Vinyl Chloride	90. Hexachlorocyclopentadiene	

**ATTACHMENT H – MINIMUM LEVELS**

**MINIMUM LEVELS IN PPB (µg/l)**

<b>Table 1- VOLATILE SUBSTANCES<sup>1</sup></b>	<b>GC</b>	<b>GCMS</b>
Acrolein	2.0	5
Acrylonitrile	2.0	2
Benzene	0.5	2
Bromoform	0.5	2
Carbon Tetrachloride	0.5	2
Chlorobenzene	0.5	2
Chlorodibromomethane	0.5	2
Chloroethane	0.5	2
Chloroform	0.5	2
Dichlorobromomethane	0.5	2
1,1 Dichloroethane	0.5	1
1,2 Dichloroethane	0.5	2
1,1 Dichloroethylene	0.5	2
1,2 Dichloropropane	0.5	1
1,3 Dichloropropylene (volatile)	0.5	2
Ethylbenzene	0.5	2
Methyl Bromide ( <i>Bromomethane</i> )	1.0	2
Methyl Chloride ( <i>Chloromethane</i> )	0.5	2
Methylene Chloride ( <i>Dichloromethane</i> )	0.5	2
1,1,1,2 Tetrachloroethane	0.5	1
Tetrachloroethylene	0.5	2
Toluene	0.5	2
trans-1,2 Dichloroethylene	0.5	1
1,1,1 Trichloroethane	0.5	2
1,1,2 Trichloroethane	0.5	2
Trichloroethylene	0.5	2
Vinyl Chloride	0.5	2
1,2 Dichlorobenzene (volatile)	0.5	2
1,3 Dichlorobenzene (volatile)	0.5	2
1,4 Dichlorobenzene (volatile)	0.5	2

**Selection and Use of Appropriate ML Value:**

ML Selection: When there is more than one ML value for a given substance, the discharger may select any one of those ML values, and their associated analytical methods, listed in this Attachment that are below the calculated effluent limitation for compliance determination. If no ML value is below the effluent limitation, then the discharger shall select the lowest ML value, and its associated analytical method, listed in the PQL Table.

ML Usage: The ML value in this Attachment represents the lowest quantifiable concentration in a sample based on the proper application of all method-based analytical procedures and the absence of any matrix interferences. Assuming that all method-specific analytical steps are followed, the ML value will also represent, after the appropriate application of method-specific factors, the lowest standard in the calibration curve for that specific analytical technique. Common analytical practices sometimes require different treatment of the sample relative to calibration standards.

Note: chemical names in parenthesis and italicized is another name for the constituent.

<sup>1</sup> The normal method-specific factor for these substances is 1, therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance.

**MINIMUM LEVELS IN PPB (µg/l)**

<b>Table 2 – Semi-Volatile Substances<sup>2</sup></b>	<b>GC</b>	<b>GCMS</b>	<b>LC</b>
2-Chloroethyl vinyl ether	1	1	
2 Chlorophenol	2	5	
2,4 Dichlorophenol	1	5	
2,4 Dimethylphenol	1	2	
4,6 Dinitro-2-methylphenol	10	5	
2,4 Dinitrophenol	5	5	
2- Nitrophenol		10	
4- Nitrophenol	5	10	
4 Chloro-3-methylphenol	5	1	
2,4,6 Trichlorophenol	10	10	
Acenaphthene	1	1	0.5
Acenaphthylene		10	0.2
Anthracene		10	2
Benzidine		5	
Benzo (a) Anthracene (1,2 Benzanthracene)	10	5	
Benzo(a) pyrene (3,4 Benzopyrene)		10	2
Benzo (b) Fluoranthene (3,4 Benzofluoranthene)		10	10
Benzo(g,h,i)perylene		5	0.1
Benzo(k)fluoranthene		10	2
bis 2-(1-Chloroethoxyl) methane		5	
bis(2-chloroethyl) ether	10	1	
bis(2-Chloroisopropyl) ether	10	2	
bis(2-Ethylhexyl) phthalate	10	5	
4-Bromophenyl phenyl ether	10	5	
Butyl benzyl phthalate	10	10	
2-Chloronaphthalene		10	
4-Chlorophenyl phenyl ether		5	
Chrysene		10	5
Dibenzo(a,h)-anthracene		10	0.1
1,2 Dichlorobenzene (semivolatile)	2	2	
1,3 Dichlorobenzene (semivolatile)	2	1	
1,4 Dichlorobenzene (semivolatile)	2	1	
3,3-Dichlorobenzidine		5	
Diethyl phthalate	10	2	
Dimethyl phthalate	10	2	
di-n-Butyl phthalate		10	
2,4 Dinitrotoluene	10	5	
2,6 Dinitrotoluene		5	
di-n-Octyl phthalate		10	
1,2-Diphenylhydrazine		1	
Fluoranthene	10	1	0.05
Fluorene		10	0.1
Hexachloro-cyclopentadiene	5	5	
1,2,4 Trichlorobenzene	1	5	

**MINIMUM LEVELS IN PPB (µg/l)**

<b>Table 2 - SEMI-VOLATILE SUBSTANCES<sup>2</sup></b>	<b>GC</b>	<b>GCMS</b>	<b>LC</b>	<b>COLOR</b>
Pentachlorophenol	1	5		
Phenol <sup>3</sup>	1	1		50
Hexachlorobenzene	5	1		
Hexachlorobutadiene	5	1		
Hexachloroethane	5	1		
Indeno(1,2,3,cd)-pyrene		10	0.05	
Isophorone	10	1		
Naphthalene	10	1	0.2	
Nitrobenzene	10	1		
N-Nitroso-dimethyl amine	10	5		
N-Nitroso -di n-propyl amine	10	5		
N-Nitroso diphenyl amine	10	1		
Phenanthrene		5	0.05	
Pyrene		10	0.05	

<b>Table 3– INORGANICS<sup>4</sup></b>	<b>FAA</b>	<b>GFAA</b>	<b>ICP</b>	<b>ICPMS</b>	<b>SPGFAA</b>	<b>HYDRIDE</b>	<b>CVAA</b>	<b>COLOR</b>	<b>DCP</b>
Antimony	10	5	50	0.5	5	0.5			1000
Arsenic		2	10	2	2	1		20	1000
Beryllium	20	0.5	2	0.5	1				1000
Cadmium	10	0.5	10	0.25	0.5				1000
Chromium (total)	50	2	10	0.5	1				1000
Chromium VI	5							10	
Copper	25	5	10	0.5	2				1000
Lead	20	5	5	0.5	2				10000
Mercury				0.5			0.2		
Nickel	50	5	20	1	5				1000
Selenium		5	10	2	5	1			1000
Silver	10	1	10	0.25	2				1000
Thallium	10	2	10	1	5				1000
Zinc	20		20	1	10				1000
Cyanide								5	

<sup>2</sup> With the exception of phenol by colorimetric technique, the normal method-specific factor for these substances is 1000, therefore, the lowest standards concentration in the calibration curve is equal to the above ML value for each substance multiplied by 1000.

<sup>3</sup> Phenol by colorimetric technique has a factor of 1.

<sup>4</sup> The normal method-specific factor for these substances is 1, therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance.

MINIMUM LEVELS IN PPB (µg/l)

Table 4- PESTICIDES – PCBs <sup>5</sup>	GC
Aldrin	0.005
alpha-BHC ( <i>a</i> -Hexachloro-cyclohexane)	0.01
beta-BHC ( <i>b</i> -Hexachloro-cyclohexane)	0.005
Gamma-BHC ( <i>Lindane</i> ; <i>g</i> -Hexachloro-cyclohexane)	0.02
Delta-BHC ( <i>d</i> -Hexachloro-cyclohexane)	0.005
Chlordane	0.1
4,4'-DDT	0.01
4,4'-DDE	0.05
4,4'-DDD	0.05
Dieldrin	0.01
Alpha-Endosulfan	0.02
Beta-Endosulfan	0.01
Endosulfan Sulfate	0.05
Endrin	0.01
Endrin Aldehyde	0.01
Heptachlor	0.01
Heptachlor Epoxide	0.01
PCB 1016	0.5
PCB 1221	0.5
PCB 1232	0.5
PCB 1242	0.5
PCB 1248	0.5
PCB 1254	0.5
PCB 1260	0.5
Toxaphene	0.5

Techniques:

- GC - Gas Chromatography
- GCMS - Gas Chromatography/Mass Spectrometry
- HRGCMS - High Resolution Gas Chromatography/Mass Spectrometry (i.e., EPA 1613, 1624, or 1625)
- LC - High Pressure Liquid Chromatography
- FAA - Flame Atomic Absorption
- GFAA - Graphite Furnace Atomic Absorption
- HYDRIDE - Gaseous Hydride Atomic Absorption
- CVAA - Cold Vapor Atomic Absorption
- ICP - Inductively Coupled Plasma
- ICPMS - Inductively Coupled Plasma/Mass Spectrometry
- SPGFAA - Stabilized Platform Graphite Furnace Atomic Absorption (i.e., EPA 200.9)
- DCP - Direct Current Plasma
- COLOR - Colorimetric

<sup>5</sup> The normal method-specific factor for these substances is 100, therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance multiplied by 100.

**ATTACHMENT I – TRIGGERS FOR MONITORING PRIORITY POLLUTANTS**

	CONSTITUENT	µg/L
1	<b>Antimony</b>	<b>6</b>
2	<b>Arsenic</b>	<b>50</b>
3	<b>Beryllium</b>	<b>4</b>
4	Cadmium	5.3
5a	Chromium III	176
5b	Chromium VI	5.5
6	Copper	21
7	Lead	22
8	Mercury	0.026
9	Nickel	45
10	Selenium	2.5
11	Silver	6.2
12	<b>Thallium</b>	<b>2</b>
13	Zinc	104
14	Cyanide	2.6
15	Asbestos	--
16	2,3,7,8-TCDD (Dioxin)	0.000000007
17	Acrolein	390
18	Acrylonitrile	0.33
19	<b>Benzene</b>	<b>1</b>
20	Bromoform	180
21	<b>Carbon Tetrachloride</b>	<b>0.5</b>
22	Chlorobenzene	10500
23	Chlorodibromomethane	17
24	Chloroethane	--
25	2-Chloroethyl vinyl ether	--
26	Chloroform	--
27	Dichlorobromomethane	23
28	<b>1,1-Dichloroethane</b>	<b>5</b>
29	<b>1,2-Dichloroethane</b>	<b>0.5</b>
30	1,1-Dichloroethylene	1.6
31	<b>1,2-Dichloropropane</b>	<b>5</b>
32	<b>1,3-Dichloropropylene</b>	<b>0.5</b>
33	<b>Ethylbenzene</b>	<b>300</b>
34	Methyl Bromide	2000
35	Methyl Chloride	--
36	Methylene Chloride	800
37	<b>1,1,2,2-Tetrachloroethane</b>	<b>1</b>

	CONSTITUENT	µg/L
38	Tetrachloroethylene	4.43
39	<b>Toluene</b>	<b>150</b>
40	<b>1,2,-Trans-dichloroethylene</b>	<b>10</b>
41	<b>1,1,1-Trichloroethane</b>	<b>200</b>
42	<b>1,1,2-Trichloroethane</b>	<b>5</b>
43	<b>Trichloroethylene</b>	<b>5</b>
44	<b>Vinyl Chloride</b>	<b>0.5</b>
45	2-Chlorophenol	200
46	2,4-Dichlorophenol	395
47	2,4-Dimethylphenol	1150
48	2-Methy-4,6-Dinitrophenol	383
49	2,4-Dinitrophenol	7000
50	2-Nitrophenol	--
51	4-Nitrophenol	--
52	3-Methyl-4-Chlorophenol	--
53	<b>Pentachlorophenol</b>	<b>1</b>
54	Phenol	2,300,000
55	2,4,6-Trichlorophenol	3.3
56	Acenaphthene	1,350
57	Acenaphthylene	--
58	Anthracene	55,000
59	Benzidine	0.00027
60	Benzo (a) anthracene	0.025
61	Benzo (a) pyrene	0.025
62	Benzo (b) fluoranthene	0.025
63	Benzo (g,h,i) pyrene	--
64	Benzo (k) fluorantene	0.025
65	Bis (2-Chloroethoxy) methane	--
66	Bis (2-Chloroethyl) ether	0.7
67	Bis (2-Chloroisopropyl) ether	85,000
68	Bis (2-ethyhexyl) phthalate	3.0
69	4-Bromophenyl phenyl ether	--
70	Butyl benzyl phthalate	2600
71	2- Chloronaphthalene	2150
72	4-Chlorophenyl phenyl ether	--
73	Chrysene	0.025
74	Dibenzo (a,h) anthracene	0.025
75	<b>1,2-Dichlorobenzene</b>	<b>600</b>

See notes below for italicized constituents.

**ATTACHMENT I. -Continued**

	CONSTITUENT	µg/L
76	1,3-Dichlorobenzene	1,300
<b>77</b>	<b><i>1,4-Dichlorobenzene</i></b>	<b><i>5</i></b>
78	3,3-Dichlorobenzidine	0.039
79	Diethyl phthalate	60,000
80	Dimethyl phthalate	1,450,000
81	Di-N-butyl phthalate	6,000
82	2,4-Dinitrotoluene	4.6
83	2,6-Dinitrotoluene	--
84	Di-N-octyl phthalate	--
85	1,2-Diphenylhydrazine	0.27
86	Fluoranthene	185
87	Fluorene	7,000
88	Hexachlorobenzene	0.00039
89	Hexachlorobutadiene	25
<b>90</b>	<b><i>Hexachlorocyclopentadiene</i></b>	<b><i>50</i></b>
91	Hexachloroethane	4.5
92	Indeno (1,2,3-cd) pyrene	0.025
93	Isophorone	300
<b>94</b>	<b><i>Naphthalene</i></b>	<b><i><u>17</u></i></b>
95	Nitrobenzene	950
96	<b><i>N-Nitrosodimethylamine</i></b>	<b><i><u>0.01</u></i></b>
97	<b><i>N-Nitrosodi-N-propylamine</i></b>	<b><i><u>0.01</u></i></b>
98	N-Nitrosodiphenylamine	8
99	Phenantrene	--

	CONSTITUENT	µg/L
100	Pyrene	5,500
<b>101</b>	<b><i>1,2,4 -Trichlorobenzene</i></b>	<b><i>5</i></b>
102	Aldrin	0.00007
103	BHC Alpha	0.0065
104	BHC Beta	0.023
105	BHC Gamma	0.032
106	BHC Delta	--
107	Chlordane	0.0003
108	4,4-DDT	0.0003
109	4,4-DDE	0.0003
110	4,4-DDD	0.00042
111	Dieldrin	0.00007
112	Endosulfan Alpha	0.028
113	Endosulfan Beta	0.028
114	Endosulfan Sulfate	120
115	Endrin	0.018
116	Endrin Aldehyde	0.42
117	Heptachlor	0.00011
118	Heptachlor Epoxide	0.000055
119	PCB 1016	0.000085
120	PCB 1221	0.000085
125	PCB 1260	0.000085
126	Toxaphene	0.0001
127	<b><i>Perchlorate</i></b>	<b><i>4</i></b>

Notes:

1. For constituents not shown italicized, the values shown in the Table are fifty percent of the most stringent applicable receiving water objectives (freshwater or human health (consumption of water and organisms) as specified for that pollutant in 40 CFR 131.38<sup>1</sup>).
2. For constituents shown bold and italicized, the values shown in the Table are based on the California Department of Public Health maximum contaminant levels (MCLs) or Notification Level. Notification Level based trigger is underlined.
3. For hardness dependent metals, the hardness value used is 191 mg/L as 5<sup>th</sup> percentile of effluent flows and for pentachlorophenol, the pH value used is 7.5 standard units.

<sup>1</sup> See Federal Register/ Vol. 65, No. 97 / Thursday, May 18, 2000 / Rules and Regulations.

## **ATTACHMENT J – STORM WATER POLLUTION PREVENTION PLAN (SWPPP)**

### **A. SWPPP Elements**

The Discharger shall update its site-specific SWPPP for the Facility by January 1, 2016. The updated SWPPP shall contain the following elements, as described further in this Section:

1. Facility Name and Contact Information;
2. Site Map;
3. List of Industrial Materials;
4. Description of Potential Pollution Sources;
5. Assessment of Potential Pollutant Sources;
6. Minimum BMPs;
7. Advanced BMPs, if applicable;
8. Monitoring Implementation Plan;
9. Annual Comprehensive Facility Compliance Evaluation (Annual Evaluation); and,
10. Date that SWPPP was Initially Prepared and the Date of Each SWPPP Amendment, if Applicable.

### **B. SWPPP Implementation and Revisions**

The Discharger shall implement the updated SWPPP for the Facility on January 1, 2016.<sup>1</sup> The Discharger shall also revise the SWPPP whenever necessary.

### **C. SWPPP Performance Standards**

1. The Discharger shall ensure a SWPPP is prepared to:
  - a. Identify and evaluate all sources of pollutants that may affect the quality of industrial storm water discharges and authorized non-storm water discharges (NSWDs);
  - b. Identify and describe the minimum BMPs (see Section H.1. below) and any advanced BMPs (see Section H.2. below) implemented to reduce or prevent pollutants in industrial storm water discharges and authorized NSWDs. BMPs shall be selected to achieve compliance with Section IV.D. of this Order; and,

<sup>1</sup> During the interim, the Discharger shall continue implementing its current SWPPP.

- c. Identify and describe conditions or circumstances which may require future revisions to be made to the SWPPP.
2. The Discharger shall prepare a SWPPP in accordance with all applicable SWPPP requirements of this Attachment. A copy of the SWPPP shall be maintained at the Facility.

#### **D. Planning and Organization**

##### **1. Pollution Prevention Team**

The Discharger must have a Pollution Prevention Team established and responsible for assisting with the implementation of the requirements in this Attachment. The Discharger shall include in the SWPPP detailed information about its Pollution Prevention Team including:

- a. The positions within the facility organization (collectively, team members) who assist in implementing the SWPPP and conducting all monitoring requirements as per the Stormwater Monitoring and Reporting Requirements (Attachment K) of this Order;
- b. The responsibilities, duties, and activities of each of the team members; and,
- c. The procedures to identify alternate team members to implement the SWPPP and conduct required monitoring when the regularly assigned team members are temporarily unavailable (due to vacation, illness, out of town business, or other absences).

##### **2. Other Requirements and Existing Facility Plans**

- a. The Discharger shall ensure its SWPPP is developed, implemented, and revised as necessary to be consistent with any applicable municipal, state, and federal requirements that pertain to the requirements in this Order.
- b. The Discharger may include in their SWPPP the specific elements of existing plans, procedures, or regulatory compliance documents that contain storm water-related BMPs or otherwise relate to the requirements of this Order.
- c. The Discharger shall properly reference the original sources for any elements of existing plans, procedures, or regulatory compliance documents included as part of their SWPPP and shall maintain a copy of the documents at the Facility as part of the SWPPP.
- d. The Discharger shall document in their SWPPP the Facility's scheduled operating hours. Scheduled facility operating hours that would be considered

irregular (temporary, intermittent, seasonal, weather dependent, etc.) shall also be documented in the SWPPP.

## E. Site Map

1. The Discharger shall prepare a site map that includes notes, legends, a north arrow, and other data as appropriate to ensure the map is clear, legible and understandable.
2. The Discharger may provide the required information on multiple site maps.
3. The Discharger shall include the following information on the site map:
  - a. The Facility boundary, storm water drainage areas within the Facility boundary, and portions of any drainage area impacted by discharges from surrounding areas. Include the flow direction of each drainage area, on-facility surface water bodies, areas of soil erosion, and location(s) of nearby water bodies (such as rivers, lakes, wetlands, etc.) or municipal storm drain inlets that may receive the Facility's industrial storm water discharges and authorized NSWDS;
  - b. Locations of storm water collection and conveyance systems, associated discharge locations, and direction of flow. Include any sample locations if different than the identified discharge locations;
  - c. Locations and descriptions of structural control measures<sup>2</sup> that affect industrial storm water discharges, authorized NSWDS, and/or run-on;
  - d. Identification of all impervious areas of the Facility, including paved areas, buildings, covered storage areas, or other roofed structures;
  - e. Locations where materials are directly exposed to precipitation and the locations where identified significant spills or leaks (see Section G.1.d. below) have occurred; and
  - f. Areas of industrial activity subject to this Order. Identify all industrial storage areas and storage tanks, shipping and receiving areas, fueling areas, vehicle and equipment storage/maintenance areas, material handling and processing areas, waste treatment and disposal areas, dust or particulate generating areas, cleaning and material reuse areas, and other areas of industrial activity that may have potential pollutant sources.

---

<sup>2</sup> Examples of structural control measures are catch basins, berms, detention ponds, secondary containment, oil/water separators, diversion barriers, etc.

## **F. List of Industrial Materials**

The Discharger shall ensure the SWPPP includes a list of industrial materials handled at the Facility, and the locations where each material is stored, received, shipped, and handled, as well as the typical quantities and handling frequency.

## **G. Potential Pollutant Sources**

### **1. Description of Potential Pollutant Sources**

#### **a. Industrial Processes**

The Discharger shall ensure the SWPPP describes each industrial process including: manufacturing, cleaning, maintenance, recycling, disposal, and any other activities related to the process. The type, characteristics, and approximate quantity of industrial materials used in or resulting from the process shall be included. Areas protected by containment structures and the corresponding containment capacity shall be identified and described.

#### **b. Material Handling and Storage Areas**

The Discharger shall ensure the SWPPP describes each material handling and storage area, including: the type, characteristics, and quantity of industrial materials handled or stored; the shipping, receiving, and loading procedures; the spill or leak prevention and response procedures; and the areas protected by containment structures and the corresponding containment capacity.

#### **c. Dust and Particulate Generating Activities**

The Discharger shall ensure the SWPPP describes all industrial activities that generate a significant amount of dust or particulate that may be deposited within the Facility boundaries. The SWPPP shall describe such industrial activities, including the discharge locations, the source type, and the characteristics of the dust or particulate pollutant.

#### **d. Significant Spills and Leaks**

The Discharger shall:

- i. Evaluate the Facility for areas where spills and leaks can likely occur;
- ii. Ensure the SWPPP includes:
  - a) A list of any industrial materials that have spilled or leaked in significant quantities and have discharged from the Facility's storm water conveyance system within the previous five-year period;

- b) A list of any toxic chemicals identified in 40 Code of Federal Regulations section 302 that have been discharged from the facilities' storm water conveyance system as reported on USEPA Form R, as well as oil and hazardous substances in excess of reportable quantities (40 C.F.R. §§ 110, 117, and 302) that have discharged from the Facility's storm water conveyance system within the previous five-year period;
  - c) A list of any industrial materials that have spilled or leaked in significant quantities and had the potential to be discharged from the Facility's storm water conveyance system within the previous five-year period; and,
  - iii. Ensure that for each discharge or potential discharge listed above the SWPPP includes the location, characteristics, and approximate quantity of the materials spilled or leaked; approximate quantity of the materials discharged from the Facility's storm water conveyance system; the cleanup or remedial actions that have occurred or are planned; the approximate remaining quantity of materials that have the potential to be discharged; and the preventive measures taken to ensure spills or leaks of the material do not reoccur.
- e. NSWDs

The Discharger shall:

- i. Ensure the SWPPP includes an evaluation of the Facility that identifies all NSWDs, sources, and drainage areas;
- ii. Ensure the SWPPP includes an evaluation of all drains (inlets and outlets) that identifies connections to the storm water conveyance system;
- iii. Ensure the SWPPP includes a description of how all unauthorized NSWDs have been eliminated; and,
- iv. Ensure all NSWDs are described in the SWPPP. This description shall include the source, quantity, frequency, and characteristics of the NSWDs, associated drainage area, and whether it is an authorized or unauthorized NSWD.

f. Erodible Surfaces

The Discharger shall ensure the SWPPP includes a description of the Facility locations where soil erosion may be caused by industrial activity, contact with storm water, authorized and unauthorized NSWDS, or run-on from areas surrounding the Facility.

2. Assessment of Potential Pollutant Sources

- a. The Discharger shall ensure that the SWPPP includes a narrative assessment of all areas of industrial activity with potential industrial pollutant sources. At a minimum, the assessment shall include:
  - i. The areas of the Facility with likely sources of pollutants in industrial storm water discharges and authorized NSWDS;
  - ii. The pollutants likely to be present in industrial storm water discharges and authorized NSWDS;
  - iii. The approximate quantity, physical characteristics (e.g., liquid, powder, solid, etc.), and locations of each industrial material handled, produced, stored, recycled, or disposed;
  - iv. The degree to which the pollutants associated with those materials may be exposed to, and mobilized by contact with, storm water;
  - v. The direct and indirect pathways by which pollutants may be exposed to storm water or authorized NSWDS;
  - vi. All sampling, visual observation, and inspection records;
  - vii. The effectiveness of existing BMPs to reduce or prevent pollutants in industrial storm water discharges and authorized NSWDS;
  - viii. The estimated effectiveness of implementing, to the extent feasible, minimum BMPs to reduce or prevent pollutants in industrial storm water discharges and authorized NSWDS; and,
- b. Based upon the assessment above, Dischargers shall identify in the SWPPP any areas of the Facility where the minimum BMPs described in Section H.1. below will not adequately reduce or prevent pollutants in storm water discharges in compliance with Section IV.D. of this Order. Dischargers shall identify any advanced BMPs, as described in subsection H.2. below, for those areas.

- c. Based upon the assessment above, the Discharger shall identify any additional parameters, beyond the required parameters in Section I.B.5. of the Stormwater Monitoring and Reporting Requirements (Attachment K) that indicate the presence of pollutants in industrial storm water discharges.

## H. Best Management Practices (BMPs)

### 1. Minimum BMPs

The Discharger shall, to the extent feasible, implement and maintain all of the following minimum BMPs to reduce or prevent pollutants in industrial storm water discharges.<sup>3</sup>

#### a. Good Housekeeping

The Discharger shall:

- i. Observe all outdoor areas associated with industrial activity; including storm water discharge locations, drainage areas, conveyance systems, waste handling/disposal areas, and perimeter areas impacted by off-facility materials or storm water run-on to determine housekeeping needs. Any identified debris, waste, spills, tracked materials, or leaked materials shall be cleaned and disposed of properly;
- ii. Minimize or prevent material tracking;
- iii. Minimize dust generated from industrial materials or activities;
- iv. Ensure that all Facility areas impacted by rinse/wash waters are cleaned as soon as possible;
- v. Cover all stored industrial materials that can be readily mobilized by contact with storm water;
- vi. Contain all stored non-solid industrial materials or wastes (e.g., particulates, powders, shredded paper, etc.) that can be transported or dispersed by the wind or contact with storm water;
- vii. Prevent disposal of any rinse/wash waters or industrial materials into the storm water conveyance system;

---

<sup>3</sup> For the purposes of this Order, the requirement to implement BMPs "to the extent feasible" requires Dischargers to select, design, install and implement BMPs that reduce or prevent discharges of pollutants in their storm water discharge in a manner that reflects best industry practice considering technological availability and economic practicability and achievability.

- viii. Minimize storm water discharges from non-industrial areas (e.g., storm water flows from employee parking area) that contact industrial areas of the Facility; and,
- ix. Minimize authorized NSWDS from non-industrial areas (e.g., potable water, fire hydrant testing, etc.) that contact industrial areas of the Facility.

b. Preventive Maintenance

The Discharger shall:

- i. Identify all equipment and systems used outdoors that may spill or leak pollutants;
- ii. Observe the identified equipment and systems to detect leaks, or identify conditions that may result in the development of leaks;
- iii. Establish an appropriate schedule for maintenance of identified equipment and systems; and,
- iv. Establish procedures for prompt maintenance and repair of equipment, and maintenance of systems when conditions exist that may result in the development of spills or leaks.

c. Spill and Leak Prevention and Response

The Discharger shall:

- i. Establish procedures and/or controls to minimize spills and leaks;
- ii. Develop and implement spill and leak response procedures to prevent industrial materials from discharging through the storm water conveyance system. Spilled or leaked industrial materials shall be cleaned promptly and disposed of properly;
- iii. Identify and describe all necessary and appropriate spill and leak response equipment, location(s) of spill and leak response equipment, and spill or leak response equipment maintenance procedures; and,
- iv. Identify and train appropriate spill and leak response personnel.

d. Material Handling and Waste Management

The Discharger shall:

- i. Prevent or minimize handling of industrial materials or wastes that can be readily mobilized by contact with storm water during a storm event;

- ii. Contain all stored non-solid industrial materials or wastes (e.g., particulates, powders, shredded paper, etc.) that can be transported or dispersed by the wind or contact with storm water;
  - iii. Cover industrial waste disposal containers and industrial material storage containers that contain industrial materials when not in use;
  - iv. Divert run-on and storm water generated from within the Facility away from all stockpiled materials;
  - v. Clean all spills of industrial materials or wastes that occur during handling in accordance with the spill response procedures (see Section H.1.c. above); and,
  - vi. Observe and clean as appropriate, any outdoor material or waste handling equipment or containers that can be contaminated by contact with industrial materials or wastes.
- e. Erosion and Sediment Controls
- For each erodible surface Facility location identified in the SWPPP (see Section G.1.f. above), the Discharger shall:
- i. Implement effective wind erosion controls;
  - ii. Provide effective stabilization for inactive areas, finished slopes, and other erodible areas prior to a forecasted storm event;
  - iii. Maintain effective perimeter controls and stabilize all site entrances and exits to sufficiently control discharges of erodible materials from discharging or being tracked off the site;
  - iv. Divert run-on and storm water generated from within the Facility away from all erodible materials; and,
  - v. If sediment basins are implemented, ensure compliance with the design storm standards as described in Section H.5. below.

f. Employee Training Program

The Discharger shall:

- i. Ensure that all team members implementing the various compliance activities of this Attachment are properly trained to implement the requirements of this Attachment, including but not limited to: BMP implementation, BMP effectiveness evaluations, visual observations, and monitoring activities. If a Discharger enters Level 1 status, appropriate team members shall be trained by a Qualified Industrial Storm Water Practitioner (QISP);
- ii. Prepare or acquire appropriate training manuals or training materials;
- iii. Identify which personnel need to be trained, their responsibilities, and the type of training they shall receive;
- iv. Provide a training schedule; and,
- v. Maintain documentation of all completed training classes and the personnel that received training in the SWPPP.

g. Quality Assurance and Record Keeping

The Discharger shall:

- i. Develop and implement management procedures to ensure that appropriate staff implements all elements of the SWPPP, including the Monitoring Implementation Plan;
- ii. Develop a method of tracking and recording the implementation of BMPs identified in the SWPPP; and
- iii. Maintain the BMP implementation records, training records, and records related to any spills and clean-up related response activities for a minimum of five (5) years.

## 2. Advanced BMPs

a. In addition to the minimum BMPs described in Section H.1. above, the Discharger shall, to the extent feasible, implement and maintain any advanced BMPs identified in Section G.2.b., necessary to reduce or prevent discharges of pollutants in its storm water discharge in a manner that complies with Section IV.D. of this Order.

b. Advanced BMPs may include one or more of the following BMPs:

i. Exposure Minimization BMPs

These include storm resistant shelters (either permanent or temporary) that prevent the contact of storm water with the identified industrial materials or area(s) of industrial activity.

ii. Storm Water Containment and Discharge Reduction BMPs

These include BMPs that divert, infiltrate, reuse, contain, retain, or reduce the volume of storm water runoff. Dischargers are encouraged to utilize BMPs that infiltrate or reuse storm water where feasible.

iii. Treatment Control BMPs

This is the implementation of one or more mechanical, chemical, biologic, or any other treatment technology that will meet the treatment design standard.

iv. Other Advanced BMPs

Any additional BMPs not described in subsections b.i through iii above that are necessary to comply with Section IV.D. of this Order.

## 3. BMP Descriptions

a. The Discharger shall ensure that the SWPPP identifies each BMP being implemented at the Facility, including:

i. The pollutant(s) that the BMP is designed to reduce or prevent in industrial storm water discharges;

ii. The frequency, time(s) of day, or conditions when the BMP is scheduled for implementation;

iii. The locations within each area of industrial activity or industrial pollutant source where the BMP shall be implemented;

- iv. The individual and/or position responsible for implementing the BMP;
  - v. The procedures, including maintenance procedures, and/or instructions to implement the BMP effectively;
  - vi. The equipment and tools necessary to implement the BMP effectively; and,
  - vii. The BMPs that may require more frequent visual observations beyond the monthly visual observations.
- b. The Discharger shall identify any BMPs described in subsection a above that are implemented in lieu of any of the minimum or applicable advanced BMPs.

#### 4. BMP Summary Table

The Discharger shall prepare a table summarizing each identified area of industrial activity, the associated industrial pollutant sources, the industrial pollutants, and the BMPs being implemented.

#### 5. Design Storm Standards for Treatment Control BMPs

All new treatment control BMPs employed by the Discharger to comply with Section H.2. Advanced BMPs and new sediment basins installed after January 1, 2016 shall be designed to comply with design storm standards in this Section, except as provided in an Industrial Activity BMP Demonstration (Section II.D.2.a. of the Stormwater Monitoring and Reporting Requirements – Attachment K). A Factor of Safety shall be incorporated into the design of all treatment control BMPs to ensure that storm water is sufficiently treated throughout the life of the treatment control BMPs. The design storm standards for treatment control BMPs are as follows:

- a. Volume-based BMPs: The Discharger, at a minimum, shall calculate<sup>4</sup> the volume to be treated using one of the following methods:
  - i. The volume of runoff produced from an 85<sup>th</sup> percentile 24-hour storm event, as determined from local, historical rainfall records;

---

<sup>4</sup> All hydrologic calculations shall be certified by a California licensed professional engineer in accordance with the Professional Engineers Act (Bus. & Prof. Code § 6700, et seq).

- ii. The volume of runoff produced by the 85<sup>th</sup> percentile 24-hour storm event, determined as the maximized capture runoff volume for the Facility, from the formula recommended in the Water Environment Federation's Manual of Practice<sup>5</sup>; or,
  - iii. The volume of annual runoff required to achieve 80% or more treatment, determined in accordance with the methodology set forth in the latest edition of California Stormwater Best Management Practices Handbook<sup>6</sup>, using local, historical rainfall records.
- b. Flow-based BMPs: The Discharger shall calculate the flow needed to be treated using one of the following methods:
- i. The maximum flow rate of runoff produced from a rainfall intensity of at least 0.2 inches per hour for each hour of a storm event;
  - ii. The maximum flow rate of runoff produced by the 85th percentile hourly rainfall intensity, as determined from local historical rainfall records, multiplied by a factor of two; or,
  - iii. The maximum flow rate of runoff, as determined using local historical rainfall records, that achieves approximately the same reduction in total pollutant loads as would be achieved by treatment of the 85th percentile hourly rainfall intensity multiplied by a factor of two.

## I. MONITORING IMPLEMENTATION PLAN

The Discharger shall prepare a Monitoring Implementation Plan in accordance with the requirements of this Attachment. The Monitoring Implementation Plan shall be included in the SWPPP and shall include the following items:

1. An identification of team members assigned to conduct the monitoring requirements;
2. A description of the following in accordance with the USEPA's "Industrial Stormwater Monitoring and Sampling Guide," dated March 2009, available at: [http://www.epa.gov/npdes/pubs/msgp\\_monitoring\\_guide.pdf](http://www.epa.gov/npdes/pubs/msgp_monitoring_guide.pdf) and the "NPDES Storm Water Sampling Guidance Document," dated July 1992, available at: <http://www.epa.gov/npdes/pubs/owm0093.pdf>.
  - a. Discharge locations;

<sup>5</sup> Water Environment Federation (WEF). *Manual of Practice No. 23/ ASCE Manual of Practice No. 87, cited in chapter 5 (1998 Edition) and Cited in Chapter 3 (2012 Edition)*.

<sup>6</sup> California Stormwater Quality Association. *Stormwater Best Management Practice New Development and Redevelopment Handbook*. < <http://www.casqa.org/> >. [as of July 3, 2013].

- b. Visual observation procedures; and,
  - c. Visual observation response procedures related to monthly visual observations and sampling event visual observations.
3. Justifications for the following that are applicable to the Facility:
- Alternative discharge locations in accordance with Section I.C.3 of the Stormwater Monitoring and Reporting Requirements (Attachment K) of this Order;
4. Procedures for field instrument calibration instructions, including calibration intervals specified by the manufacturer; and,
5. An example Chain of Custody form used when handling and shipping water quality samples to the lab.

**TABLE A: Five Phases for Developing and Implementing an Industrial Storm Water Pollution Prevention Plan (SWPPP)**

**PLANNING AND ORGANIZATION**

- \*Form Pollution Prevention Team
- \*Review other Facility plans

**ASSESSMENT**

- \*Develop a site map
- \*Identify potential pollutant sources
- \*Inventory of materials and chemicals
- \*List significant spills and leaks
- \*Identify Non-Storm Water Discharges
- \*Assess pollutant risk

**Best Management Practice (BMP) IDENTIFICATION**

- \*Identify minimum required BMPs
- \*Identify any advanced BMPs

**IMPLEMENTATION**

- \*Train employees for the Pollution Prevention Team
- \*Implement BMPs
- \*Collect and review records

**EVALUATION / MONITORING**

- \*Conduct annual Facility evaluation (Annual Evaluation)
- \*Review monitoring information
- \*Evaluate BMPs
- \*Review and revise SWPPP

**TABLE B: Example - Assessment of Potential Industrial Pollution Sources and Corresponding BMPs Summary**

Area	Activity	Pollutant Source	Industrial Pollutant	BMPs
Vehicle and Equipment Fueling	Fueling	Spills and leaks during delivery	Fuel oil	-Use spill and overflow protection
		Spills caused by topping off fuel tanks	Fuel oil	-Train employees on proper fueling, cleanup, and spill response techniques
		Hosing or washing down fuel area	Fuel oil	-Use dry cleanup methods rather than hosing down area -Implement proper spill prevention control program
		Leaking storage tanks	Fuel oil	-Inspect fueling areas regularly to detect problems
		Rainfall running off fueling area, and rainfall running onto and off fueling area	Fuel oil	-Minimize run-on of storm water into the fueling area, cover fueling area

## **ATTACHMENT K – STORMWATER MONITORING AND REPORTING REQUIREMENTS**

### **I. MONITORING**

#### **A. Visual Observations**

##### **1. Monthly Visual Observations**

- a. At least once per calendar month, the Discharger shall visually observe each drainage area for the following:
  - i. The presence or indications of prior, current, or potential unauthorized NSWDS and their sources;
  - ii. Authorized NSWDS, sources, and associated BMPs to ensure that BMPs are included in the SWPPP and implemented to reduce, to the extent practicable, the flow or volume of authorized NSWDS and that authorized NSWDS do not contain quantities of pollutants that cause or contribute to an exceedance of a water quality standards ; and,
  - iii. Outdoor industrial equipment and storage areas, outdoor industrial activities areas, BMPs, and all other potential source of industrial pollutants.
- b. The monthly visual observations shall be conducted during daylight hours of scheduled facility operating hours and on days without precipitation.
- c. The Discharger shall provide an explanation in the Annual Report for uncompleted monthly visual observations.

##### **2. Sampling Event Visual Observations**

Sampling event visual observations shall be conducted at the same time sampling occurs at a discharge location. At each discharge location where a sample is obtained, the Discharger shall observe the discharge of storm water associated with industrial activity.

- a. The Discharger shall ensure that visual observations of storm water discharged from containment sources (e.g. secondary containment or storage ponds) are conducted at the time that the discharge is sampled.
- b. Any Discharger employing volume-based or flow-based treatment BMPs shall sample any bypass that occurs while the visual observations and sampling of storm water discharges are conducted.

- c. The Discharger shall visually observe and record the presence or absence of floating and suspended materials, oil and grease, discolorations, turbidity, odors, trash/debris, and source(s) of any discharged pollutants.
- d. In the event that a discharge location is not visually observed during the sampling event, the Discharger shall record which discharge locations were not observed during sampling or that there was no discharge from the discharge location.
- e. The Discharger shall provide an explanation in the Annual Report for uncompleted sampling event visual observations.

### 3. Visual Observation Records

The Discharger shall maintain records of all visual observations. Records shall include the date, approximate time, locations observed, presence and probable source of any observed pollutants, name of person(s) that conducted the observations, and any response actions and/or additional SWPPP revisions necessary in response to the visual observations.

4. The Discharger shall revise BMPs as necessary when the visual observations indicate pollutant sources have not been adequately addressed in the SWPPP.

## B. Sampling and Analysis

1. A Qualifying Storm Event (QSE) is a precipitation event that:
  - a. Produces a discharge for at least one drainage area; and,
  - b. Is preceded by 48 hours with no discharge from any drainage area.
2. The Discharger shall collect and analyze storm water samples from two (2) QSEs within the first half of each reporting year (July 1 to December 31), and two (2) QSEs within the second half of each reporting year (January 1 to June 30).
3. Samples shall be collected from each drainage area at all discharge locations. The samples must be:
  - a. Representative of storm water associated with industrial activities and any commingled authorized NSWDS; or,
  - b. Associated with the discharge of contained storm water.

4. Samples from each discharge location shall be collected within four (4) hours of:
  - a. The start of the discharge; or,
  - b. The start of facility operations if the QSE occurs within the previous 12-hour period (e.g., for storms with discharges that begin during the night for facilities with day-time operating hours). Sample collection is required during scheduled facility operating hours and when sampling conditions are safe.
5. The Discharger shall analyze all collected samples for the following parameters:
  - a. Total suspended solids (TSS) and oil and grease (O&G);
  - b. pH (see Section I.C.2 below); and
6. The Discharger shall select corresponding NALs, analytical test methods, and reporting units from the list provided in Table 1 below. The Discharger may also propose analytical test methods with substantially similar or more stringent method detection limits than existing approved analytical test methods.

**TABLE 1: Parameter NAL Values, Test Methods, and Reporting Units**

PARAMETER	TEST METHOD	REPORTING UNITS	ANNUAL NAL	INSTANTANEOUS MAXIMUM NAL
pH	See Section I.C.2, below	pH units	N/A	Less than 6.0 Greater than 9.0
Suspended Solids (TSS), Total	SM 2540-D	mg/L	100	400
Oil & Grease (O&G), Total	EPA 1664A	mg/L	15	25

SM – Standard Methods for the Examination of Water and Wastewater, 18<sup>th</sup> edition

EPA – USEPA test methods

7. The Discharger shall ensure that the collection, preservation and handling of all storm water samples are in accordance with the USEPA's Guidance Documents mentioned in Section I.2. of Attachment J.
8. The Discharger shall ensure that all laboratory analyses are conducted according to test procedures under 40 Code of Federal Regulations part 136, including the observation of holding times, unless other test procedures have been specified by the Regional Water Board.
9. Sampling Analysis Reporting
  - a. The Discharger shall submit all sampling and analytical results for all individual or Qualified Combined Samples in its annual report.

- b. The Discharger shall provide the method detection limit when an analytical result from samples taken is reported by the laboratory as a "non-detect" or less than the method detection limit. A value of zero shall not be reported.
- c. The Discharger shall provide the analytical result from samples taken that is reported by the laboratory as below the minimum level (often referred to as the reporting limit) but above the method detection limit.

### **C. Methods and Exceptions**

- 1. The Discharger shall comply with the monitoring methods in this General Permit and the USEPA's Guidance Documents mentioned in Section I.2. of Attachment J.
- 2. pH Methods
  - a. Dischargers that have never entered Level 1 status for pH, are eligible to screen for pH using wide range litmus pH paper or other equivalent pH test kits. The pH screen shall be performed as soon as practicable, but no later than 15 minutes after the sample is collected.
  - b. Dischargers that enter Level 1 status (see Section II.C. below) for pH shall, in the subsequent reporting years, analyze for pH using methods in accordance with 40 Code of Federal Regulations 136 or use a calibrated portable instrument for pH.
  - c. Dischargers using a calibrated portable instrument for pH shall ensure that all field measurements are conducted in accordance with the accompanying manufacturer's instructions.
- 3. Alternative Discharge Locations
  - a. The Discharger is required to identify, when practicable, alternative discharge locations for any discharge locations identified in accordance with Section I.B.3., above if the facility's discharge locations are:
    - i. Affected by storm water run-on from surrounding areas that cannot be controlled; and/or,
    - ii. Difficult to observe or sample (e.g. submerged discharge outlets, dangerous discharge location accessibility).
  - b. The Discharger shall include in its annual report any alternative discharge location or revisions to the alternative discharge locations in the Monitoring Implementation Plan.

#### 4. Sample Collection and Visual Observation Exceptions

- a. Sample collection and visual observations are not required under the following conditions:
  - i. During dangerous weather conditions such as flooding or electrical storms; or,
  - ii. Outside of scheduled facility operating hours. The Discharger is not precluded from collecting samples or conducting visual observations outside of scheduled facility operating hours.
- b. In the event that samples are not collected, or visual observations are not conducted in accordance with Section I.B.4., above due to these exceptions, an explanation shall be included in the Annual Report.

#### 5. Sampling Frequency Reduction Certification

- a. The Discharger is eligible to reduce the number of QSEs sampled each reporting year in accordance with the following requirements:
  - i. Results from four (4) consecutive QSEs that were sampled (QSEs may be from different reporting years) did not exceed any NALs as defined in Section II.A. below; and
  - ii. The Discharger is in full compliance with the requirements of this Order and has submitted via CIWQS all annual reports on-time during the time period in which samples were collected.
- b. The Regional Water Board may notify a Discharger that it may not reduce the number of QSEs sampled each reporting year if the Discharger is subject to an enforcement action.
- c. Upon Sampling Frequency Reduction certification, the Discharger shall collect and analyze samples from one (1) QSE within the first half of each reporting year (July 1 to December 31), and one (1) QSE within the second half of each reporting year (January 1 to June 30). All other monitoring, sampling, and reporting requirements remain in effect.
- d. The Discharger may reduce sampling per the Sampling Frequency Reduction certification unless notified by the Regional Water Board that: (1) the Sampling Frequency Reduction certification has been rejected or (2) additional supporting documentation must be submitted. In such instances, the Discharger is ineligible for the Sampling Frequency Reduction until the Regional Water Board provides Sampling Frequency Reduction certification approval.
- e. The Discharger loses its Sampling Frequency Reduction certification if an NAL exceedance occurs (see Section II.A. below).

## II. EXCEEDANCE RESPONSE ACTIONS (ERAs)

### A. NALs and NAL Exceedances

The Discharger shall perform sampling, analysis and reporting in accordance with this Stormwater Monitoring Program and Reporting Requirements and shall compare the results to the two types of NAL values in Table 1 to determine whether either type of NAL has been exceeded for each applicable parameter. The two types of potential NAL exceedances are as follows:

1. Annual NAL exceedance: The Discharger shall determine the average concentration for each parameter using the results of all the sampling and analytical results for the entire facility for the reporting year (i.e., all "effluent" data). The Discharger shall compare the average concentration for each parameter to the corresponding annual NAL values in Table 1. For Dischargers using composite sampling or flow-weighted measurements in accordance with standard practices, the average concentrations shall be calculated in accordance with the USEPA's NPDES Storm Water Sampling Guidance Document.<sup>1</sup> An annual NAL exceedance occurs when the average of all the analytical results for a parameter from samples taken within a reporting year exceeds the annual NAL value for that parameter listed in Table 1; and,
2. Instantaneous maximum NAL exceedance: The Discharger shall compare all sampling and analytical results from each distinct sample to the corresponding instantaneous maximum NAL values in Table 1. An instantaneous maximum NAL exceedance occurs when two (2) or more analytical results from samples taken for any single parameter within a reporting year exceed the instantaneous maximum NAL value (for TSS and O&G) or are outside of the instantaneous maximum NAL range for pH.

### B. Baseline Status

At the beginning of a Discharger's NOI Coverage, the Discharger has Baseline status for all parameters.

<sup>1</sup> USEPA. NPDES Storm Water Sampling Guidance Document. <<http://www.epa.gov/npdes/pubs/owm0093.pdf>>. [as of February 4, 2014]

### C. Level 1 Status

A Discharger's Baseline status for any given parameter shall change to Level 1 status if sampling results indicate an NAL exceedance for that same parameter. Level 1 status will commence on July 1 following the reporting year during which the exceedance(s) occurred.<sup>2</sup>

#### 1. Level 1 ERA Evaluation

- a. By October 1 following commencement of Level 1 status for any parameter with sampling results indicating an NAL exceedance, the Discharger shall:
- b. Complete an evaluation, with the assistance of a QISP, of the industrial pollutant sources at the facility that are or may be related to the NAL exceedance(s); and,
- c. Identify in the evaluation the corresponding BMPs in the SWPPP and any additional BMPs and SWPPP revisions necessary to prevent future NAL exceedances and to comply with Section IV.D. of this Order. Although the evaluation may focus on the drainage areas where the NAL exceedance(s) occurred, all drainage areas shall be evaluated.

#### 2. Level 1 ERA Report

- a. Based upon the above evaluation, the Discharger shall, as soon as practicable but no later than January 1 following commencement of Level 1 status :
  - i. Revise the SWPPP as necessary and implement any additional BMPs identified in the evaluation;
  - ii. Certify and submit via CIWQS a Level 1 ERA Report prepared by a QISP that includes the following:
    - 1) A summary of the Level 1 ERA Evaluation required in Section II.C.1. above; and,
    - 2) A detailed description of the SWPPP revisions and any additional BMPs for each parameter that exceeded an NAL.

---

<sup>2</sup> For all sampling results reported before June 30th of the preceding reporting year. If sample results indicating an NAL exceedance are submitted after June 30<sup>th</sup>, the Discharger will change status once those results have been reported.

- iii. Certify and submit via CIWQS the QISP's identification number, name, and contact information (telephone number, e-mail address).
  - b. A Discharger's Level 1 status for a parameter will return to Baseline status once a Level 1 ERA report has been completed, all identified additional BMPs have been implemented, and results from four (4) consecutive QSEs that were sampled subsequent to BMP implementation indicate no additional NAL exceedances for that parameter.
3. NAL Exceedances Prior to Implementation of Level 1 Status BMPs.

Prior to the implementation of an additional BMP identified in the Level 1 ERA Evaluation or October 1, whichever comes first, sampling results for any parameter(s) being addressed by that additional BMP will not be included in the calculations of annual average or instantaneous NAL exceedances.

#### **D. Level 2 Status**

A Discharger's Level 1 status for any given parameter shall change to Level 2 status if sampling results indicate an NAL exceedance for that same parameter while the Discharger is in Level 1. Level 2 status will commence on July 1 following the reporting year during which the NAL exceedance(s) occurred.<sup>3</sup>

1. Level 2 ERA Action Plan
  - a. Dischargers with Level 2 status shall certify and submit via CIWQS a Level 2 ERA Action Plan prepared by a QISP that addresses each new Level 2 NAL exceedance by January 1 following the reporting year during which the NAL exceedance(s) occurred. For each new Level 2 NAL exceedance, the Level 2 Action Plan will identify which of the demonstrations in Section II.D.2.a through c the Discharger has selected to perform. A new Level 2 NAL exceedance is any Level 2 NAL exceedance for 1) a new parameter in any drainage area, or 2) the same parameter that is being addressed in an existing Level 2 ERA Action Plan in a different drainage area.
  - b. The Discharger shall certify and submit via CIWQS the QISP's identification number, name, and contact information (telephone number, e-mail address) if this information has changed since previous certifications.
  - c. The Level 2 ERA Action Plan shall at a minimum address the drainage areas with corresponding Level 2 NAL exceedances.

<sup>3</sup> For all sampling results reported before June 30th of the preceding reporting year. If sample results indicating an NAL exceedance are submitted after June 30<sup>th</sup>, the Discharger will change status upon the date those results have been reported into CIWQS.

- d. All elements of the Level 2 ERA Action Plan shall be implemented as soon as practicable and completed no later than 1 year after submitting the Level 2 ERA Action Plan.
- e. The Level 2 ERA Action Plan shall include a schedule and a detailed description of the tasks required to complete the Discharger's selected demonstration(s) as described below in Section II.D.2.a through c.

## 2. Level 2 ERA Technical Report

On January 1 of the reporting year following the submittal of the Level 2 ERA Action Plan, a Discharger with Level 2 status shall certify and submit a Level 2 ERA Technical Report prepared by a QISP that includes one or more of the following demonstrations:

### a. Industrial Activity BMPs Demonstration

This shall include the following requirements, as applicable:

- i. Shall include a description of the industrial pollutant sources and corresponding industrial pollutants that are or may be related to the NAL exceedance(s);
- ii. Shall include an evaluation of all pollutant sources associated with industrial activity that are or may be related to the NAL exceedance(s);
- iii. Where all of the Discharger's implemented BMPs, including additional BMPs identified in the Level 2 ERA Action Plan, achieve compliance with Section IV.D. of this Order and are expected to eliminate future NAL exceedance(s), the Discharger shall provide a description and analysis of all implemented BMPs;
- iv. In cases where all of the Discharger's implemented BMPs, including additional BMPs identified in the Level 2 ERA Action Plan, achieve compliance with Section IV.D. of this Order but are not expected to eliminate future NAL exceedance(s), the Discharger shall provide, in addition to a description and analysis of all implemented BMPs:
  - 1) An evaluation of any additional BMPs that would reduce or prevent NAL exceedances;
  - 2) Estimated costs of the additional BMPs evaluated; and,
  - 3) An analysis describing the basis for the selection of BMPs implemented in lieu of the additional BMPs evaluated but not implemented.

- v. The description and analysis of BMPs required in Section II.D.2.a.iii above shall specifically address the drainage areas where the NAL exceedance(s) responsible for the Discharger's Level 2 status occurred, although any additional Level 2 ERA Action Plan BMPs may be implemented for all drainage areas; and,
- vi. If an alternative design storm standard for treatment control BMPs (in lieu of the design storm standard for treatment control BMPs in Section H.5. of Attachment J) will achieve compliance with Section IV.D. of this Order, the Discharger shall provide an analysis describing the basis for the selection of the alternative design storm standard.

b. Non-Industrial Pollutant Source Demonstration

This shall include:

- i. A statement that the Discharger has determined that the exceedance of the NAL is attributable solely to the presence of non-industrial pollutant sources. (The pollutant may also be present due to industrial activities, in which case the Discharger must demonstrate that the pollutant contribution from the industrial activities by itself does not result in an NAL exceedance.) The sources shall be identified as either run-on from adjacent properties, aerial deposition from man-made sources, or as generated by on-site non-industrial sources;
- ii. A statement that the Discharger has identified and evaluated all potential pollutant sources that may have commingled with storm water associated with the Discharger's industrial activity and may be contributing to the NAL exceedance;
- iii. A description of any on-site industrial pollutant sources and corresponding industrial pollutants that are contributing to the NAL exceedance;
- iv. An assessment of the relative contributions of the pollutant from (1) storm water run-on to the facility from adjacent properties or non-industrial portions of the Discharger's property or from aerial deposition and (2) the storm water associated with the Discharger's industrial activity;
- v. A summary of all existing BMPs for that parameter; and,
- vi. An evaluation of all on-site/off-site analytical monitoring data demonstrating that the NAL exceedances are caused by pollutants in storm water run-on to the facility from adjacent properties or non-industrial portions of the Discharger's property or from aerial deposition.

c. Natural Background Pollutant Source Demonstration

This shall include:

- i. A statement that the Discharger has determined that the NAL exceedance is attributable solely to the presence of the pollutant in the natural background that has not been disturbed by industrial activities. (The pollutant may also be present due to industrial activities, in which case the Discharger must demonstrate that the pollutant contribution from the industrial activities by itself does not result in an NAL exceedance);
- ii. A summary of all data previously collected by the Discharger, or other identified data collectors, that describes the levels of natural background pollutants in the storm water discharge;
- iii. A summary of any research and published literature that relates the pollutants evaluated at the facility as part of the Natural Background Source Demonstration;
- iv. Map showing the reference site location in relation to facility along with available land cover information;
- v. Reference site and test site elevation;
- vi. Available geology and soil information for reference and test sites;
- vii. Photographs showing site vegetation;
- viii. Site reconnaissance survey data regarding presence of roads, outfalls, or other human-made structures; and,
- ix. Records from relevant state or federal agencies indicating no known mining, forestry, or other human activities upstream of the proposed reference site.

3. Level 2 ERA Technical Report Submittal

- a. The Discharger shall certify and submit via CIWQS the Level 2 ERA Technical Report described in Section II.D.2. above.
- b. The Regional Water Board may review the submitted Level 2 ERA Technical Reports. Upon review of a Level 2 ERA Technical Report, the Regional Water Board may reject the Level 2 ERA Technical Report and direct the Discharger to take further action(s) to comply with Section IV.D. of this Order.
- c. Dischargers with Level 2 status who have submitted the Level 2 ERA Technical Report are only required to annually update the Level 2 ERA Technical Report

based upon additional NAL exceedances of the same parameter and same drainage area (if the original Level 2 ERA Technical Report contained an Industrial Activity BMP Demonstration and the implemented BMPs were expected to eliminate future NAL exceedances in accordance with Section II.D.2.a.ii), facility operational changes, pollutant source(s) changes, and/or information that becomes available via compliance activities (monthly visual observations, sampling results, annual evaluation, etc.). The Level 2 ERA Technical Report shall be prepared by a QISP and be certified and submitted via CIWQS by the Discharger with each Annual Report. If there are no changes prompting an update of the Level 2 ERA Technical Report, as specified above, the Discharger will provide this certification in the Annual Report that there have been no changes warranting re-submittal of the Level 2 ERA Technical Report.

- d. Dischargers are not precluded from submitting a Level 2 ERA Action Plan or ERA Technical Report prior to entering Level 2 status if information is available to adequately prepare the report and perform the demonstrations described above. A Discharger who chooses to submit a Level 2 ERA Action Plan or ERA Technical Report prior to entering Level 2 status will automatically be placed in Level 2 in accordance to the Level 2 ERA schedule.

#### 4. Eligibility for Returning to Baseline Status

- a. Dischargers with Level 2 status who submit an Industrial Activity BMPs Demonstration in accordance with Section II.D.2.a.i through iii above and have implemented BMPs to prevent future NAL exceedance(s) for the Level 2 parameter(s) shall return to baseline status for that parameter, if results from four (4) subsequent consecutive QSEs sampled indicate no additional NAL exceedance(s) for that parameter(s). If future NAL exceedances occur for the same parameter(s), the Discharger's Baseline status will return to Level 2 status on July 1 in the subsequent reporting year during which the NAL exceedance(s) occurred. These Dischargers shall update the Level 2 ERA Technical Report as required above in Section II.D.3.c.
- b. Dischargers are ineligible to return to baseline status if they submit any of the following:
  - i. A industrial activity BMP demonstration in accordance with Section II.D.2.a.iv. above;
  - ii. An non-industrial pollutant source demonstration; or,
  - iii. A natural background pollutant source demonstration.

## 5. Level 2 ERA Implementation Extension

- a. Dischargers that need additional time to submit the Level 2 ERA Technical Report shall be automatically granted a single time extension for up to six (6) months upon submitting the following items into CIWQS, as applicable:
  - i. Reasons for the time extension;
  - ii. A revised Level 2 ERA Action Plan including a schedule and a detailed description of the necessary tasks still to be performed to complete the Level 2 ERA Technical Report; and
  - iii. A description of any additional temporary BMPs that will be implemented while permanent BMPs are being constructed.
- b. The Regional Water Board will review Level 2 ERA Implementation Extensions for completeness and adequacy. Requests for extensions that total more than six (6) months are not granted unless approved in writing by the Regional Water Board. The Regional Water Board may (1) reject or revise the time allowed to complete Level 2 ERA Implementation Extensions, (2) identify additional tasks necessary to complete the Level 2 ERA Technical Report, and/or (3) require the Discharger to implement additional temporary BMPs.

### III. ANNUAL COMPREHENSIVE FACILITY COMPLIANCE EVALUATION (ANNUAL EVALUATION)

The Discharger shall conduct one Annual Evaluation for each reporting year (July 1 to June 30). If the Discharger conducts an Annual Evaluation fewer than eight (8) months, or more than sixteen (16) months, after it conducts the previous Annual Evaluation, it shall document the justification for doing so. The Discharger shall revise the SWPPP, as appropriate, and implement the revisions within 90 days of the Annual Evaluation. At a minimum, Annual Evaluations shall consist of:

- A. A review of all sampling, visual observation, and inspection records conducted during the previous reporting year;
- B. An inspection of all areas of industrial activity and associated potential pollutant sources for evidence of, or the potential for, pollutants entering the storm water conveyance system;
- C. An inspection of equipment needed to implement the BMPs;
- D. An inspection of any BMPs;

- E. A review and effectiveness assessment of all BMPs for each area of industrial activity and associated potential pollutant sources to determine if the BMPs are properly designed, implemented, and are effective in reducing and preventing pollutants in industrial storm water discharges and authorized NSWDS; and,
- F. An assessment of any other factors needed to comply with the requirements in Section IV.B. below.

#### **IV. ANNUAL REPORT**

- A. The Discharger shall certify and submit via CIWQS an Annual Report no later than July 15<sup>th</sup> following each reporting year.
- B. The Discharger shall include in the Annual Report:
  - 1. A Compliance Checklist that indicates whether a Discharger complies with this Stormwater Monitoring Program and Reporting Requirements;
  - 2. An explanation for any non-compliance of requirements within the reporting year, as indicated in the Compliance Checklist;
  - 3. An identification, including page numbers and/or sections, of all revisions made to the SWPPP within the reporting year; and,
  - 4. The date(s) of the Annual Evaluation.

#### **V. MONITORING AND RECORDS**

- 1. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity.
- 2. If the Discharger monitor any pollutant more frequently than required, the results of such monitoring shall be included in the calculation and reporting of the data submitted.
- 3. Records of monitoring information shall include:
  - a. The date, exact location, and time of sampling or measurement;
  - b. The date(s) analyses were performed;
  - c. The individual(s) that performed the analyses;
  - d. The analytical techniques or methods used; and,
  - e. The results of such analyses.

4. The Discharger shall retain, for a period of at least five (5) years, either a paper or electronic copy of all storm water monitoring information, records, data, and reports required by this Order. Copies shall be available for review by the Water Board's staff at the facility during scheduled facility operating hours.
5. Upon written request by the Water Boards or the USEPA, the Discharger shall provide paper or electronic copies of Annual Reports or other requested records to the Water Boards or USEPA within ten (10) days from receipt of the request.