FORMATS.CEL AC=DSTD 5/9/05

Contains confidential information proprietory to Bechtel not to be disclosed to third parties without Bechtel's prior written permission.

©Copyright Bechtel Corporation 2013. All rights reserved.

N 644,000
N 642,000
N 640,000
N 638,000
N 646,000
N 634,000
E 1,142,000
E 1,144,000
E 1,146,000
E 1,148,000
E 1,150,000
E 1,152,000
12'30"
3901
3900
3899
Lion Rock
Crowbar
BM 100
Coral
Cove
Radio Tower
Spring
Water Tanks
Canyon
Crowbar Canyon
Ruda Canyon
Los Osos
Diablo Canyon
Spooner 1573
Pecho 1493
X1474
X1231
X1355
X914
X749
HAUL ROAD TO SPOILS AREA 5,600 LF.
HAUL ROAD TO SPOILS AREA 3,594 LF.
POTENTIAL SPOILS AREA 264 ACRES
POTENTIAL SPOILS AREA 46 ACRES
EXC. RAMPS (TYP.)
BENCH (TYP.)
EL. 115
EXISTING TRANSMISSION TOWER
EXISTING TRANSMISSION TOWER
EXISTING FACILITIES
SHORE
CLIFF
DIABLO CREEK
Substation
AQUEDUCT
DIABLO WTs
Filtration Plant
WTs
DESALINATION
DIABLO CANYON POWER PLANT
PRIVATE
WT
Trails
Substation
CCK-7200-00003
CCK-7200-00002
WT
WT
WT
WT
WT
1
2
3
4
5
6
A
B
C
D

FOR INFORMATION ONLY.
DO NOT USE FOR CONSTRUCTION

NOTES:

1. CONTOURS SHOWN ON THIS DRAWING ORIGINATED FROM USGS QUAD MAP TITLED "PORT SAN LUIS, CALIF."

0 500 1000 1500FT

SCALE: 1" = 500'

Bechtel Confidential. © 2013 Bechtel Power Corporation (Bechtel). This document, prepared under Contract Job number 25762 between Bechtel and PG&E, contains information confidential and/or proprietary to Bechtel that is not to be used, disclosed, or reproduced in any form by any person or entity other than Bechtel or PG&E without Bechtel's prior written permission. All rights reserved.

This document has been prepared by Bechtel exclusively for PG&E under contract job number 25762 and is not to be relied upon by any person or entity other than PG&E or used inconjunction with any other project.

NO.	DATE	REVISIONS	BY	CHK	DESIGN SUPV	ENGR	PROJ ENGR
1	9/4/13	ISSUED FOR ESTIMATE	MHN	-	-	-	-

SCALE 1"=500' | DESIGNED | DRAWN MHN | CHIEF ENGR

BECHTEL
FREDERICK, MARYLAND

PACIFIC GAS AND ELECTRIC
DIABLO CANYON POWER PLANT

TWO COOLING TOWER ARRANGEMENT - EXCAVATION PLAN WITH USGS TOPO MAP

JOB NO.	DRAWING NO.	REV
25762-110	CEK-7200-00004	00A

22 x 34 "D" SIZE

LEVELS 1111111111222222222333333333444444444555555555 56666
1234567890123456789012345678901234567890123456789012345678901234567890123

PSC=BER=BFN=E

FORMATS.CEL AC=DSTD 5/9/05

Contains confidential information proprietory to Bechtel not to be disclosed to third parties without Bechtel's prior written permission

©Copyright Bechtel Corporation 2013. All rights reserved.

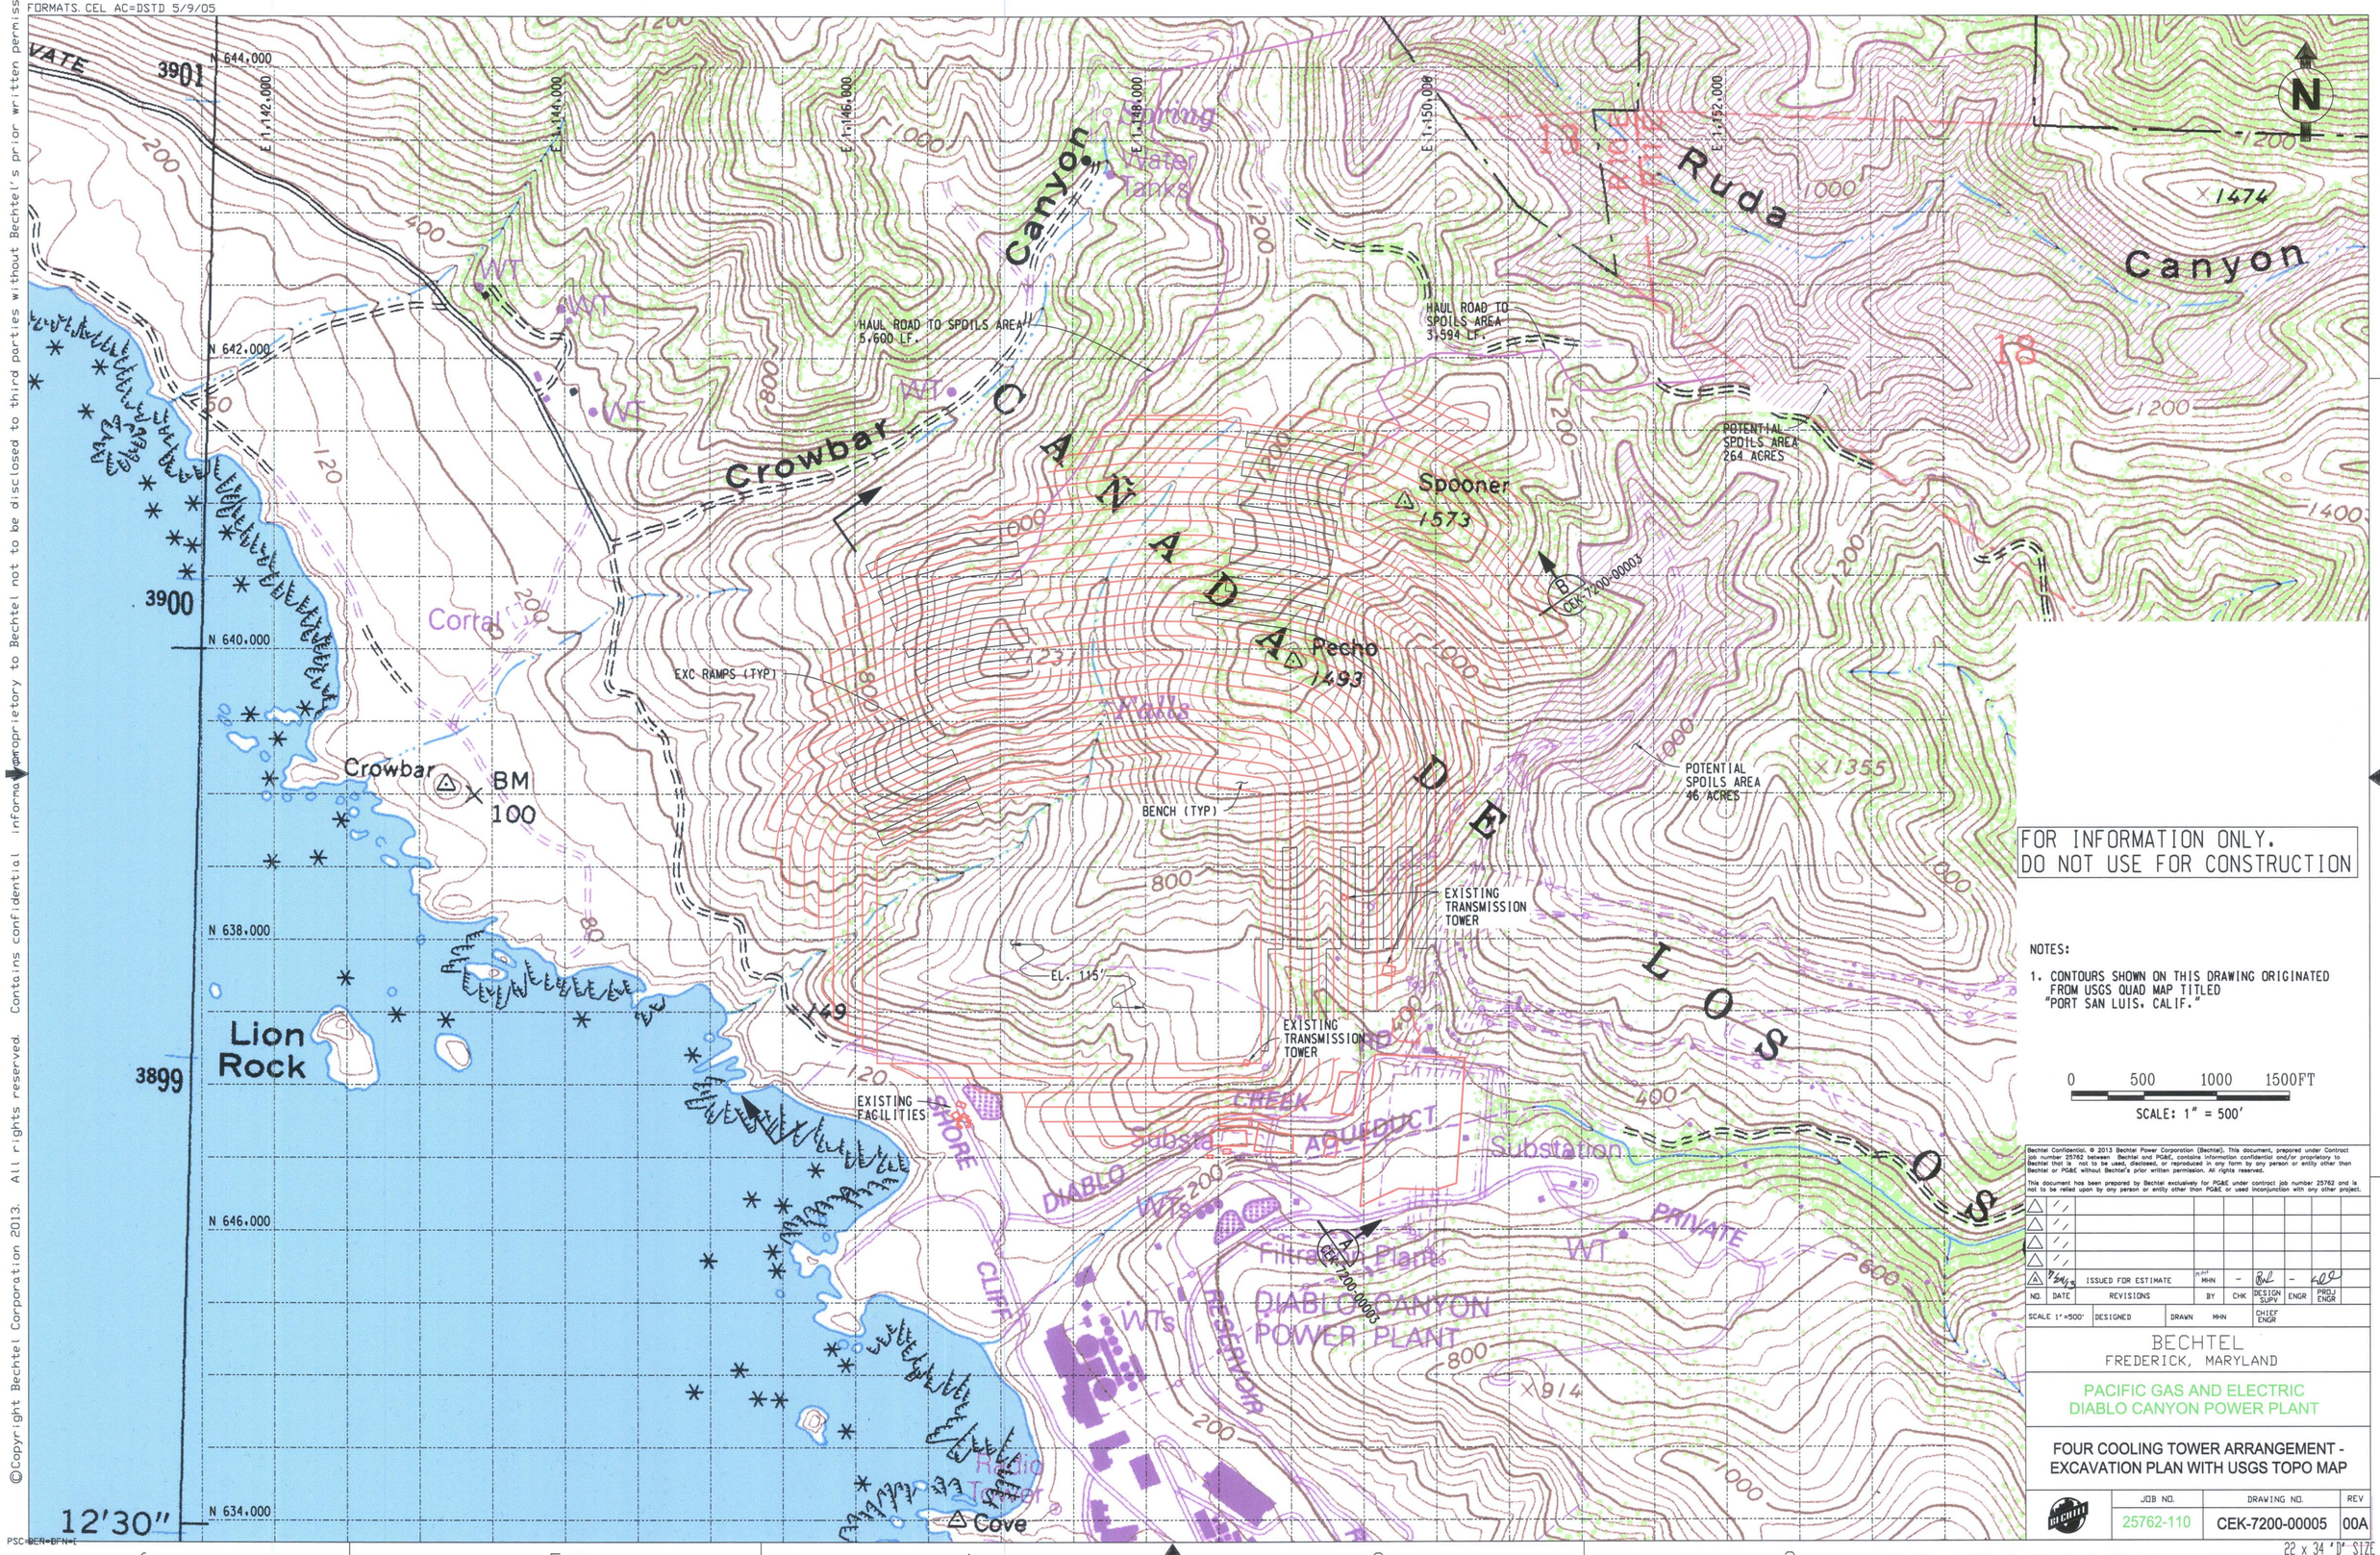

FOR INFORMATION ONLY.
DO NOT USE FOR CONSTRUCTION

NOTES:

1. CONTOURS SHOWN ON THIS DRAWING ORIGINATED FROM USGS QUAD MAP TITLED "PORT SAN LUIS, CALIF."

0 500 1000 1500FT

SCALE: 1" = 500'

Bechtel Confidential. © 2013 Bechtel Power Corporation (Bechtel). This document, prepared under Contract job number 25762 between Bechtel and PG&E, contains information confidential and/or proprietary to Bechtel that is not to be used, disclosed, or reproduced in any form by any person or entity other than Bechtel or PG&E without Bechtel's prior written permission. All rights reserved.

This document has been prepared by Bechtel exclusively for PG&E under contract job number 25762 and is not to be relied upon by any person or entity other than PG&E or used inconjunction with any other project.

NO.	DATE	REVISIONS	BY	CHK	DESIGN SUPV	ENGR	PROJ ENGR
0	7/29/13	ISSUED FOR ESTIMATE	MHN	-	BL	-	JDS

SCALE 1"=500'	DESIGNED	DRAWN	CHIEF ENGR
		MHN	

BECHTEL
FREDERICK, MARYLAND

PACIFIC GAS AND ELECTRIC
DIABLO CANYON POWER PLANT

FOUR COOLING TOWER ARRANGEMENT - EXCAVATION PLAN WITH USGS TOPO MAP

JOB NO.	DRAWING NO.	REV
25762-110	CEK-7200-00005	00A

22 x 34 'D' SIZE

LEVELS 1111111111222222222333333333444444444455555555 5666 6 1234567890123456789012345678901234567890123456789012345678901234567890123

PSC=BER=BFN=E

6 5 4 3 2

D C B A