
Monitoring Methods for Double-Walled Pressurized Piping and Under-Dispenser Containment (UDC) Title 23, California Code of Regulations (CCR)

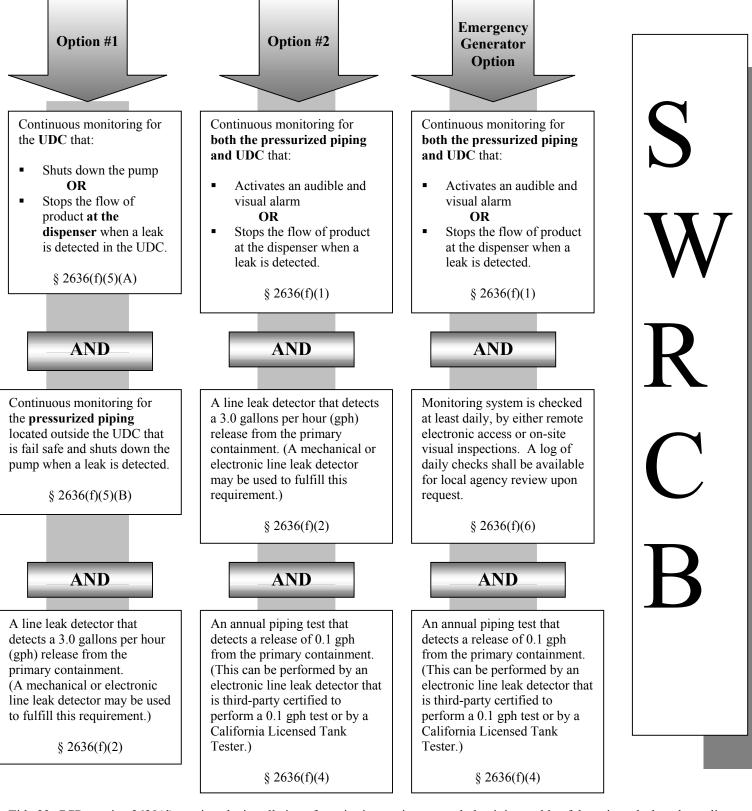

Title 23, CCR, section 2630(d) requires the installation of monitoring equipment such that it is capable of detecting a leak at the earliest possible opportunity. Therefore, an underground storage tank system where the UDC drains back to a low point in the product piping (generally the turbine pump) is not compliant unless a monitoring device is also installed in the UDC. This flow chart was created as a quick reference. Please refer to Title 23, CCR for specific regulatory language regarding other pressurized piping, suction piping, and UDC monitoring requirements. A copy of Title 23, CCR is available online at: www.swrcb.ca.gov.