Oceanside NIMO Site
Sewer and Brine Flows

IDEC Pharmaceuticals Corporation

W F Voth
Revision 7
Date 11 Apr 03

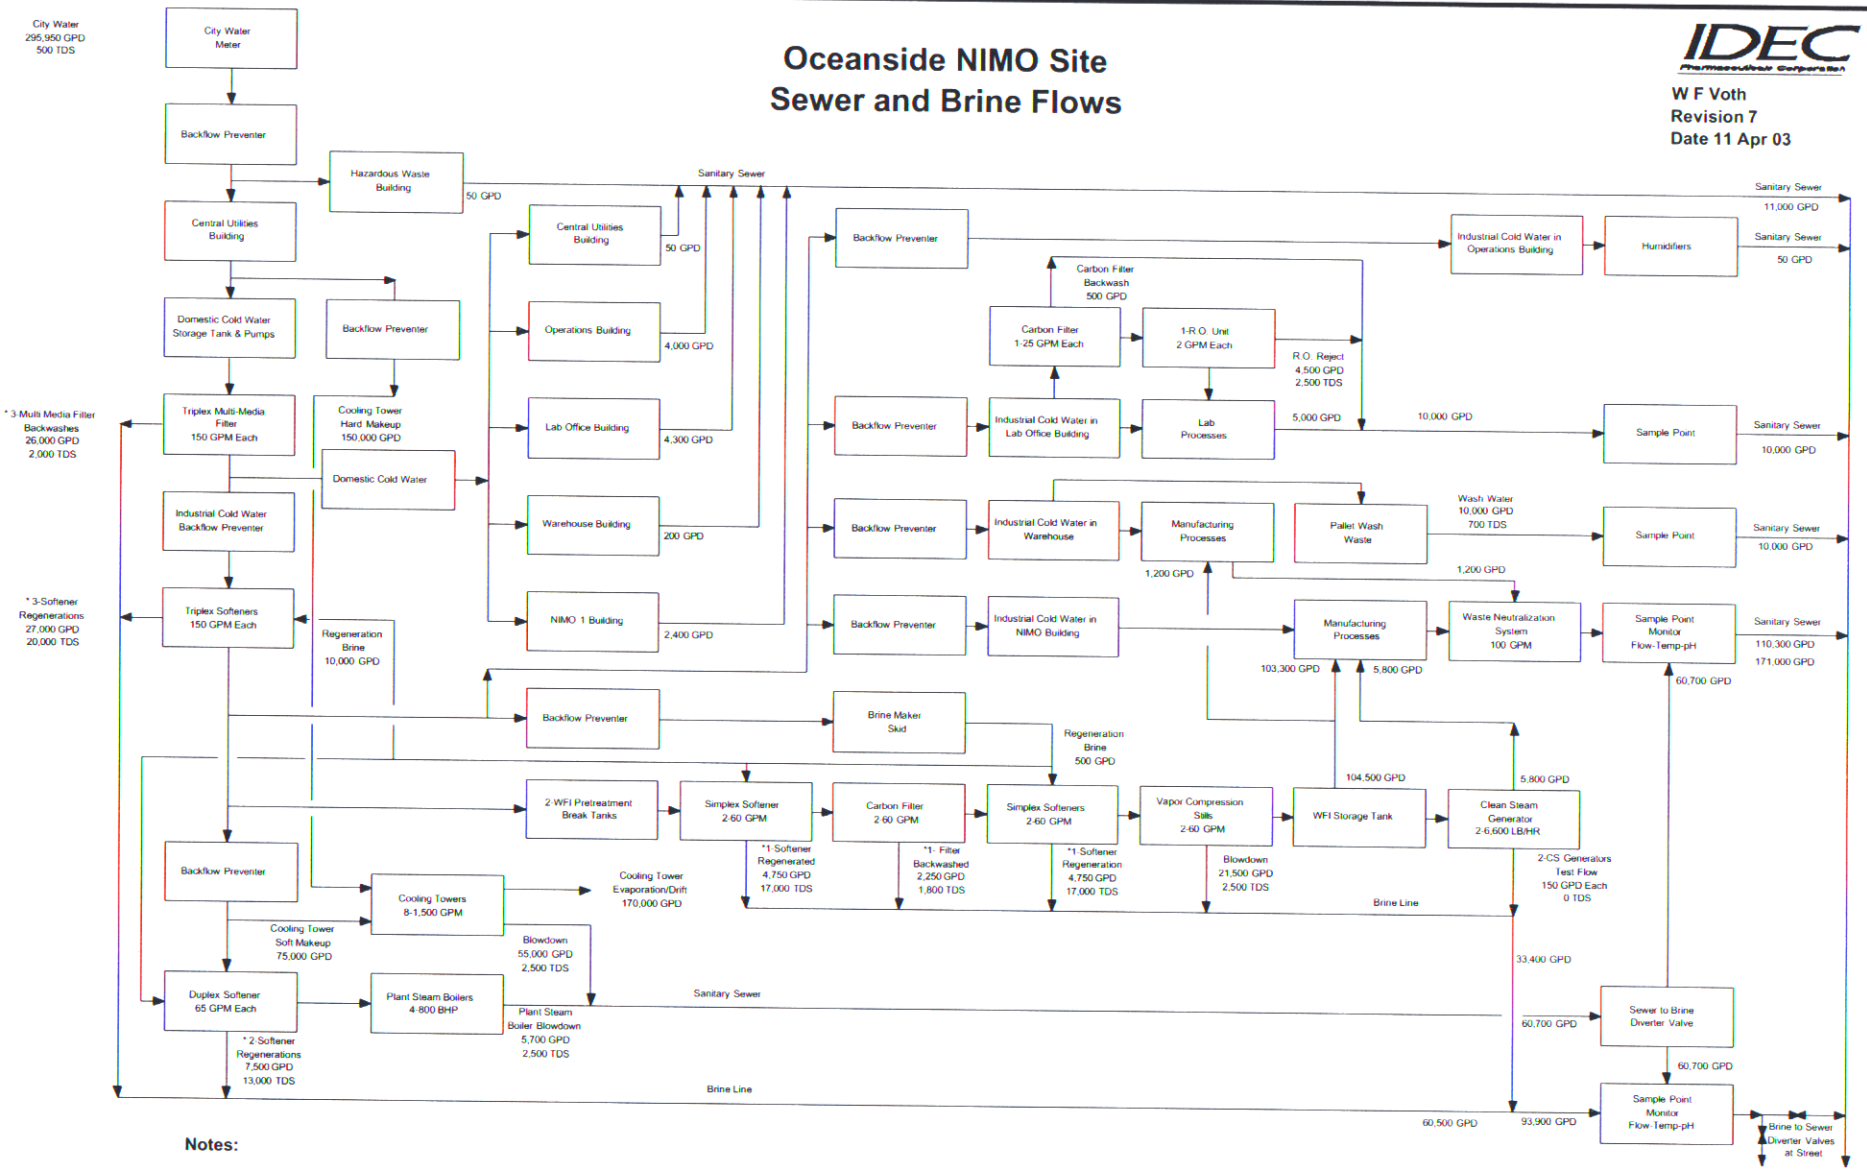

Notes:

* Denotes equipment that will be sequenced by the BMS so that only one skid will be in backwash or regeneration at a time.